

City of Baltimore
Department of Public Works

Modified Consent Decree
Calendar Quarterly Report

Sanitary Sewer Overflow Consent Decree
Civil Action No. JFM-02-1524

Calendar Quarterly Report No. 23
For Calendar Quarter ending June 30, 2023



Mayor
BRANDON M. SCOTT



Table of Contents

1.0	Executive Summary	1
2.0	Sanitary Sewer Overflows (SSOs)	3
2.1	SSO Structures.....	3
2.2	Building Backups	4
3.0	Phase I Projects	20
3.1	Milestone Progress Updates for Collection System Projects	22
4.0	Phase II Projects	24
5.0	Flow Monitoring and Information Management	27
6.0	Pumping Station Inspection and Repair	30
7.0	Illegal Connections to the Collection System	33
8.0	Sanitary Discharges of Unknown Origin (SDUO)	34
9.0	MCD Compliance Issues.....	35
10.0	Annual Costs for Appendix B Projects	39
11.0	Acronyms.....	44
	Attachment 1. Collection System SSO Events during the Calendar Quarter	46
	Attachment 2. SSO Structure Overflows During the Calendar Quarter	48
	Attachment 3. Reported Building Backups During the Calendar Quarter.....	49
	Attachment 4. Map of Reported Building Backups During the Calendar Quarter.....	102
	Attachment 5. SDUO	103

List of Tables

Table 2-1.	Remaining (Current) SSO Structure Status	4
Table 2-2.	FY 2023 All ERP Applications.....	6
Table 2-3.	FY 2023 All ERP Applications Meeting Procedural Requirements	6
Table 2-4.	Amount Paid to Date Under the ERP for Fiscal Years 2018, 2019, 2020, 2021, 2022, and 2023	7
Table 2-5.	ERP Claims as of June 30, 2023	8
Table 5-1.	Rainfall and Flow Monitoring at Meter Locations	27
Table 5-2.	Rainfall and Flow Monitoring at SSO Structures.....	28
Table 6-1.	Pumping Station Progress Report for Calendar Quarter	31
Table 6-2.	Identified Deficiencies Not Resolved Within Six Months	32

Table 7-1.	Illegal Connection Status for Calendar Quarter	33
Table 9-1.	Impacts to Elimination of SSO Structures	37
Table 10-1.	Costs Incurred to Date	39

List of Figures

3-1.	Phase I Project Work Completed During Calendar Quarter	21
3-2.	SC 941 – 48” Pipelaying operation	22
3-3.	SC 941 – Prep for bypass tie-in	23
4-1.	SC 1021 – CCTV inspection	25
4-2.	SC 1021 – Setting up for CCTV inspection	26

1.0 Executive Summary

This Calendar Quarterly Report (“Quarterly Report”) is submitted pursuant to the requirements of the Modified Consent Decree (MCD) entered on October 6, 2017 by the United States (U.S.) District Court for the District of Maryland. This Quarterly Report is intended to provide an update on the progress of remedial measures and programs required by the MCD. The primary requirements for the Quarterly Report are specified in Paragraph 21 of the MCD. The City of Baltimore (“the City” or “Baltimore City”) has provided its progress on key MCD paragraphs below. This Quarterly Report details the City’s efforts for the calendar quarter ending June 30, 2023.

The Quarterly Report includes attachments that highlight Sanitary Sewer Overflow (SSO) events, building backups, and Sanitary Discharges of Unknown Origin (SDUO) that occurred during the calendar quarter. A compact disk with flow monitoring data, rain gauge data, SSO overflow tables, and SSO 5-Day Reports are also included with the Quarterly Report.

Paragraph 8: Elimination of SSO Discharges:

Following the initial listing of SSO structures in the 2002 Consent Decree (CD), the City has identified 15 additional SSO structures, and seven of those additional structures have been eliminated. The City has submitted corrective action plans for the additional SSO structures. Flow monitoring is ongoing and rainfall data continues to be collected from nine citywide gauges and 11 countywide gauges to inform the planning for timely elimination of the remaining SSO structures. Ten SSO structures remain, five of which have completed the associated project needed for elimination and are in Post-Construction Flow Monitoring (PCFM) phase.

For additional detail on elimination of SSO discharges and description of activities performed during this quarter, please see *Section 2.1 SSO Structures*.

Paragraph 9: Implementation of Sewershed Plans:

In total, the City has completed or recognized substantial completion for 38 Phase I construction projects. A single Phase I collection system project is in active construction: Sanitary Contract (SC) 941. Several factors continue to challenge completion of SC 941, including unforeseen site conditions, valve and bypass challenges, and subcontractor lack of production due to large overall workloads in the region. The City has focused on mitigating the latter issue through the Small Business Development Program (SBDP), which seeks to increase the number of locally qualified contractors and teaming partners, as well as increase the skilled workforce. The City has submitted to the EPA and MDE several time of performance extension requests to complete SC 941, the most recent on January 13, 2023.

For additional detail on implementation of the Sewershed Plan and a description of activities performed during this quarter, please see *Section 3.0 Phase I Projects*.

Appendix E: Building Backup Expedited Reimbursement Program (BBERP)

The approval rating for applications submitted under the Expedited Reimbursement Pilot Program meeting all specified requirements was 22% for Fiscal Year (FY) 2018, 23% for FY 2019, 11% for FY 2020, 13% for FY 2021, 0% for FY 2022, and 0% for FY 2023. See Section 2.2 for a detailed summary of the number of applications by FY. Table 2-3 provides a current status of requests under the Expedited Reimbursement Pilot Program current as of June 30, 2023 as required in Appendix E of the MCD.

For additional detail on the progress of the BBERP and a description of activities performed this quarter, please see *Section 2.2 Building Backups*.

Phase II Progress

The MCD required submittal of the Phase II Plan Report to the U.S. Environmental Protection Agency (EPA) and the Maryland Department of the Environment (MDE) by December 31, 2022. On December 28, 2022, the City requested a time of performance extension to submit the Phase II Plan by January 31, 2023. In response to a request by Blue Water Baltimore (BWB) for a 60-day comment period extension, on February 2, 2023, following an extended public comment period, the City requested an extension to submit the Phase II Plan Report by May 4, 2023. On April 27, 2023, the City was made aware of an additional 272 comments organized by BWB using a third-party system. Because the third-party system is a known purveyor of spam email, the City Information Technology (IT) software security blocked the emails. Once obtained, the City reviewed and updated the Phase II Plan as necessary. The City transmitted the final Phase II Plan Report on May 31, 2023.

The City has evaluated data from Phase I PCFM at select basins and developed a strategic plan to confirm the effectiveness of sewer rehabilitation projects following Phase I project completion. Thus far, results of the PCFM program are comparable to the assumptions made during Phase I planning. Note that due to ongoing construction delays, not all projects are complete and therefore not all PCFM data has been analyzed. Upon completion of the outstanding Phase I projects, meters are installed and additional PCFM data is analyzed accordingly.

For additional detail on Phase II progress and a description of activities performed during this quarter, please see *Section 4.0 Phase II Projects*.

2.0 Sanitary Sewer Overflows (SSOs)

The City reports SSO activity per the requirements of the MCD. Attachment 1 lists SSO events that occurred during this calendar quarter. Attachment 2 lists SSO events that occurred at SSO Structures during this calendar quarter.

2.1 SSO Structures

To date, the City has eliminated 60 out of 62 SSO structures identified at the time of the 2002 CD. The remaining SSO structures identified in the 2002 CD (#67 and #72) cannot be eliminated until SC 941 is complete and sedimentation issues in the interceptor system have been addressed. The Headworks Project, which is complete, has mostly eliminated the backwater condition that was the main instigator of overflows at Structures #67 and #72 and allowed the City to proceed with its PCFM at these two structures.

The City expects less frequent activation of SSO discharge at SSO Structures #67 and #72 due to the relief of the backwater condition and completion of over 90% of the sewer work associated with SC 941. However, observed sedimentation and debris in the interceptor continues to contribute to activations at SSO Structures #67 and #72. The City is actively engaging a large-diameter sewer inspection and cleaning company to address the sedimentation and debris issues under SC 966.

Since 2002, the City has discovered an additional 15 SSO structures and eliminated seven of those newly identified structures, for a total of eight additional discovered SSO structures remaining. Combined with SSO Structures #67 and #72 referenced previously, there is a total of 10 SSO structures in existence, as shown in Table 2-1.

Substantial completion of projects needed to eliminate structures is complete and PCFM has commenced and continues for a period of 18 months at the following SSO structures: 135, 138, 139, 156, and 157. Elimination of SSO Structures #152 and #154 was dependent on the Headworks Project being fully operational. Upon completion of the Headworks Project, the City began proceeding with PCFM at these two structures. However, because of observed interceptor sedimentation and debris, as mentioned above in relation to SSO Structures #67 and #72, there still is risk of continued activations at SSO Structures #152 and #154. The City believes this risk will lessen as project SC 966 continues to clean out the interceptor system downstream of SSO Structures #152 and #154.

Attachment 2 lists discharges from SSO structures that occurred during the calendar quarter.

Table 2-1 lists the SSO structures that must be eliminated under the MCD, the stipulated date for the elimination, and the date of actual elimination for any SSO structure(s) eliminated during the calendar quarter.

Table 2-1. Remaining (Current) SSO Structure Status

SSO Structure No.	Manhole ID	Location ¹	Sewershed	MCD Stipulated Date of Substantial Completion of Construction	MCD Stipulated Date of Elimination	Date of Elimination During Calendar Quarter
67	S31MM_013MH	Falls Road, approx. 1,100' northwest of US 1 bridge intersection	Jones Falls	Jan 1, 2021	TBD upon completion of SC 966	
72	S37GG_007MH	Rear of 428 East Preston St.	Jones Falls	Jan 1, 2021	TBD upon completion of SC 966	
135	S11UU_008MH	3104 Liberty Heights Ave.	High Level	Jul 26, 2022	Jan 26, 2024	
138	S07EE 1023MH	W. Cold Spring La. & Ayrdale Ave.	High Level	Jul 26, 2022	Jan 26, 2024	
139	S11QQ 1002MH	W. Garrison Ave. & Queensberry Ave.	High Level	Jul 26, 2022	Jan 26, 2024	
152	S33II_004MH	N. Charles St. & W. Lanvale St.	Jones Falls	Jan 1, 2021	TBD upon completion of SC 966	
154	S33KK_033MH	N. Charles St. & W. Lafayette Ave.	Jones Falls	Jan 1, 2021	TBD upon completion of SC 966	
155 ¹	S03WW1008MH	3404 Glen Avenue	Jones Falls	Jun 1, 2024	Dec 1, 2025	
156 ¹	S08G__001MH	Charing Cross Road & Greenwich Avenue	Gwynns Falls	Jan 1, 2024	Jul 1, 2025	
157 ¹	S35YY_036MH	East 32 nd Street & St. Paul/Hargrove Alley	Jones Falls	Jan 1, 2023	Jul 1, 2024	

¹ Four SSO structures (#155, #156, #157, and #158, identified on September 13, 2016; June 6, 2017; September 19, 2017; and November 9, 2017, respectively) discovered after lodging of the MCD were not included in Appendix A of the MCD. Flow meters are installed at SSO Structures #155, #156, and #157, and these locations are monitored for overflow activity. The City proposed corrective plans for SSO Structures #155, #156, #157, which were approved by the EPA and MDE on July 25, 2018.

The City will continue to monitor and evaluate activity at all SSO structures and will continue to keep the EPA and MDE advised of progress in future Calendar Quarterly Reports.

2.2 Building Backups

The MCD prescribes enhanced measures to investigate and address building backups. Appendix E of the MCD requires an Expedited Reimbursement Program (ERP) to reimburse City residents for verified cleanup/disinfection costs arising from building backups caused by wet weather surcharging in the

collection system. Data from the program is reported on an annual basis beginning in the Quarterly Report due following the one-year anniversary of the program. Per Appendix E, the program is required to begin six months after Date of Entry (DOE), resulting in a program start date of April 6, 2018. The City has developed an electronic system and supporting documentation to process applications and correspondence under the ERP.

The ERP is advertised through various media, including the Department of Public Works (DPW) website, community outreach events, billing inserts, and the guide distributed to customers when the City responds to sewage backups.

The attachments below summarize the required information for building backups that occurred during this Calendar Quarter ending June 30, 2023. Attachments specific to building backups include:

- Attachment 3. Reported Building Backups during the Calendar Quarter, pursuant to subparagraph 21.i.
- Attachment 4. Map of Reported Building Backups during the Calendar Quarter, pursuant to subparagraph 21.i.

The events listed in Attachments 3 and 4 may have a variety of causes, including: roots; improper disposal of wipes, Fats, Oil, and Grease (FOG), or other inappropriate items; Infiltration and Inflow (I/I); or issues in public or private infrastructure. Building backups are addressed once they are reported to the City. The DPW has several proactive programs to address building backups including targeted cleaning, FOG abatement, root control, and SSO root cause analysis. For an entry to be reported, it must meet certain criteria including following application timelines, be wet-weather capacity related, and have occurred during a rain event. A rain event is defined by the DPW as .05 inches or more of rain.

The Expedited Reimbursement Pilot Program began on April 6, 2018. A summary of the performance of the program is reported on an annual basis during the calendar quarter ending June 30. Fiscal years begin on July 1 and end on June 30 of the following year. The City submitted a long-term plan for building backups to the EPA and MDE for approval. On May 22, 2023, the EPA provided comments on the City's long-term building backup plan and on July 21, 2023, the City responded to the EPA's comments.

Table 2-2. FY 2023 All ERP Applications

Description	Count	Percent out of Total Applications
Total	27	100%
Final Determinations	27	100%
Denied - Procedural Issues	27	100%
Denied - Non-Procedural issues	0	0%
Approved	0	0%
Approvals waiting documentation	0	0%

Table 2-3. FY 2023 All ERP Applications Meeting Procedural Requirements

Description	Count	Percent out of Applications Meeting Procedural Requirements
Total	27	100%
Denied	27	100%
Approved	0	0%

Table 2-4. Amount Paid to Date Under the ERP for Fiscal Years 2018, 2019, 2020, 2021, 2022, and 2023

Fiscal Year	Amount Paid to Date
FY2018*	\$4,500.00
FY2019**	\$10,275.00
FY2020	\$1,000.00
FY2021**	\$5,244.41
FY2022	\$0.00
FY2023	\$0.00
TOTAL	\$21,019.41

**ERP started on April 6, 2018. As such, FY 2018 data accounts for the period starting April 6, 2018 through June 30, 2018.*

*** Determinations on reimbursement amounts are outstanding for approved applications due to outstanding information from the resident. For FY19, two approved applications are awaiting documentation. For FY21, two approved applications are awaiting documentation. Thus, the amount paid for applications occurring in FY19 and/or FY21 is subject to change.*

Table 2-5. ERP Claims as of June 30, 2023

Request No.	Date of Occurrence	Location of Incident	Amount Requested	Application Received Date	Request Determination	Amount Approved	Determination Rationale	Determination Date	Determination Time (in Days)
FY 2018									
RP-2018-10001	4/14/2018	1638 Northwick Road, 21218	\$2,500.00	4/17/2018	Denied		Not caused by weather - House connection choke	4/20/2018	3
RP-2018-10006	5/15/2018	1253 Walker Avenue, 21239	\$2,500.00	5/16/2018	Denied		Not caused by surcharging-Roots	5/30/2018	14
RP-2018-10008	4/20/2018	2302 Mount Royal Terrace, 21217	\$2,500.00	5/22/2018	Denied		No notice to City within 24 hours	5/25/2018	3
RP-2018-10009	4/14/2018	5203 Muth Avenue, 21207	\$2,500.00	6/4/2018	Denied		No notice to City within 24 hours	6/4/2018	0
RP-2018-10010	5/23/2018	954 North Hill Road, 21218	\$1,615.00	6/6/2018	Denied		Not caused by surcharging	6/7/2018	1
RP-2018-10011	5/28/2018	5127 Frederick Avenue, 21229	\$2,500.00	6/9/2018	Approved	\$2,000.00	Surcharging proven	8/21/2018	72
RP-2018-10012	4/26/2018	1525 Wadsworth Way, 21239	\$1,925.75	6/11/2018	Denied		Not caused by weather - House connection choke via roots	6/14/2018	3
RP-2018-10013	4/7/2018	312 Lyndhurst Street, 21229	\$2,500.00	6/12/2018	Denied		Investigator determination of no surcharging	6/14/2018	2
RP-2018-10014	1/10/2018	1165 W. Hamburg Street, 21230	\$500.00	6/13/2018	Denied		Incident prior to pilot start date (04/06/2018)	6/14/2018	1
RP-2018-10015	5/27/2018	5511 Medwick Garth South, 21228	\$2,500.00	6/18/2018	Approved	\$2,500.00	Surcharging proven	6/19/2018	1
RP-2018-10016	5/27/2018	503 Hilton Avenue, 21228	\$1,671.00	6/19/2018	Denied		Baltimore County	6/19/2018	0
RP-2018-10017	5/27/2018	5450 Frederick Avenue, 21229	\$2,500.00	6/22/2018	Denied		No notice to City within 24 hours	6/26/2018	4
RP-2018-10018	4/8/2018	3805 Hayward Avenue, 21215	\$2,500.00	6/25/2018	Denied		No notice to City within 24 hours	6/26/2018	1
RP-2018-10021	5/19/2018	5605 Key Avenue, 21215	\$2,900.00	6/26/2018	Denied		No notice to City within 24 hours	6/28/2018	2
FY 2019									
RP-2018-10023	3/7/2018	2923 Fleetwood Avenue, 21214	\$840.00	7/1/2018	Denied		Incident prior to pilot start date (04/06/2018)	7/2/2018	1
RP-2018-10024	5/27/2018	225 Medwick Garth East	\$2,454.75	7/3/2018	Approved	\$500.00	Surcharging proven - Insurance Company Also Paid	8/14/2018	41
RP-2018-10025	5/16/2018	3417 Chesley Avenue, 21234	\$2,500.00	7/6/2018	Denied		Investigator determination of no surcharging	7/16/2018	10
RP-2018-10026	5/27/2018	5533 Medwick Garth South, 21228	\$2,414.92	7/6/2018	Approved	\$2,325.00	Surcharging proven - Invoices used to determine amount granted	9/6/2018	60
RP-2018-10027	6/9/2018	2202 Linden Avenue, 1st Floor, 21217	\$2,500.00	7/12/2018	Denied		Investigator determination of no surcharging	7/16/2018	4
RP-2018-10028	6/3/2018	4502 Craddock Avenue, 21212	\$2,500.00	7/17/2018	Approved	\$500.00	Surcharging proven-Invoice and receipt used to determine amount granted	8/28/2018	41

Request No.	Date of Occurrence	Location of Incident	Amount Requested	Application Received Date	Request Determination	Amount Approved	Determination Rationale	Determination Date	Determination Time (in Days)
RP-2018-10029	5/28/2018	2316 Allendale Road, 21216	\$1,000.00	7/17/2018	Denied		Investigator determination of no surcharging	7/18/2018	1
RP-2018-10030	7/21/2018	805 Wicklow Road, 21229	\$332.54	7/23/2018	Denied		No notice to City within 24 hours	7/23/2018	0
RP-2018-10031	5/28/2018	3400 Virginia Avenue, 21215	\$2,300.00	7/24/2018	Denied		Roots in House Connection	7/25/2018	1
RP-2018-10032	7/21/2018	3817 Glengyle Avenue, 21215	\$2,500.00	7/24/2018	Approved	\$2,500.00	Surcharging proven-Invoice and receipt used to determine amount granted	9/18/2018	54
RP-2018-10033	7/23/2018	3817 Glengyle Avenue, 21215	\$2,500.00	7/24/2018	Approved	\$1,250.00	Surcharging proven-Invoice and receipt used to determine amount granted	9/18/2018	54
RP-2018-10056	5/27/2018	5535 Medwick Garth South, 21228	\$2,500.00	7/26/2018	Approved	\$1,000.00	Surcharging proven-Invoice and receipt used to determine amount granted	11/13/2018	107
RP-2018-10034	6/5/2018	1531 Penrose Avenue, 21223	\$2,500.00	7/26/2018	Denied		No notice to City within 24 hours	7/27/2018	1
RP-2018-10035	7/23/2018	3724 Ferndale Avenue, 21207	\$2,500.00	7/30/2018	Denied		No notice to City within 24 hours	7/30/2018	0
RP-2018-10036	5/27/2018	5517 Medwick Garth South, 21228	\$1,200.00	7/30/2018	Approved	\$1,200.00	Surcharging proven-Invoice and receipt used to determine amount granted	8/20/2018	20
RP-2018-10037	5/27/2018	5128 Edmondson Avenue, 21229	\$2,500.00	7/30/2018	Approved- Awaiting Documentation - Final Insurance Determination				TBD
RP-2018-10038	6/5/2018	5128 Edmondson Avenue, 21229	\$350.00	7/30/2018	Denied		No notice to City within 24 hours	8/23/2018	23
RP-2018-10043	3/20/2018	2819 Santa Fe Avenue, 21215	\$2,500.00	8/2/2018	Denied		Incident prior to pilot start date (04/06/2018)	8/7/2018	5
RP-2018-10055	7/27/2018	2819 Santa Fe Avenue, 21215	\$2,500.00	8/2/2018	Denied		Investigator determination of no surcharging- Removal of Rags and Debris	8/28/2018	26
RP-2018-10044	7/21/2018	4171 Crest Heights Road, 21215	\$1,537.50	8/3/2018	Denied		Investigator determination of no surcharging- Removal of Grease, Rocks and Debris	8/7/2018	4
RP-2018-10045	7/22/2018	4300 Elderon Avenue, 21215	\$160.95	8/7/2018	Denied		Investigator determination of no surcharging	8/8/2018	1
RP-2018-10046	5/29/2018	103 West Northern Parkway, 21210	\$2,500.00	8/9/2018	Denied		Investigator determination of no surcharging- Removal of Grease, Rocks and Debris	8/9/2018	0
RP-2018-10047	5/24/2018	2767 The Alameda, 21227	\$2,500.00	8/13/2018	Denied		No notice to City within 24 hours	8/14/2018	1
RP-2018-10048	7/27/2018	10 S. Monastery Avenue, 21229	\$1,000.00	8/15/2018	Denied		Investigator determination of no surcharging- Removal of Grease, Rocks and Debris	8/21/2018	6
RP-2018-10049	7/23/2018	3403 Bateman Avenue, 21216	\$1,500.00	8/15/2018	Denied		No notice to City within 24 hours	8/21/2018	6
RP-2018-10050	5/27/2018	5130 Edmondson Avenue, 21229	\$2,500.00	8/17/2018	Approved after reconsideration		No notice to City within 24 hours - Reconsidered after review and based on data from RP-2018-10037	8/21/2018	4

Request No.	Date of Occurrence	Location of Incident	Amount Requested	Application Received Date	Request Determination	Amount Approved	Determination Rationale	Determination Date	Determination Time (in Days)
RP-2018-10051	7/21/2018	5011 Westhills Road, 21229	\$2,272.24	8/17/2018	Denied		No notice to City within 24 hours	8/21/2018	4
RP-2018-10052	07/22/2018; 07/25/2018; 07/27/2018	3405 Orlando Avenue, 21234	\$1,479.68	8/21/2018	Denied		Investigator determination of no surcharging-Removal of Grease, Rocks and Debris-House Connection broken on consumer side	8/22/2018	1
RP-2018-10053	8/13/2018	5627 Govane Avenue, 21212	\$2,500.00	8/23/2018	Denied		No notice to City within 24 hours	8/27/2018	4
RP-2018-10054	7/24/2018	25 York Court, #3, 21218	\$1,585.00	8/27/2018	Denied		Not caused by surcharging-Roots in House Connection	8/28/2018	1
RP-2018-10057	5/31/2018	806 Glen Allen Drive, 21229	\$2,500.00	8/28/2018	Denied		Investigator determination of no surcharging	8/29/2018	1
RP-2018-10058	5/27/2018	427 Drury Lane, 21229	\$2,500.00	8/28/2018	Approved	\$1,000.00	Surcharging proven - Insurance Company Also Paid	9/18/2018	20
RP-2018-10060	5/27/2018	3827 Callaway Avenue, 21215	\$2,500.00	9/11/2018	Denied		No notice to City within 24 hours and application not received within 90 days of discovery	9/12/2018	1
RP-2018-10061	8/31/2018	1014 Rockhill Avenue, 21229	\$2,500.00	9/19/2018	Denied		No notice to City within 24 hours	9/19/2018	0
RP-2018-10062	1/15/2018	3408 Holmes Avenue, 21217	\$2,500.00	9/21/2018	Denied		Incident prior to pilot start date (04/06/2018)	9/21/2018	0
RP-2018-10063	8/10/2018	6306 Wallis Avenue, 21215	\$2,500.00	9/21/2018	Denied		No notice to City within 24 hours	9/25/2018	4
RP-2018-10064	8/31/2018	925 Rockhill Avenue, 21229	\$2,500.00	9/24/2018	Denied		No notice to City within 24 hours	9/25/2018	1
RP-2018-10065	5/27/2018	4206 Elderon Avenue, 21215	\$100.00	9/25/2018	Denied		Application not received within 90 days of date of incident discovery and investigator determined incident not due to surcharging	9/26/2018	1
RP-2018-10066	9/24/2018	934 N. Eden Street, 21205	\$446.00	9/26/2018	Denied		Investigator determination of no surcharging-Removal of Grease, Rags and Debris	9/26/2018	0
RP-2018-10067	7/25/2018	4305 Belvieu Avenue, 21215	\$2,500.00	9/27/2018	Denied		Investigator determination of no surcharging-Removal of Rags and Debris	9/27/2018	0
RP-2018-10068	8/31/2018	3626 Hinline Road, 21229	\$2,400.00	10/2/2018	Denied		No notice to City within 24 hours	10/3/2018	1
RP-2018-10069	5/20/2018	2211 Chelsea Terrace, 21216	\$2,500.00	10/9/2018	Denied		No notice to City within 24 hours and application not received within 90 days of discovery	10/12/2018	3
RP-2018-10070	5/27/2018	2211 Chelsea Terrace, 21216	\$2,500.00	10/9/2018	Denied		No notice to City within 24 hours and application not received within 90 days of discovery	10/12/2018	3
RP-2018-10071	6/10/2018	2211 Chelsea Terrace, 21216	\$1,500.00	10/9/2018	Denied		No notice to City within 24 hours and application not received within 90 days of discovery	10/12/2018	3
RP-2018-10072	5/27/2018	3933 Colchester Road, 21229	\$2,500.00	10/11/2018	Denied		No notice to City within 24 hours and application not received within 90 days of discovery	10/12/2018	1

Request No.	Date of Occurrence	Location of Incident	Amount Requested	Application Received Date	Request Determination	Amount Approved	Determination Rationale	Determination Date	Determination Time (in Days)
RP-2018-10074	7/22/2018	4222 Fallstaff Road, 21215	\$7,356.00	10/16/2018	Denied		Investigator determination of no surcharging-Removal of Grease, Rags and Debris	10/17/2018	1
RP-2018-10075	9/10/2018	1210 Haverhill Road, 21229	\$536.34	10/16/2018	Denied		Investigator determination of no surcharging-Removal of Debris from Sewer Mainline and House Connection	10/18/2018	2
RP-2018-10076	7/22/2018	3823 Menlo Drive, 21215	\$2,782.00	10/17/2018	Approved- Awaiting Documentation - Final Insurance Determination				TBD
RP-2018-10078	9/17/2018	2831 Gwynns Falls Pkwy, 21216	\$584.68	10/30/2018	Denied		Investigator determination of no surcharging-Removal of Grease, Rags and Debris	11/1/2018	1
RP-2018-10079	9/18/2018	2831 Gwynns Falls Pkwy, 21216	\$584.68	10/30/2018	Denied		Investigator determination of no surcharging-Removal of Grease, Rags and Debris	11/1/2018	1
RP-2018-10081	10/25/2018	2827 N. Howard Street, 21218	\$350.00	11/5/2018	Denied		Investigator determination of no surcharging-Removal of Rags and Debris	11/7/2018	2
RP-2018-10082	8/29/2018	1024 Rockhill Avenue, 21229	\$28,000.00	10/12/2018	Denied		No notice to City within 24 hours	11/30/2018	48
RP-2018-10083	11/20/2018	3305 Bancroft Road, 21215	\$700.00	11/29/2018	Denied		Not caused by surcharging-Roots in House Connection	11/30/2018	1
RP-2018-10086	11/24/2018	1349 Glenwood Avenue, 21239	\$2,500.00	12/31/2018	Denied		Investigator determination of no surcharging-Removal of Rags and Roots	12/31/2018	0
RP-2019-10087	11/25/2018	2813 N. Howard Street, 21218	\$1,522.84	1/29/2019	Denied		No notice to City within 24 hours	1/29/2019	0
RP-2019-10088	1/23/2019	654 E. 35th Street, 21218	\$934.00	1/29/2019	Denied		Investigator determination of no surcharging-Removal of Rags and Debris	1/30/2019	1
RP-2019-10090	2/22/2019	6216 Woodcrest Avenue, 21209	\$2,500.00	4/11/2019	Denied		Investigator determination of no surcharging-Removal of Rags and Debris	4/11/2019	0
RP-2019-10091	2/24/2019	8 Bellemore Road, 21210	\$2,500.00	4/11/2019	Denied		Investigator determination of no surcharging-Removal of Roots, Dirt and Debris	4/16/2019	5
RP-2019-10092	3/4/2019	706 Hunting Place, 21229	\$773.00	4/16/2019	Denied		Not caused by surcharging-Roots in House Connection	4/17/2019	1
RP-2019-10093	2/22/2019	6218 Woodcrest Avenue, 21209	\$1,654.00	4/18/2019	Denied		Investigator determination of no surcharging-Removal of Rags and Debris	4/22/2019	4
RP-2020-10119	2/2/2019	801 Glen Allen Drive, 21229	\$3,000.00	8/5/2020	Denied		Not caused by surcharging-Roots in House Connection-App sent to Law w/Liability Claim 190009797-101 & OLRA received claim on 03-27-2019	8/6/2020	1
FY 2020									
RP-2019-10094	7/12/2019	4304 Elderon Avenue, 21215	\$108.43	9/10/2019	Approved after reconsideration		Investigator could not determine whether surcharging- no cleanout - Reconsideration determined surcharging based on OneRain data & hydraulic modeling	9/26/2019	16
RP-2019-10095	7/30/2019	3109 Northway Drive, 21234	\$2,345.41	8/14/2019	Denied		Not caused by surcharging-Roots in House Connection	9/13/2019	29

Request No.	Date of Occurrence	Location of Incident	Amount Requested	Application Received Date	Request Determination	Amount Approved	Determination Rationale	Determination Date	Determination Time (in Days)
RP-2019-10096	9/5/2019	3823 W. Rogers Avenue, 21215	\$196.69	10/22/2019	Denied		Investigator could not determine whether surcharging- no cleanout - OneRain data shows no rain events occurred within 72 hours	12/23/2019	61
RP-2019-10097	10/23/2019	6004 Berkeley Avenue, 21209	\$1,000.00	10/29/2019	Denied		Investigator determination-Roots in House Connection	12/23/2019	54
RP-2019-10098	7/4/2019	4 Bellemore Road, 21210	\$2,500.00	9/27/2019	Approved	\$1,000.00	Investigator determination of surcharging - Insurance Company Also Paid	12/27/2019	90
RP-2019-10099	12/2/2019	1716 Hartsdale Road, 21239	\$2,500.00	12/27/2019	Denied		Investigator determination-Roots in House Connection	12/31/2019	4
RP-2019-10100	11/24/2019	5221 Tramore Road, 21214	\$12,128.88	12/16/2019	Denied		Investigator determination of no surcharging- Removal of Heavy Rags, Paper and Debris	1/6/2020	20
RP-2020-10101	12/8/2019	430 Kane Street, 21224	\$1,258.66	1/9/2020	Denied		No notice to City within 24 hours	1/23/2020	14
RP-2020-10102	12/23/2019	430 Kane Street, 21224	\$1,258.66	1/9/2020	Denied		Investigator determination of no surcharging- Removal of Rags, Paper and Debris	1/23/2020	14
RP-2020-10103	12/24/2019	430 Kane Street, 21224	\$1,258.66	1/9/2020	Denied		Investigator determination of no surcharging- Removal of Rags, Paper and Debris	1/23/2020	14
RP-2020-10104	11/17/2019	1217 Havenwood Road, 21218	No amount entered	1/17/2020	Denied		No notice to City within 24 hours	1/23/2020	6
RP-2020-10106	10/17/2019	6204 Cross Country Blvd., 21215	\$2,500.00	2/10/2020	Denied		Not caused by surcharging-Removal of Rags and Debris. Hydraulic Analysis Determined Not a Capacity- Related Issue	2/20/2020	10
RP-2020-10107	2/24/2020	8 Middleton Court, 21212	\$1,060.50	3/5/2020	Denied		Investigator could not determine whether surcharging- no cleanout - OneRain data shows no rain events occurred within 72 hours	3/5/2020	0
RP-2020-10108	2/25/2020	8 Middleton Court, 21212	\$1,060.50	3/5/2020	Denied		Investigator could not determine whether surcharging- no cleanout - Mainline running clear	3/5/2020	0
RP-2020-10109	2/8/2020	4411 Old Frederick Road, 21229	\$3,000.00	3/19/2020	Denied		Not caused by surcharging-Removal of Rags and Debris. Hydraulic Analysis Determined Not a Capacity- Related Issue	3/30/2020	11
RP-2020-10110	2/13/2020	710 N. Fulton Avenue, 21217	\$2,200.00	4/27/2020	Denied		Investigator determination-Roots in House Connection	4/29/2020	2
RP-2020-10111	10/30/2020	4202 Elderon Avenue, 21215	\$5,525.36	5/1/2020	Denied		No notice to City within 24 hours and application not received within 90 days of discovery	5/11/2020	10
RP-2020-10112	3/24/2020	4426 Hamilton Avenue, 21206	\$1,500.00	5/4/2020	Denied		No notice to City within 24 hours and Investigator determination of no surcharging- Removal of Heavy Grease and Debris	5/14/2020	10
RP-2020-10113	4/13/2020	5627 Govane Avenue, 21212	\$2,500.00	5/1/2020	Denied		Not caused by surcharging-Removal of Rags and Debris. Hydraulic Analysis Determined Not a Capacity- Related Issue	5/19/2020	18

Request No.	Date of Occurrence	Location of Incident	Amount Requested	Application Received Date	Request Determination	Amount Approved	Determination Rationale	Determination Date	Determination Time (in Days)
RP-2020-10114	4/12/2020	5629 Govane Avenue, 21212	TBD	5/11/2020	Denied - Awaiting Requested Amt on Application		Not caused by surcharging-Removal of Rags and Debris. Hydraulic Analysis Determined Not a Capacity- Related Issue		TBD
RP-2020-10115	4/16/2020	909 E. Patapsco Avenue, 21225	\$234.80	6/12/2020	Denied		Investigator determination-House Connection Choke	6/15/2020	3
RP-2020-10116	4/13/2020	5633 Govane Avenue, 21212	\$2,431.20	6/29/2020	Denied		Not caused by surcharging-Removal of Rags and Debris. Hydraulic Analysis Determined Not a Capacity- Related Issue	7/2/2020	3
FY 2021									
RP-2020-10117	3/3/2020	4941 Westhills Road, 21229	\$1,800.00	7/16/2020	Denied		Investigator determination-Heavy Roots in House Connection	7/20/2020	4
RP-2020-10118	7/22/2020	2900 N. Rogers Avenue, 21207	\$5,000.00	7/24/2020	Denied		Investigator determination-House Connection Choke	7/27/2020	3
RP-2020-10120	7/24/2020	213 N. Lakewood Avenue, 21224	\$134.41	8/6/2020	Approved after reconsideration	\$134.41	Reconsideration determined surcharging based on hydraulic modeling	8/12/2020	6
RP-2020-10121	7/23/2020	4317 Glenmore Avenue, 21206	\$5,000.00	8/19/2020	Denied		No notice to City about backup incident	9/15/2020	26
RP-2020-10122	6/20/2020	5604 1/2 Purlington Way, 21212	\$1,000.00	9/10/2020	Denied		Investigator determination-House Connection Choke	9/25/2020	15
RP-2020-10123	8/1/2020	700 N. Edgewood Street, 21229	\$2,500.00	9/13/2020	Denied		Not caused by surcharging-Removal of Rags and Debris. Hydraulic Analysis Determined Not a Capacity- Related Issue	9/29/2020	16
RP-2020-10124	5/5/2020	423 Gwynn Avenue, 21229	\$5,000.00	8/12/2020	Denied		Investigator determination-House Connection/Lateral Issue	10/1/2020	49
RP-2020-10125	1/25/2020	1031 Saint Dunstons Road, 21212	\$5,000.00	9/8/2020	Denied		Not caused by surcharging- Hydraulic Analysis Determined Not a Capacity- Related Issue	10/6/2020	28
RP-2020-10126	7/22/2020	1534 Pentwood Road, 21239	\$1,000.00	9/16/2020	Approved	\$1,000.00	Surcharging proven - Insurance Company Also Paid	10/2/2020	16
RP-2020-10127	9/3/2020	806 N. Broadway, 21205	\$2,960.00	9/29/2020	Denied		Investigator determination of no surcharging-Removal of Rags and Debris	10/7/2020	8
RP-2020-10128	9/4/2020	1638 Northwick Road, 21218	\$500.00	9/14/2020	Denied		Not caused by surcharging- Hydraulic Analysis Determined Not a Capacity- Related Issue	10/9/2020	25
RP-2020-10129	8/29/2020	421 Southway, 21218	\$709.10	10/7/2020	Denied		Not caused by surcharging- Hydraulic Analysis Determined Not a Capacity- Related Issue	10/16/2020	9
RP-2020-10130	9/2/2020	1130 Kevin Road, 21229	\$1,852.00	10/13/2020	Denied		Investigator determination-House Connection/Lateral Issue	10/16/2020	3
RP-2020-10131	8/4/2020	1610 Dundalk Avenue, 21222	\$150.00	10/23/2020	Approved	\$150.00	Determined that surcharging occurred based on hydraulic modeling	11/4/2020	11
RP-2020-10132	10/13/2020	5005 Saint Albans Way, 21212	\$3,225.00	11/5/2020	Denied		Not caused by surcharging- Hydraulic Analysis Determined Not a Capacity- Related Issue	11/12/2020	7
RP-2020-10133	10/22/2020	2317 E. Fairmount Avenue, 21224	\$287.00	11/10/2020	Denied		Investigator determination-House Connection/Lateral Issue	11/13/2020	3
RP-2020-10134	10/30/2020	326 S. Chester Avenue, 21231	\$3,081.64	11/24/2020	Denied		Investigator determination-House Connection/Lateral Issue	11/25/2020	1

Request No.	Date of Occurrence	Location of Incident	Amount Requested	Application Received Date	Request Determination	Amount Approved	Determination Rationale	Determination Date	Determination Time (in Days)
RP-2020-10135	11/12/2020	1162 E. Northern Pkwy, 21239	\$2,500.00	12/22/2020	Approved	\$2,500.00	Bureau W/WW determined that surcharging occurred based on-site visit	12/29/2020	7
RP-2021-10136	11/6/2020	422 E. Federal Street, 21202	\$3,581.25	12/9/2020	Denied		OneRain data shows no rain events occurred within 72 hours	1/4/2021	25
RP-2021-10137	11/7/2020	113-B Saint Dunstons Rd, 21212	\$1,658.15	1/5/2021	Denied		OneRain data shows no rain events occurred within 72 hours	1/6/2021	1
RP-2021-10139	7/22/2020	1536 Pentwood Road, 21239	\$5,000.00	1/14/2021	Denied		This application was past the 90 days required submission time frame. It was submitted to the City after 176 days of the backup date.	1/15/2021	1
RP-2021-10165	12/5/2020	2926 Erdman Ave, 21213	\$5,800.00	2/15/2021	Denied		Ownership cannot be verified. Sent an email to the applicant for providing additional information. Owner submitted the documents on 09.22.2021. Not a capacity related event. Investigators removed grease and rags	3/3/2021	18
RP-2021-10167	11/17/2020	620 North Pulaski Street, 21217	\$1,100.00	2/17/2021	Denied		This application was past the 90 days required submission time frame. It was submitted to the City after 92 days of the backup date. All research was done on this address. There was no rain within 72 hours of the backup.	3/3/2021	16
RP-2021-10168	2/15/2021	500 N Edgewood Street, 21229	\$2,500.00	2/23/2021	Denied		CW states that the backup was due to Rags and Debris	3/12/2021	19
RP-2021-10159	2/5/2021	3608 Frankford Ave, 21214	\$6,502.34	3/10/2021	Denied		Investigator determination of no surcharging-Removal of Rags and heavy Debris	9/1/2021	171
RP-2021-10143	2/21/2021	3015 Fait Ave, 21224	\$512.63	3/22/2021	Denied		Investigator determination of no surcharging-Removal of Rags and Debris	3/31/2021	9
RP-2021-10149	2/10/2021	2214 Cloville Ave, 21214	\$500.00	4/1/2021	Denied		Investigator determination of no surcharging-Removal of Rags and Debris	5/6/2021	35
RP-2021-10150	2/7/2021	2212 Cloville Avenue, 21214	\$3,053.40	3/23/2021	Denied		Investigator determination of no surcharging-Removal of Rags and Debris	5/6/2021	43
RP-2021-10151	3/20/2021	3005 Grantley Ave_21215	\$2,500.00	4/5/2021	Denied		Investigator determination of no surcharging-Removal of Rags and Debris	9/21/2021	166
RP-2021-10161	5/4/2021	2318 N. Longwood St._21216	\$5,000.00	5/19/2021	Denied		Investigator determination of no surcharging-Removal of Rags and Debris from the lateral. Also, it was not a wet weather event	9/17/2021	118
N/A	6/12/2021	54 Krouse Ct, Aberdeen, MD_21001	\$3,500.00	6/16/2021	Denied		Not a City resident and not served by City sewer system	9/17/2021	91
RP-2021-10162	2/28/2021	3907 Greenway_Baltimore_MD_21218	\$650.00	5/22/2021	Denied		Investigator determination of no surcharging-Removal of Rags and Debris from the lateral.	9/17/2021	115
	6/11/2021	3103 Shelburne Rd	\$6,500.00	7/1/2021	Waiting for attachments from the resident		The area is in surcharge zone. There was 2.5 inch of rain and the system is under capacity for that amount of rain.		TBD
RP-2021-10174	6/10/2021	1803 Ingram Rd	\$5,000.00	6/11/2021	Denied		311 was not called and there was no site investigation. The area is not in the Sewer deficit area	10/5/2021	114

Request No.	Date of Occurrence	Location of Incident	Amount Requested	Application Received Date	Request Determination	Amount Approved	Determination Rationale	Determination Date	Determination Time (in Days)
	6/10/2021	1735 E.35th St	\$5,000.00	6/15/2021	Waiting for the information from the resident		The area is in the Sewer deficit area.		TBD
RP-2021-10175	8/12/2020	2639 Wegworth Ln	\$6,500.00	6/3/2021	Denied		Application received after 90 days	10/5/2021	122
		2603_E.Northern Parkway	\$4,900.00	6/2/2021	Incomplete application		Sent an email to the resident		TBD
RP-2021-10176	3/3/2021	502 S Potomac St	\$6,000.00	5/28/2021	Denied		Investigators found mainline clear. SHC was broken and was replaced. Also, the sewer system has capacity during the wet weather	10/5/2021	127
RP-2021-10169	4/25/2021	107 W. Madison St	\$767.24	5/20/2021	Denied		Investigator determination of no surcharging-Broken Sewer house connection	9/30/2021	130
RP-2021-10177	5/5/2021	2405 W. Coldspring Ln	\$709.00	5/23/2021	Denied		311 was not called and there was no site investigation. The area is not in the Sewer deficit area	10/6/2021	133
RP-2021-10178	3/27/2021	847 WASHINGTON BLVD	\$5,200.00	5/17/2021	Denied		311 was not called and there was no site investigation. The area is not in the Sewer deficit area	10/6/2021	139
	3/24/2021	4903 Westhills Rd_MD_21229	\$5,000.00	6/9/2021	Waiting for additional documents from the resident				TBD
RP-2021-10157	2/5/2021	2208 Poplar Grove St	\$2,500.00	3/19/2021	Denied		Investigator determination of no surcharging-Removal of rags and debris	9/8/2021	173
FY 2022									
RP-2021-10154	11/18/2020	5467 Cedonia Ave	\$5,000.00	7/23/2021	Denied		Application not received within 90 days of date of incident discovery. No back up receipts for cleaning and sanitation	7/28/2021	5
RP-2021-10155	5/23/2021	1522 Ralworth Rd	\$1,250.00	7/6/2021	Denied		Not wet weather event. Maintenance removed rags and debris.	9/21/2021	77
RP-2021-10170	5/28/2021	501 Hawthorne Rd_20210	\$2,500.00	7/15/2021	Denied		Investigator determination of no surcharging-Removal or rags and debris	9/30/2021	77
RP-2021-10164	10/25/2020	1111 Nanticoke St_21230	\$2,200.00	9/5/2021	Denied		Application not received within 90 days of date of incident discovery	9/21/2021	16
RP-2021-10188	8/17/2021	1318 Northview Rd_21218	\$4,315.00	9/2/2021	Denied		Claimant is not an owner. SDAT information is different. Sent an email. Resident provided the mortgage contract docs. Application denied as the event was caused due to debris, rags, and paper in mainline. The mainline has enough capacity otherwise.	9/21/2021	19
RP-2021-10171	4/2/2021	812 S Fagley St_21214	\$5,000.00	9/1/2021	Denied		Investigator determination of no surcharging-Removal of mud and grease.	10/4/2021	33
RP-2021-10173	5/12/2021	3802 Saint Paul St_21218	\$15,480.61	9/2/2021	Denied		Application received after 90 days.	10/4/2021	32
RP-2021-10179	8/3/2021	1638 Sherwood Ave_21239	\$5,000.00	8/23/2021	Denied		Investigator determination of no surcharging-Investigators determined choke is inside the home.	10/6/2021	44

Request No.	Date of Occurrence	Location of Incident	Amount Requested	Application Received Date	Request Determination	Amount Approved	Determination Rationale	Determination Date	Determination Time (in Days)
RP-2021-10180	5/18/2021	2202 Linden Avenue_21217	\$5,000.00	8/15/2021	Denied		Not a wet weather event. Investigators removed rags and debris from the mainline.	10/7/2021	53
N/A	N/A	2105 Echodale Ave_21214	\$8,000.00	8/10/2021	Incomplete application		Date of discovery is missing on the application.	10/4/2021	55
RP-2021-10172	1/10/2021	1527 Kingsway Road	\$5,000.00	6/1/2021	Denied		Application received after 90 days.	10/4/2021	125
RP-2021-10181	7/7/2021	121 Taplow Rd_21212	\$2,725.00	7/27/2021	Denied		No wet weather event. Investigators determined mainline choke and removed rags	10/7/2021	72
RP-2021-10182	7/6/2021	4023 Rosecrest Ave_21215	\$21,213.49	7/21/2021	Denied		Investigator determination of no surcharging - Removal of Rags and Debris	10/7/2021	78
RP-2021-10185	9/2/2021	5605 St Albans Way_21212	\$4,028.99	9/2/2021	Denied		311 was not called. No investigation was completed. Sewer system has enough capacity.	10/7/2021	35
RP-2021-10186	9/4/2021	4310 Kathland Ave_2107	\$5,000.00	9/4/2021	Denied		Investigator determination of no surcharging - Removed rags and debris	10/7/2021	33
N/A	10/2/2021	833 Abbott Ct_21202	\$2,000.00	10/4/2021	Denied		Not an Owner or a Tenant. Sent an email to the resident.	10/7/2021	3
RP-2021-10187	4/5/2021	4205 Gelston Dr_21229	\$978.00	10/6/2021	Denied		Application received after 90 days	10/7/2021	1
RP-2021-10189	9/17/2021	745 McKewin Ave_21218	\$5,000.00	10/17/2021	Denied		Investigator determination of no surcharging - Removed rags and debris from the house connection	12/28/2021	72
RP-2021-10190	2/28/2021	3907 Greenway_21218	\$650.00	10/27/2021	Denied		Already responded to the application last year. This is duplicate of the same application which was received after 90 days.	12/28/2021	62
RP-2022-10196	9/20/2021	6717 Roberts Ave_21222	\$1,486.00	10/26/2021	Denied		No records of 311 call or DPW investigation on September 20, 2021. No Rain on Sep 20, 2021	1/12/2022	78
RP-2021-10191	9/25/2021	3838 Elm Ave_21211	\$1,200.00	10/18/2021	Denied		Investigator determination of no surcharging - Removed roots and debris from the house connection	12/29/2021	72
RP-2021-10192	9/23/2021	1326 Pentwood Rd_21239	\$1,000.00	10/11/2021	Denied		Investigator determination mainline Choke - Removed rags and grease from the mainline	12/29/2021	79
RP-2021-10193	7/10/2021	3747 Elm Ave_21211	\$1,541.50	10/11/2021	Denied		Application received after 90 days	12/30/2021	80
RP-2021-10194	6/19/2021	3701 Evergreen Ave_21206	\$5,302.94	7/7/2021	Denied		Needed additional documents from the resident to process the application that was received on Oct 28, 2021. Not a wet weather event. Maintenance removed roots, rags and debris	12/30/2021	176
RP-2022-10203	10/29/2021	5404 Woodmont Ave	\$5,000.00	11/12/2021	Denied		Maintenance removed rags and debris from the mainline	2/17/2022	97
RP-2022-10204	9/23/2021	1320 Pentwood Rd_21239	\$10,000.00	11/23/2021	Denied		Investigator determination mainline Choke - Removed rags and grease from the mainline	2/17/2022	86
RP-2022-10199	10/29/2021	5400 Woodmont Ave_21239	\$9,891.00	11/30/2021	Denied		Investigator determination mainline Choke - Removed rags and debris from the mainline	2/2/2022	64

Request No.	Date of Occurrence	Location of Incident	Amount Requested	Application Received Date	Request Determination	Amount Approved	Determination Rationale	Determination Date	Determination Time (in Days)
RP-2022-10205	8/14/2021	2120 Cambridge St_21231	\$10,062.84	12/2/2021	Denied		Application was received on December 2, 2021 (90 days after the application) and the Maintenance team removed rags and debris from the mainline	2/17/2022	77
RP-2022-10202	8/7/2021	3501 Ellamont Rd_21215	\$10,000.00	12/13/2021	Denied		Application was received after 90 days and Investigator determination mainline Choke - Removed rags and Grease from the mainline	2/16/2022	65
RP-2022-10207	12/7/2021	1643 Montpelier St_21218	\$6,154.00	12/30/2021	Denied		No rain. Investigator determination mainline Choke - Removed debris from the mainline	2/17/2022	49
RP-2022-10208	8/18/2021	5914 Fenwick Ave_21239	\$5,000.00	1/4/2022	Denied		Application was received after 90 days and Investigator determined the mainline and the sewer house connection was clear	2/17/2022	44
RP-2022-10197	1/17/2022	5502 Elsrode Ave,	\$554.60	1/21/2022	Denied		No surcharge. The system has enough capacity for 1.08 Inches of rain.	1/25/2022	4
RP-2022-10209	1/25/2022	502 N. Lakewood Ave	\$2,500.00	1/26/2022	Denied		No rain. Maintenance removed heavy rags and heavy grease from the mainline	2/17/2022	22
RP-2022-10198	1/27/2022	2321 Ashburton St_21216	\$2,500.00	1/27/2022	Denied		No rain	2/2/2022	6
RP-2022-10210	1/1/2022	5803 Clearspring Rd_21212	\$5,000.00	2/5/2022	Denied		Investigator determination mainline Choke - Removed rags, grease and debris from the mainline	2/17/2022	12
	2/9/2022	1607 St. Paul St 21202	\$4,510.00	2/26/2022	Denied		Investigator determination mainline Choke - Removed rags and grease from the mainline.	4/13/2022	46
RP-2022-10216	1/3/2022	3900 Lyndale Ave 21213	\$4,463.32	3/8/2022	Denied		Investigator determination Sewer house connection Choke - Removed debris	4/19/2022	42
RP-2022-10217	2/19/2022	5616 Newbury St 21209	\$9,000.00	2/27/2022	Denied		Investigator determined mainline and connection Choke - Removed wipes and debris. Not a residential address	4/19/2022	51
RP-2022-10214	1/14/2022	1953 W Mulberry St 21223	\$2,800.00	2/3/2022	Denied		No rain. Investigator determination mainline Choke	3/15/2022	40
RP2021-10165	12/5/2020	2926 Erdman Ave 21213	\$5,000.00	2/25/2022	Previously Denied		Application was responded previously. Forwarded the response	4/19/2022	53
RP-2022-10213	2/4/2022	3608 Elkader Rd 21218	\$5,384.59	2/22/2022	Denied		Investigator determination Lateral and mainline Choke - Removed debris from sewer house connection and the mainline	3/15/2022	21
RP-2022-10220	3/21/2022	2503 Frank Ave 21230	\$375.00	3/22/2022	Denied		Not a wet weather event. Customer notified that Plumber relieved the Sewer House connection	4/19/2022	28
RP-2022-10221	6/10/2021	1802 Northbourne Rd 212	\$2,737.57	3/20/2022	Denied		Customer submitted the request after 90 days. No Backup was reported to 311 during the timeline	6/1/2022	73
RP-2022-10219	2/8/2022	6404 Eastern Ave 21221	\$23,000.00	3/18/2022	Denied		This is a commercial property	4/19/2022	32
RP_2022-10222	2/7/2022	5505 Belle Ave 21207	\$7,000.00	3/28/2022	Denied		Not a wet weather event. Mainline clear	6/1/2022	65

Request No.	Date of Occurrence	Location of Incident	Amount Requested	Application Received Date	Request Determination	Amount Approved	Determination Rationale	Determination Date	Determination Time (in Days)
RP-2022-10224	4/7/2022	3313 Gwynns Falls Pkwy 21216	\$700.00	4/14/2022	Denied		Investigator determination Mainline choke - Removed rags and debris	6/1/2022	48
RP-2022-10218	3/18/2022	6227 Berkeley Ave 21209	\$5,000.00	4/6/2022	Denied		Investigator determined the choke was internal to the home	4/19/2022	13
RP-2022-10227	3/9/2022	136 Reedbird Ave 21225	\$5,000.00	5/2/2022	Denied		Provided service under SOS program already	5/9/2022	7
RP-2022-10223	1/12/2022	1700 N Broadway 21213	\$5,000.00	3/28/2022	Denied		Investigator determined the choke at the Sewer House connection. Removed Rags and Debris	6/1/2022	65
RP-2022-10233	2/9/2022	1601 Saint Paul St 21202	\$7,714.54	5/3/2022	Denied		D 8" Sanitary Mainline Choke	6/15/2022	43
RP-2022-10236	7/21/2021	5705 Anthony Ave 21206	\$4,000.00	5/8/2022	Denied		There was no 311-service request reported by the resident during 7-21-2021.	6/22/2022	45
RP-2022-10235	4/21/2022	3946 Belvieu Ave 21215	\$2,600.00	5/9/2022	Denied		Investigator determined side house connection choke. Mainline clear	6/16/2022	38
RP-2022-10237	5/2/2022	3011 Orlando Ave 21234	\$6,323.69	5/23/2022	Denied		Investigator determined house connection choke. Main line clear	7/15/2022	53
RP-2022-10239	5/13/2022	2110 Charles St_21218	\$2,610.00	6/23/2022	Denied		Investigator determined mainline choke. Removed rags and debris	7/15/2022	22
FY 2023									
RP-2022-10253	7/16/2022	4004 The Alameda 21218	\$4,800.00	7/20/2022	Denied		Investigator determined mainline choke. Removed rags and debris from the mainline	9/7/2022	49
RP-2023-10244	7/17/2022	2419 N Pulaski St 21217	\$2,500.00	7/18/2022	Denied		Investigator determined mainline clear – private conn	8/30/2022	43
RP-2022-10423	7/11/2022	6121 Eastern Pkwy 21206	\$5,000.00	8/3/2022	Denied		Investigator determined mainline choke. Removed rags, grease, and debris from the mainline	8/17/2022	14
RP-2022-10429	5/30/2022	4223 Potter St 21229	\$938.00	7/19/2022	Denied		No Worker Order documented in CityWorks	9/8/2022	51
RP-2022-10250	8/4/2022	3037 Fleetwood Ave_21214	\$5,000.00	8/25/2022	Denied		Investigator determination resulted in “clean up basement”	9/14/2022	20
RP-2022-10423	1/1/2021	1423 Poplar Grove St 21216	\$0.00	8/3/2022	Denied		Investigator determined mainline clear. No access to cleanout	10/12/2022	70
RP-2022-10251	9/12/2022	2500 Garrison Blvd 21216	\$5,000.00	9/13/2022	Denied		Stormwater matter. Not WIC	9/23/2022	10
RP-2022-10252	10/6/2022	3605 Belle Avenue	\$770.00	10/11/2022	Denied		Investigator determined mainline choke. Removed rags, grease, and debris from the mainline	10/27/2022	16
RP-2023-10257	11/27/2022	3815 Roland Avenue	\$5,000.00	12/5/2022	Denied		Investigator determined mainline choke. Removed rags, grease, and debris from the mainline	1/19/2023	45
RP-2022-10255	11/10/2022	2202 Linden Avenue	\$5,841.83	11/10/2022	Denied		Investigator determined mainline choke. Removed rags, grease, and debris from the mainline	1/15/2023	66

Request No.	Date of Occurrence	Location of Incident	Amount Requested	Application Received Date	Request Determination	Amount Approved	Determination Rationale	Determination Date	Determination Time (in Days)
RP-2023-10256	10/28/2022	2231 Guilford Ave 21218	\$2,500.00	2/8/2023	Denied		Investigator determined mainline choke. Removed rags, grease, and debris from the mainline	3/28/2023	48
RP-2022-10258	8/4/2022	3037 Fleetwood Ave 21214	\$5,000.00	8/5/2022	Denied		Investigator determined mainline choke. Removed rags, grease, and debris from the mainline	9/15/2022	41
RP-2023-10259	11/21/2022	1321 W 40 th St 21211	\$5,000.00	2/16/2023	Denied		Investigator determined mainline choke. Removed rags, grease, and debris from the mainline	3/28/2023	40
RP-2023-10261	10/14/2022	5719 The Alameda 21239	\$13,339.47	2/13/2023	Denied		Investigator determined mainline choke. Removed rags, grease, and debris from the mainline	3/28/2023	43
RP-2022-10263	12/22/2022	1204 Lakeside Ave 21218	\$5,000.00	1/23/2023	Denied		No 311 WIC in basement reported for the date	3/29/2023	43
RP-2023-10264	2/22/2023	1126 W Cross St 21230	\$360.00	2/27/2023	Denied		Investigator determined mainline choke. Removed rags, grease, and debris from the mainline	4/11/2023	
RP-2023-10266	2/13/2023	5837 Benton Heights Ave 21206	\$700.00	3/6/2023	Denied		Investigator determined mainline was flushed. Removed rags, grease, and debris from the mainline	4/13/2023	38
RP-2023-10267	2/13/2023	4302 Keswick Rd 21210	\$4,766.54	3/7/2023	Denied		Investigator determination confirmed owner's issue was resolved upon arrival	4/28/2023	52
RP-2023-10261	10/14/2022	1807 Bank St 21231	\$1,203.00	12/12/2022	Denied		Investigator determined mainline choke. Removed rags, grease, and debris from the mainline	1/30/2023	49
RP-2023-10263	2/9/2020	4703 Bayonne Ave 21206	\$5,000.00	1/19/2023	Denied		No investigator determination made/no CSR or W.O. associated w/ address; outdated event.	4/10/2023	81
RP-2023-10262	10/14/2022	200 Bolton Pl 21217	\$9,500.00	1/12/2023	Denied		Investigator determined mainline choke. Removed rags, grease, and debris from the mainline	1/30/2023	18
RP-2023-10265	9/9/2021	3116 E Northern Pkwy 21214	\$5,000.00	2/17/2023	Denied		Investigator determined mainline choke. Removed debris from the mainline in rear/HC choke on private property 8/22	4/13/2023	55
RP-2023-10268	2/2/2023	1911 Jefferson St 21205	\$5,000.00	2/24/2023	Denied		Investigator determined mainline choke. Removed debris from the mainline; line flowing clearly	4/28/2023	63
RP-2023-10269	2/2/2023	1913 Jefferson St 21205	\$5,000.00	2/24/2023	Denied		Investigator determined mainline choke. Removed debris from the mainline; line flowing clearly	4/28/2023	63
RP-2023-10270	2/2/2023	1907 Jefferson St 21205	\$5,000.00	2/24/2023	Denied		Investigator determined mainline choke. Removed debris from the mainline; line flowing clearly.	5/3/2023	68
RP-2023-10269	2/2/2023	1901 Jefferson St 21205	\$5,000.00	2/24/2023	Denied		Investigator determined mainline choke. Removed debris from the mainline; line flowing clearly	5/3/2023	68

3.0 Phase I Projects

The Phase I projects are listed in Appendix B of the MCD, which includes capital projects in the collection system, as well as the Back River Wastewater Treatment Plant (WWTP) Headworks Project. In addition to the Phase I projects, the City performs sanitary sewer infrastructure work through various on-call contracts as part of its routine maintenance of the collection system or to expedite certain work. The on-call work improves the collection system by performing similar types of work (repairing existing assets or installing new infrastructure) to what is required in the Phase I projects but is done on an as-needed basis.

Percentage complete graphs for the Phase I work accomplished in each sewershed through the end of this calendar quarter are shown as part of Figure 3-1. The percentage complete graphs are shown for:

- Linear Feet (LF) of sewer pipes rehabilitated by Cured-in-Place Pipe (CIPP)
- LF of sewer pipes replaced
- Number of manhole rehabilitations
- Number of sewer house connection rehabilitations

Figure 3-1 also contains a table for Phase I projects' structural rehabilitation progress and a map with the sewershed boundaries. The actual amount completed exceeds the contracted amount because of efforts by the City to perform sewer replacement and rehabilitation beyond the minimum requirements stipulated in the MCD.

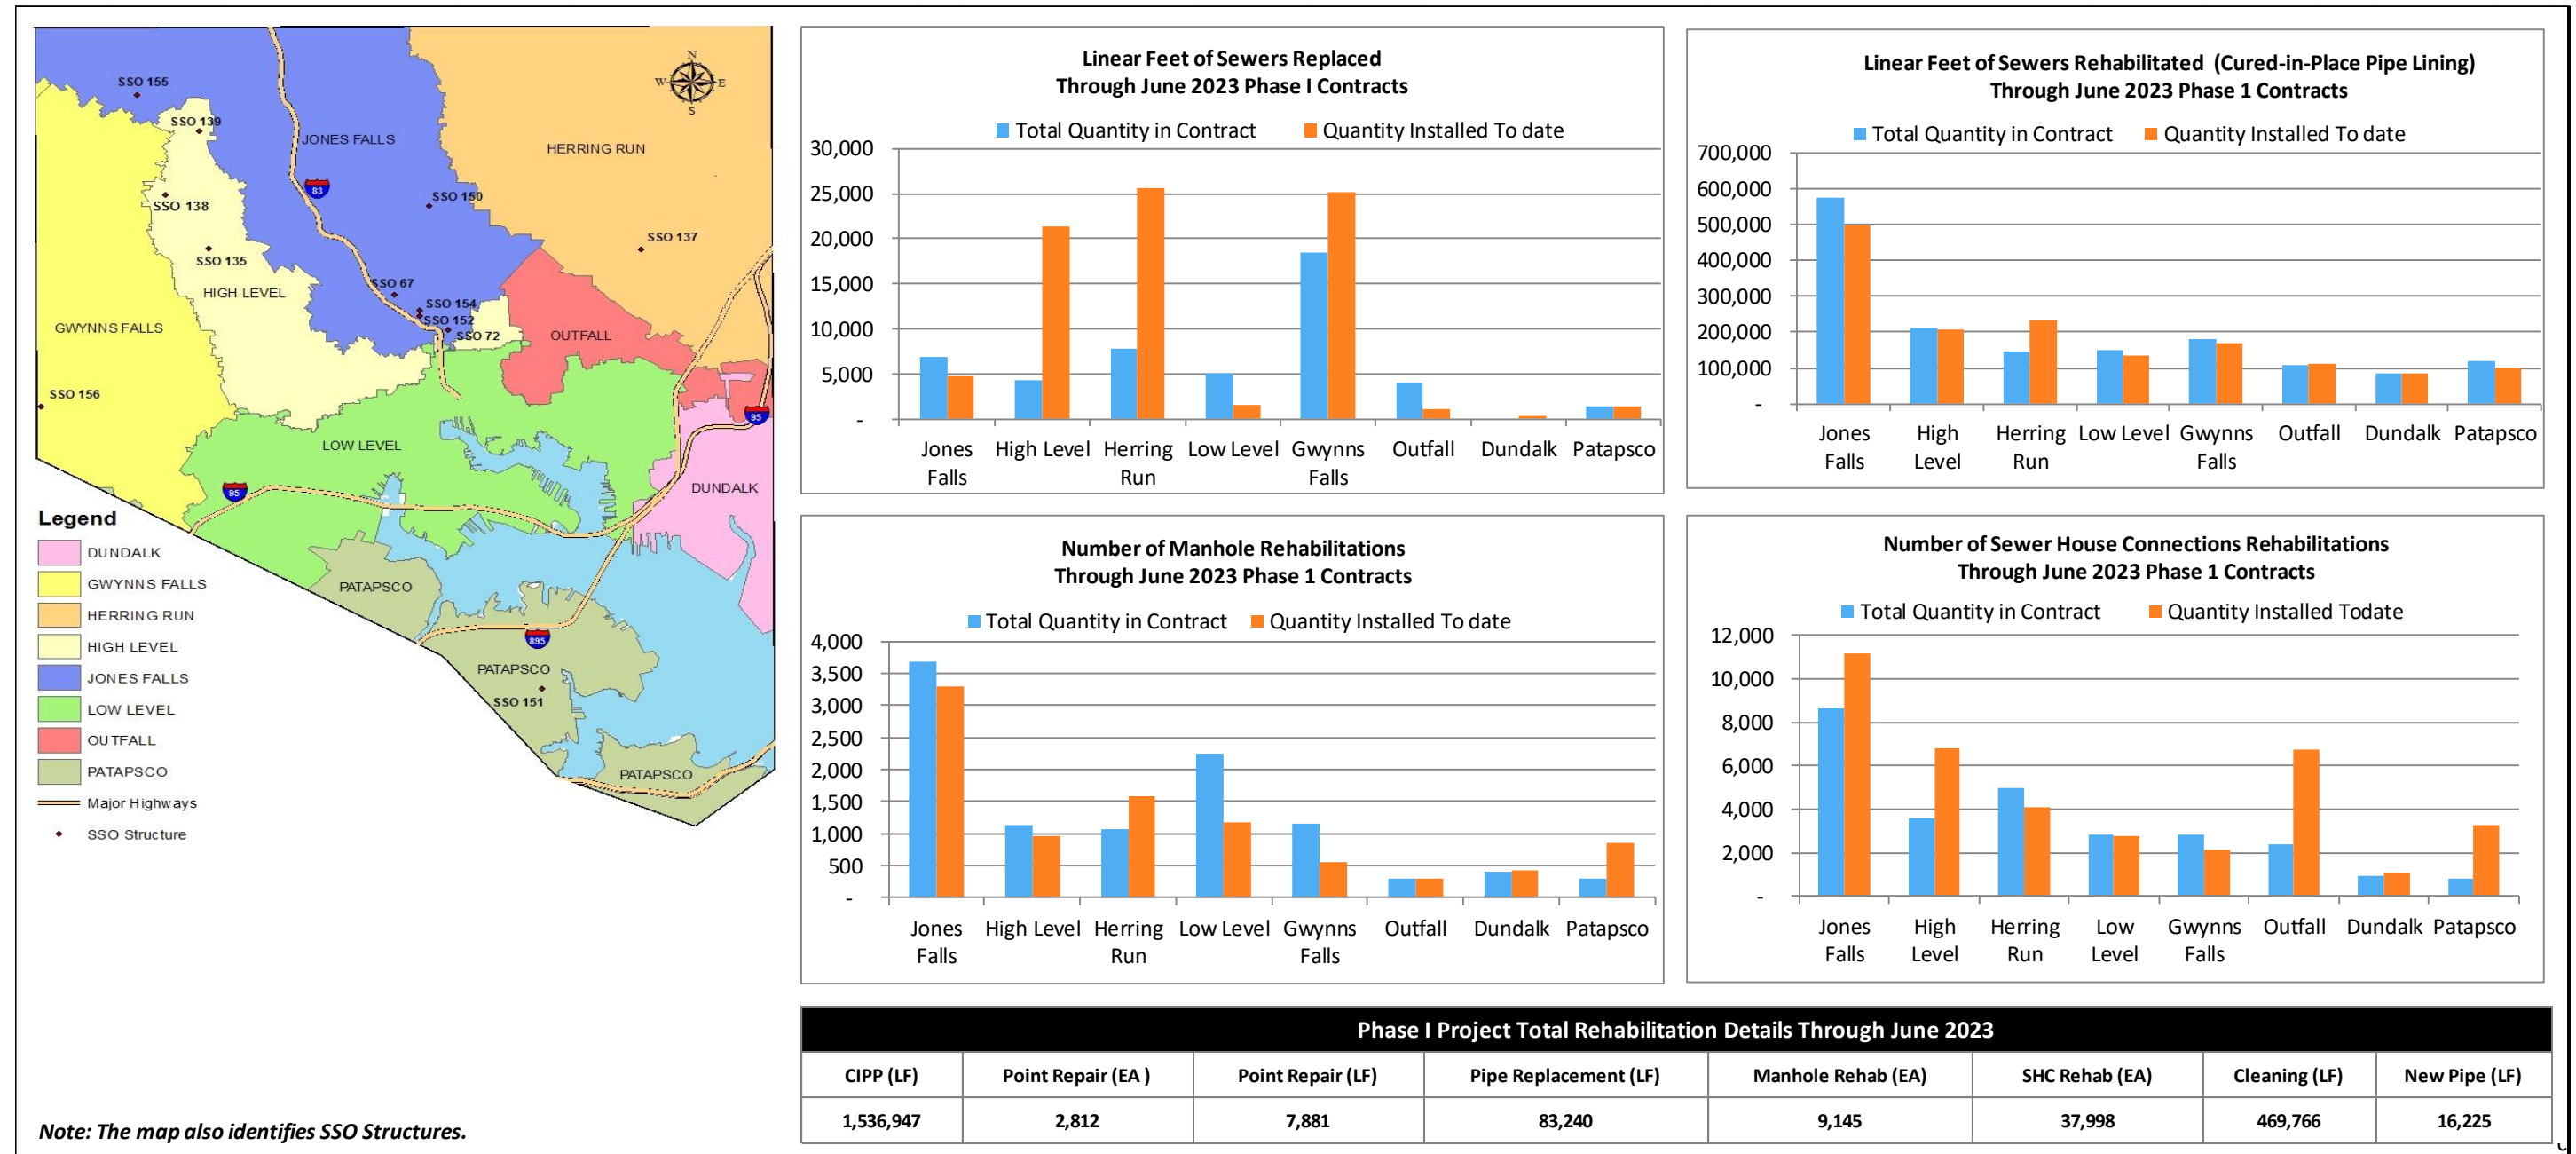


Figure 3-1: Phase I Project Work Completed During Calendar Quarter

3.1 Milestone Progress Updates for Collection System Projects

No projects were substantially completed during the reporting period.

SC 941

Currently, the removal and replacement of 48" force main on Rutland Avenue and Ellsworth Avenue is approximately 95% complete. The contractor has begun setting up the bypass system, which is needed to install the new replacement valves and also for the valve vault one construction work.

Work is expected to be completed by October 2023.



Figure 3-2: SC 941 – 48" Pipelaying Operation



Figure 3-3: SC 941 – Prep for bypass tie-in

4.0 Phase II Projects

After completion of the Phase I projects (See Section 3), the City performs post-construction flow and rainfall monitoring to assess the effectiveness of the Phase I projects. Based on the monitoring of Phase I projects, which provides a basis for the expected I/I reduction performance associated with sewer rehabilitation and repair, the City has developed the Phase II projects and/or corrective actions. The Phase II Plan was to be submitted to the EPA and MDE by December 31, 2022. The deadline was extended to May 4, 2023 to accommodate the extension of the public comment period. On April 27, 2023, the City was made aware of an additional 272 comments by BWB using a third-party system. Since the system is a known purveyor of spam email, the City IT security software blocked BWB's emails. Once obtained, the City reviewed and updated the Phase II Plan as necessary. The City submitted the final Phase II Plan Report on May 31, 2023.

Specifically, the Phase II Plan must address remaining deficiencies that are necessary to achieve the required "five-year" Level of Protection (LOP), with additional measures to achieve a "10-year" LOP in identified sensitive areas. In addition to the high I/I basins that were addressed during Phase I, the City has identified additional high I/I basins that are candidates for comprehensive sewer and manhole upgrades and primary lining of sewers and laterals. These rehabilitation projects have been included in the Phase II Plan. The final Phase II Plan does not account for the estimated baseline 2030 flows from Baltimore County ("the County") because the County has not yet completed their analysis and projections for those flows.

The City evaluated data from PCFM at select basins to enable accurate planning for Phase II. This evaluation followed a PCFM strategic plan prepared to check assumptions regarding the effectiveness of sewer rehabilitation projects for reducing I/I following the completion of Phase I construction. A third-party flow monitoring contractor began installing and collecting data from flow meters in January 2021. After 12 months of data were collected, the data was analyzed to assess the amount of I/I occurring in the system and comparing that I/I to pre-rehabilitation conditions. In summary, rehabilitation showed reductions in that I/I comparable to the assumptions made during planning of Phase I. After approval by the EPA and MDE, meters were disengaged and removed after collecting 12 months of data as sufficient storms occurred to perform the analysis. Upon completion of the remaining Phase I project, SC 941, meters will be installed and additional PCFM data will be analyzed.

Additional meters were installed to support model calibration. The 12 months of metering provided sufficient data to satisfactorily calibrate the hydraulic model. The model was calibrated to this new data and the City developed a baseline conditions model for Phase II Plan analysis based on the updated calibration.

The City continues to evaluate data obtained from PCFM analysis and is conducting the required hydraulic analysis for preliminary engineering planning for specific required projects.

The City's efforts in relation to the Phase II I/I projects include the procurement process of on-call Closed-Circuit Television (CCTV) contractors, on-call design consultants (some design projects can also be done in-house), and on-call construction contractors. The following is a listing of current and upcoming activity, as well as anticipated timing:

- SC 1019R for CCTV inspection has been awarded, and received Notice To Proceed on May 8, 2023. Currently preparing to begin work on the first two sets of assets.
- SC 1021 for CCTV inspection has completed all assigned CCTV Inspections. Final videos will need to be reviewed.
- The City is currently in the final steps of awarding contracts for on-call design consultants. These design consultants will prepare design packages, and design work is expected to begin in Fall 2023, shortly after the start of the CCTV contracts.
- The City is currently preparing contract documents to select on-call construction contractors. Construction work is expected to begin in Summer 2024. It is necessary to have a gap between the start of inspection work and start of construction work to process and analyze enough inspection data and issue design work orders.



Figure 4-1: SC 1021 – CCTV inspection



Figure 4-2: SC 1021 – Setting up for CCTV inspection

5.0 Flow Monitoring and Information Management

When reporting the City’s progress towards implementing and completing all Phase I projects in Appendix B, the City, per MCD Paragraph 9.h(i)(a), is required to transmit a summary of rainfall and flow monitoring data for the three-month period ending 30 days before the end of the calendar quarter (organized by sewershed and sewershed service area where appropriate). At a minimum, this summary should provide daily rainfall amounts, peak hourly rainfall intensity, daily flow volumes, and peak flow rates for each location at which flow monitoring is performed.

Following the pilot phase that was completed in December 2020, PCFM for Phase I projects began in January 2021 and continues through the current period. Table 5-1 summarizes rainfall and flow monitoring data at the various flow meter locations for the three-month period ending 30 days before the end of the calendar quarter. An electronic data table is provided as an attachment via compact disk to this Quarterly Report and contains all monitoring data.

Table 5-1. Rainfall and Flow Monitoring at Meter Locations

Meter No.	Meter Name	Average Daily Flow (MGD)	Peak Wet Weather Flow (MGD)	Closest Rain Gauge Location	Average Daily Rainfall Volume (in.)*	Total Rainfall Volume (in.)*	Peak Hourly Rainfall Intensity (in./hr.)*
1	BGF1	1.479	8.727	GF09RG	0.079	7.280	1.270
2	BGF2_D11	17.927	41.268	GF07RG	0.072	6.630	0.430
3	BGF4	2.591	6.039	GF07RG	0.072	6.630	0.430
4	BGF5_D3	0.927	2.967	GF07RG	0.072	6.630	0.430
5	BPA03	0.264	1.115	PA01RG	0.066	6.070	0.400
6	GF13	8.054	24.054	GF07RG	0.072	6.630	0.430
7	GF22	0.304	1.801	GF07RG	0.072	6.630	0.430
8	GFS26	3.95	11.648	GF07RG	0.072	6.630	0.430
9	HL18	4.663	18.387	JF12RG	0.066	6.080	0.540
10	HL19	7.296	18.63	JF12RG	0.066	6.080	0.540
11	HL32	0.403	1.625	GF07RG	0.072	6.630	0.430
12	HL33	0.172	1.086	GF07RG	0.072	6.630	0.430
13	HL37	0.45	2.819	GF07RG	0.072	6.630	0.430
14	HL40	0.304	1.456	GF07RG	0.072	6.630	0.430
15	HL41	0.129	0.629	GF07RG	0.072	6.630	0.430
16	JF07	1.671	2.311	JF12RG	0.066	6.080	0.540
17	JF08	0.2	0.787	JF12RG	0.066	6.080	0.540

Meter No.	Meter Name	Average Daily Flow (MGD)	Peak Wet Weather Flow (MGD)	Closest Rain Gauge Location	Average Daily Rainfall Volume (in.)*	Total Rainfall Volume (in.)*	Peak Hourly Rainfall Intensity (in./hr.)*
18	JF09	0.761	3.775	JF12RG	0.066	6.080	0.540
19	JF10	0.609	2.965	JF12RG	0.066	6.080	0.540
20	JF16	1.457	5.379	JF12RG	0.066	6.080	0.540
21	JF17	1.097	4.115	JF12RG	0.066	6.080	0.540
22	JF42	0.093	0.275	JF12RG	0.066	6.080	0.540
23	JFOUT	14.14	28.793	JF12RG	0.066	6.080	0.540
24	JFWR15	0.484	1.164	GF09RG	0.079	7.280	1.270
25	JFWR24	0.379	1.473	GF09RG	0.079	7.280	1.270
26	JFWR31	0.358	0.503	GF09RG	0.079	7.280	1.270
27	LL18	1.413	3.476	JF12RG	0.066	6.080	0.540
28	LL19	1.085	1.845	JF12RG	0.066	6.080	0.540
29	LL33	0.282	0.635	PA03RG	0.074	6.800	0.970
30	OUT02	72.729	177.081	HR15RG	0.069	6.310	0.600
31	TSGF02	24.642	53.625	GF07RG	0.072	6.630	0.430
32	TSHL03	3.935	13.013	JF12RG	0.066	6.080	0.540
33	TSJF01	6.198	10.885	JF13RG	0.062	5.730	0.370
34	TSOUT01A	79.454	165.052	HR15RG	0.069	6.310	0.600

* Note: The Average, Total, and Peak Hourly Rainfalls are calculated from the period March 2023 through May 2023 without excluding the periods when flow data are not available.

The City monitors discharge flow at each SSO structure and reports it per the requirements of Paragraph 17. Table 5-2 summarizes rainfall and flow monitoring data at SSO structures for the three-month period ending 30 days before the end of the calendar quarter. An electronic data table provided as an attachment via compact disk to this Quarterly Report contains all the monitoring information.

Table 5-2. Rainfall and Flow Monitoring at SSO Structures

SSO Structure No.*	Number of Activations	Total Volume (MG)	Peak Flow (MGD)	Rain Gauge Location	Total Rainfall Volume (in.)	Peak Hourly Rainfall Intensity (in./hr.)
67	0	0.000	0.000	JF12	6.08	0.54
72	1	0.110	1.534	JF12	6.08	0.54
135	0	0.000	0.000	GF07	6.63	0.39
138	0	0.000	0.000	GF09	7.28	1.27
139	0	0.000	0.000	GF09	7.28	1.27

SSO Structure No.*	Number of Activations	Total Volume (MG)	Peak Flow (MGD)	Rain Gauge Location	Total Rainfall Volume (in.)	Peak Hourly Rainfall Intensity (in./hr.)
152*	0	0.000	0.000	JF12	6.08	0.54
154	0	0.000	0.000	JF12	6.08	0.54
155	0	0.000	0.000	GF09	7.28	1.27
156	0	0.000	0.000	GF07	6.63	0.39
157	0	0.000	0.000	JF12	6.08	0.54

** Meter was pulled from 3/2/2023 13:15 - 4/26/2023 10:20 for rehab; however, there were no SSOs during that time period.*

Updates to the City’s hydraulic model of the collection system have been implemented based on improvements to the collection and transmission system as recorded in the City’s Geographic Information System (GIS) Information Management System. The City’s collection system model has been updated as needed.

6.0 Pumping Station Inspection and Repair

Paragraph 11, Pumping Station Inspection, Rehabilitation and Repair, requires inspection of each pumping station within the collection system and continuous monitoring through a Supervisory Control and Data Acquisition (SCADA) system. Additionally, a preventive maintenance program is required to facilitate proper operation and maintenance of the stations. Potential disruptions of pumping station operations require a failure analysis with the results reported as part of the Calendar Quarterly Report.

The City remains in compliance with the inspection, monitoring, preventive maintenance, and failure analysis requirements of the MCD. The Wastewater Facilities Division maintains a Computerized Maintenance Management System (CMMS) for tracking work order information. The system used is the Back River Wastewater Elke Maintenance System. The City will submit copies of files and failure report analyses to the EPA and MDE upon failure occurrence.

Table 6-1 summarizes the status of the Progress Report requirements as stated in MCD subparagraph 11.d (i) through (v). Table 6-2 identifies all deficiencies that have not been resolved in six months are required in 11.a(ii).

Table 6-1. Pumping Station Progress Report for Calendar Quarter

Pumping Station	Number of Inspections	Date of Completion of Inspections	Number of Repair Work Orders	Number of PS-Related SSO Events [Satisfies 11.d.(iii)]	Number of Failure Analyses Conducted	Failure Analyses Result Summary [Satisfies 11.d.(ii) and Linked to 11.c.(i)]
Eastern Avenue	184	3/31/2023	0	0		N/A
Brooklyn	184	3/31/2023	0	0		N/A
Dundalk	184	3/31/2023	2	0		N/A
Jones Falls	184	3/31/2023	0	0		N/A
Locust Point	184	3/31/2023	0	0		N/A
Quad Avenue	184	3/31/2023	2	0		N/A
McComas Street	184	3/31/2023	0	0		N/A
Westport	184	3/31/2023	0	0		N/A
Stony Run ¹	13	3/31/2023	0	0		N/A

¹ Pumping station is currently under limited operation and inspected weekly.

Table 6-2. Identified Deficiencies Not Resolved Within Six Months

Deficiency Name	Description	Date First Identified	Reason it Cannot be Resolved within Six Months	Action Plan for Resolving	Estimated Date of Resolution
Jones Falls #1 Bar Screen	Failure of bar screen	5/2022	Awaiting procurement to approve funds for the vendor to begin repairs – parts/labor	Once funds are appropriated, vendors will begin repairs	6 months
Dundalk #2 Main WW Pump	Pump housing failure	2/2023	The part is not a shelf item from the manufacturer	Maintenance is investigating possible complete rotating assembly & housing	1 year
Quad Ave. #2 Main Pump	Broken shaft	3/2023	Awaiting procurement to approve funds for the vendor to begin repairs – parts/labor	Once procurement process is complete, repairs will begin	6 months pending supplier (pump is not manufactured in the U.S.)

7.0 Illegal Connections to the Collection System

Paragraph 10 of the MCD mandates the City to identify and address illegal connections to the collection system as required by the City’s approved Illegal Sewer Connection Detection and Enforcement Plan. Article 25, Section 2-3 of the Baltimore City Code prohibits the discharge of “any stormwater, ground water, roof run-off, subsurface drainage, uncontaminated cooling water, or unpolluted water in any sanitary sewer.” Connections that discharge these flows are illegal unless authorized by the DPW. During the sewershed studies performed under the 2002 CD, the City identified and abated illegal connections to the collection system. The City continues to enforce these requirements. If the City verifies an illegal connection, the City will mandate the abatement of the connection or issue a permit as appropriate under the circumstances. The City may discover illegal connections while performing inspections, maintenance, or construction activity.

Table 7-1 summarizes the Illegal Connection Status for this calendar quarter.

Table 7-1. Illegal Connection Status for Calendar Quarter

There were no illegal connections identified or abated during the calendar quarter ending June 30, 2023.

8.0 Sanitary Discharges of Unknown Origin (SDUO)

Paragraph 15 of the MCD requires the City to investigate and eliminate SDUOs. SDUOs may be attributed to public or private sources of non-stormwater discharge to the City's storm sewer system. Any discharge source that is verified as a wastewater collection system asset must be reported as an SSO pursuant to sub-paragraph 17.e of the MCD and is subject to stipulated penalties.

The SDUO Plan was submitted to the EPA and MDE on February 2, 2018. A table summarizing the required information for SDUOs that occurred or were identified in the calendar quarter, including previously reported SDUOs confirmed during the calendar quarter as an SSO can be found in Attachment 5, Sanitary Discharges of Unknown Origin, pursuant to sub-paragraph 15.f, sub-paragraph 21.g., and sub-paragraph 21.h.

9.0 MCD Compliance Issues

MCD sub-paragraphs 21.c and 21.d require the City to describe any problems anticipated with respect to meeting the requirements of Section VI of the MCD (Remedial Measures), and to bring any additional matters that the City believes should be brought to the attention of the EPA and MDE. This section highlights the City's concerns.

The City remains concerned that the County's CD implementation schedule requires the City to make planning and design assumptions based on the anticipated amount of future flow from the County. The amount of flow entering the City's collection system is influenced by the County's CD schedule and the effectiveness of County projects in reducing extraneous flow and SSOs from the County's collection system. Because the County's flow currently accounts for approximately 50% of the flow entering the City's wastewater treatment plants, the success (or failure) of the County's CD projects has the potential to affect the City's MCD Phase II Plan. The City is coordinating closely with the County to understand and account for implementation schedules of their relevant projects and their flow projections that influence the successful delivery of the MCD. The City and County hold regular meetings to discuss and resolve issues of mutual concern, including those related to the MCD.

The City continues to be challenged by a lack of contractor capacity to meet the demand for wastewater utility contracts. Due to the significant amount of sewer rehabilitation work in the mid-Atlantic region, the local contracting community has limited resources available to meet these escalating demands. In particular, the City has experienced the following adverse impacts associated with contracting:

- Unbalanced project bids
- Fewer prospective bidders
- Insufficient numbers of crews assigned to projects
- Untrained or inexperienced crews assigned to projects
- Contractor claims and protests

These issues potentially create significant project completion delays and much higher costs associated with both initial project bidding and ongoing project re-work.

To mitigate the lack of contractors, the City has invested substantial energy and effort into the SBDP. This program seeks to grow the number of local qualified contractors and teaming partners as well as increase the skilled workforce. At the completion of the program, participants are equipped to pre-qualify with the City and pursue certain contracts related to the MCD through competitive bid.

During the quarter ending December 31, 2022, the City has encountered challenges that continue to affect one Phase I project SC 941, whose compliance date was January 1, 2021. Despite these

challenges, the City continues to utilize best practices to mitigate the delays and expeditiously complete the Phase I project.

Among these challenges are potential delays to Phase I projects caused by the Coronavirus Disease of 2019 (COVID-19) virus affecting contractor crews and geotechnical conditions resulting in rescue operations for tunneling machines.

Specific updates and concerns are noted below:

SC 941

The City's letter to the EPA and MDE, dated May 8, 2020, described a four-month delay in review of bid set design plans by the Maryland Department of Transportation (MDOT) that required design changes, as well as supply chain disruptions on account of the COVID-19 pandemic. Furthermore, a subcontractor's employee tested positive for COVID-19, requiring a delay in work while affected staff quarantined.

During construction of the pressure sewer and associated junction structures, site conditions were found to be different than those assumed in design. Special pipe fittings and pipe lengths had to be ordered to meet the existing unknown layout conditions. The City transmitted a letter to the EPA and MDE on August 30, 2021, and August 23, 2022, notifying them of delays on project SC 941 and requesting force majeure relief of stipulated penalties and milestone extension.

The current approved extension date is April 30, 2021. Manhole rehab is 95% complete. Lining is 98% complete. 60 feet of 48-inch force main pipe remains to be installed on Ellsworth St. One hundred feet remains to be installed on Rutland Ave. MCD substantial completion is expected by October 2023. Site restoration will be ongoing into next year. Trees will be planted in the spring.

SSO Structure Elimination Challenges

SSO structures cannot be eliminated until the associated rehabilitation projects have been completed and proven to be effective in reducing flows to acceptable levels through PCFM. The closure of several SSO structures has been directly impacted by delays in many of the rehabilitation projects described above.

Additionally, sedimentation issues have been identified along the sewer interceptor from SSO Structure #67 to the Back River WWTP. Many years of low-velocity flow in the interceptor system stemming from the backwater effect that the Headworks Project resolved allowed successive layers of sediment and debris to build up and harden over time. This accumulated sediment constrained the free-flow capacity of the interceptor, thereby increasing the potential for SSO discharges at SSO Structures #67, #72, #152, and #154. Efforts are underway to clean the interceptor. The SSO structures cannot be eliminated until this interceptor cleaning effort has been completed in association with project SC 966.

Table 9-1 summarizes the remaining SSO structures and the latest estimated date for substantial completion of elimination projects.

Table 9-1. Impacts to Elimination of SSO Structures

SSO Structure No.	Manhole ID	Location ¹	Sewershed	MCD Date of Substantial Completion of Construction	MCD Date of Elimination (after PCFM)	Latest Estimate for Date of Substantial Completion of Construction	Latest Estimate for Date of Elimination (after PCFM)	Potential Issues Or Notes
67	S31MM_013MH	1911 Falls Road, 37 approx. 1,100' northwest of US 1 bridge intersection	Jones Falls	Jan 1, 2021	Jul 1, 2022	Headworks substantial complete Jan 1, 2021. PCFM and auxiliary work ongoing. Substantial Completion to be determined.	To be determined	Dependent on SC 941 which is approximately 90% complete as well as interceptor cleaning of sediments that were deposited during the time prior to headworks completion that caused the backwater condition that constrained flow and reduced velocity. Project (SC 966 Contract Extension) is underway to clean interceptors upstream of Back River WWTP. Completion date is pending TIA of interceptor cleaning.
72	S37GG_007MH	Rear of 428 East Preston St.	Jones Falls	Jan 1, 2021	Jul 1, 2022	Headworks substantial complete Jan 1, 2021. PCFM and auxiliary work ongoing. Substantial Completion to be determined.	To be determined	Dependent on SC 941 which is approximately 90% complete as well as interceptor cleaning of sediments that were deposited during the time prior to headworks completion that caused the backwater condition that constrained flow and reduced velocity. Project (SC 966 Contract Extension) is underway to clean interceptors upstream of Back River WWTP. Completion date is pending TIA of interceptor cleaning.
135	S11UU_008MH	3104 Liberty Heights Ave.	High Level	Dec 1, 2021 (Previously Jan 1, 2021)	Jun 30, 2022 (Previously Jul 1, 2022)	Jul 26, 2022	Jan 26, 2024	Dependent on completion of SC 940 which is complete. SSO Structure now in PCFM.
138	S07EE 1023MH	W. Cold Spring La. & Ayrdale Ave.	High Level	Dec 1, 2021 (Previously Jan 1, 2021)	Jun 30, 2022 (Previously Jul 1, 2022)	Jul 26, 2022	Jan 26, 2024	Dependent on completion of SC 940 which is complete. SSO Structure now in PCFM.
139	S11QQ 1002MH	W. Garrison Ave. & Queensberry Ave.	High Level	Dec 1, 2021 (Previously Jan 1, 2021)	Jun 30, 2022 (Previously Jul 1, 2022)	Jul 26, 2022	Jan 26, 2024	Dependent on completion of SC 940 which is complete. SSO Structure now in PCFM.
152	S33II_004MH	N. Charles St. & W. Lanvale St.	Jones Falls	Jan 1, 2021	Jul 1, 2022 ²	Headworks substantial complete Jan 1, 2021. PCFM and auxiliary work ongoing. Substantial Completion to be determined.	To be determined	Dependent on SC 941 which is approximately 90% complete as well as interceptor cleaning of sediments that were deposited during the time prior to headworks completion that caused the backwater condition that constrained flow and reduced velocity. Project (SC 966 Contract Extension) is underway to clean interceptors upstream of Back River WWTP. Completion date is pending TIA of interceptor cleaning.
154	S33KK_033MH	N. Charles St. & W. Lafayette Ave.	Jones Falls	Jan 1, 2021	Jul 1, 2022 ²	Headworks substantial complete Jan 1, 2021. PCFM and auxiliary work ongoing. Substantial Completion to be determined.	To be determined	Dependent on SC 941 which is approximately 90% complete as well as interceptor cleaning of sediments that were deposited during the time prior to headworks completion that caused the backwater condition that constrained flow and reduced velocity. Project (SC 966 Contract Extension) is underway to clean interceptors upstream of Back River WWTP. Completion date is pending TIA of interceptor cleaning.
155 ³	S03WW1008MH	3404 Glen Avenue	Jones Falls	Jan. 1, 2023	Jul 1, 2024	Jun 1, 2024	Dec 1, 2025	Dependent on SC946R. Bids received in June 2023. Letter transmitted to Regulators requesting extension to June 1, 2024. Update to extension request will be sent as soon as timeline is updated.

SSO Structure No.	Manhole ID	Location ¹	Sewershed	MCD Date of Substantial Completion of Construction	MCD Date of Elimination (after PCFM)	Latest Estimate for Date of Substantial Completion of Construction		Latest Estimate for Date of Elimination (after PCFM)	Potential Issues Or Notes
156 ³	S08G__001MH	Charing Cross Road & Greenwich Avenue	Gwynns Falls	Jan. 1, 2023	Jul 1, 2024	Jan 1, 2024	Jul 1, 2025	Portions of the area and collection system upstream and downstream of SSO Structure #156 are located within Baltimore County jurisdiction. The City and County have coordinated on the appropriate measures to eliminate SSO Structure #156. These measures differ from those proposed to EPA and MDE in the City's letter of January 5, 2018, and subsequently approved. The City submitted a letter dated March 30, 2022, thoroughly describing the alternate plan and associated justification. EPA and MDE approved the plan on May 5, 2022. Implementation is complete and PCFM is underway.	
157 ³	S35YY_036MH	East 32 nd Street & St. Paul/Hargrove Alley	Jones Falls	Jan. 1, 2023	Jul 1, 2024	Jan 1, 2023	Jul 1, 2024	Selected assets in Basins JF18 & JF20 have been rehabilitated through contract SC-965 to enable closure of the SSO Structure. PCFM is in progress.	

¹SSO Structure locations are shown on Figure 3-1.

²Revised per MDE Letter sent by Electronic Mail on Aug 24, 2020

³Four SSO structures (#155, #156, #157, and #158, identified on Sep 13, 2016, Jun 6, 2017, Sep 19, 2017, and Nov 9, 2017 respectively) were not included in Appendix A of the MCD. Flow meters are installed at SSO Structures #155, #156, and #157, and these locations are monitored for overflow activity. The City proposed corrective plans for SSO Structures #155, #156, #157, which were approved by EPA and MDE on Jul 25, 2018. SSO Structure 158 has been eliminated.

10.0 Annual Costs for Appendix B Projects

This section was updated after the fourth quarter following the October 6, 2017 DOE of the MCD and will be updated annually thereafter. Reported costs incurred reflect capital expenditures, i.e., funds disbursed by the City of Baltimore Finance Department, for Quarterly Report 22 covering the calendar quarter ending June 30, 2023. The next annual update will be provided in Quarterly Report 25 for the period ending December 31, 2023.

Table 10-1. Costs Incurred to Date¹

ID #	Project	Baltimore City Contract Number (for reference)	Construction Completion Date	Costs incurred as of 12/31/2022 (millions)
WWTP Improvement Project				
1	Back River WWTP Headworks Modifications and Flow Equalization Project	SC 918	12/19/2021	\$479.3
Heavy Cleaning Projects				
2	Lower Jones Falls Cleaning – Large diameter pipe cleaning of the Lower Jones Falls Sewer	SC 876	Completed October 2011	\$1.7
3	Outfall Interceptor Cleaning – Large diameter pipe cleaning of the Outfall Interceptor – Phase I	SC 894	Completed April 2014	\$11.0
4	Low Level Interceptor Cleaning – Large diameter pipe cleaning of the Low-Level Interceptor	SC 922R	Completed November 2016	\$1.6
5	High Level Interceptor Cleaning – Large diameter pipe cleaning of the High-Level Interceptor	SC 933	Completed December 2016	\$4.5
6	Outfall Interceptor Cleaning – City and County Portions – Large diameter pipe cleaning of the Outfall Interceptor – Phase II	SC 934	Completed June 2018	\$8.3
Structural Improvement Projects				
7	Gwynns Run D-Branch Sewer Improvements – Improvements to the Gwynns Run D-branch interceptor in the high level sewershed by means of replacement of pipe	SC 879	Completed January 2016	\$4.8
8	Maryland Avenue Sewer Rehab in Jones Falls Sewershed – Rehabilitation and replacement of	SC 895	Completed January 2016	\$3.7

¹ Baltimore City DPW is in the process of mitigating financial management systems and the information contained in this table represents the best information available at the time of production of this report. The DPW will communicate any significant discrepancies identified during the migration in future quarterly reports as appropriate.

ID #	Project	Baltimore City Contract Number (for reference)	Construction Completion Date	Costs incurred as of 12/31/2022 (millions)
	sanitary sewer lines by CIPP lining and open cut methods of pipe in addition to point repairs, laterals, and manholes			
9	Sewer Rehab in Greenmount & Bolton Hill Areas of Jones Falls Sewershed – Rehabilitation and replacement of sanitary sewer lines by CIPP lining and open cut methods of pipe in addition to point repairs, laterals, and manholes	SC 897R	Completed August 2016	\$16.9
10	Stony Run Sewer Rehab in Jones Falls Sewershed – Rehabilitation and replacement of sanitary sewer lines by CIPP lining and open cut methods of pipe in addition to point repairs, laterals, and manholes	SC 898	Completed August 2016	\$10.0
Structural Improvement Projects (continued)				
11	Sewer Rehab in Western Run Area of Jones Falls Sewershed – Rehabilitation and replacement of sanitary sewer lines by CIPP lining and open cut methods of pipe in addition to point repairs, laterals, and manholes	SC 899	Completed August 2016	\$14.0
12	Upper Jones Falls and Maryland Avenue Sewer Rehab in Jones Falls Sewershed – Rehabilitation and replacement of sanitary sewer lines by CIPP lining and open cut methods of pipe in addition to point repairs, laterals, and manholes	SC 900	Completed August 2016	\$15.3
13	Sewer Rehab in Upper Gwynns Run Area of High Level Sewershed – Rehabilitation and replacement of sanitary sewer lines by CIPP lining and open cut methods of pipe in addition to point repairs, laterals, and manholes	SC 905	Completed January 2016	\$11.2
14	Sewer Rehab in Northern Portion of High Level Sewershed – Rehabilitation and replacement of sanitary sewer lines by CIPP lining and open cut methods of pipe in addition to point repairs, laterals, and manholes	SC 906	Completed July 2016	\$22.8
15	Sewer Rehab in Eastern Portion High Level Sewershed – Rehabilitation and replacement of sanitary sewer lines by CIPP lining and open cut methods of pipe in addition to point repairs, laterals, and manholes	SC 907	Completed January 2017	\$7.5
16	Sewer Rehab in Herring Run Sewershed – Rehabilitation and replacement of sanitary sewer lines by CIPP lining and open cut methods of pipe in addition to point repairs, laterals, and manholes	SC 908	Completed January 2017	\$14.1
17	Sewer Rehab in Eastern Portion of Herring Run Sewershed – Rehabilitation and replacement of	SC 909	Completed July 2016	\$14.2

ID #	Project	Baltimore City Contract Number (for reference)	Construction Completion Date	Costs incurred as of 12/31/2022 (millions)
	sanitary sewer lines by CIPP lining and open cut methods of pipe in addition to point repairs, laterals, and manholes			
18	Sewer Rehab in Central Portion of Herring Run Sewershed – Rehabilitation and replacement of sanitary sewer lines by CIPP lining and open cut methods of pipe in addition to point repairs, laterals, and manholes	SC 911	Completed January 2017	\$7.5
19	Sewer Rehab in Western Portion of Low Level Sewershed – Rehabilitation and replacement of sanitary sewer lines by CIPP lining and open cut methods of pipe in addition to point repairs, laterals, and manholes	SC 912	Completed August 2016	\$6.5
20	Sewer Rehab in Eastern Portion of Low Level Sewershed – Rehabilitation and replacement of sanitary sewer lines by CIPP lining and open cut methods of pipe in addition to point repairs, laterals, and manholes	SC 913	Completed October 2016	\$7.1
21	Sewer Rehab in Southern Portion of Gwynns Falls Sewershed – Rehabilitation and replacement of sanitary sewer lines by CIPP lining and open cut methods of pipe in addition to point repairs, laterals, and manholes	SC 920	Completed October 2018	\$21.0
22	Gwynns Run Interceptor Phase II – Improvements to Lower Gwynns Run Interceptor – Phase II	SC 932	Completed November 2016	\$13.5
Structural and Priority Meter Basin Rehabilitation Projects				
23	Sewer Rehab in Dundalk Sewershed – Rehabilitation and replacement of sanitary sewer lines by CIPP lining and open cut methods of pipe in addition to point repairs, laterals, and manholes	SC 902	Completed November 2017	\$19.7
24	Sewer Rehab in Patapsco Sewershed – Rehabilitation and replacement of sanitary sewer lines by CIPP lining and open cut methods of pipe in addition to point repairs, laterals, and manholes	SC 903	9/27/2018	\$27.4
25A	Improvements to the Sanitary Sewer Collection System in the Herring Run Sewershed, Part 2 Chinquapin Run	SC 910	12/31/2021	\$23.5
25B	Improvements to the Sanitary Sewer Collection System in the Herring Run Sewershed, Part 1 Sanitary Sewers	SC 956 ^a	11/05/2020	\$7.6

ID #	Project	Baltimore City Contract Number (for reference)	Construction Completion Date	Costs incurred as of 12/31/2022 (millions)
26	Sewer Rehab in Western Portion of Low Level Sewershed – Rehabilitation and replacement of sanitary sewer lines by CIPP lining and open cut methods of pipe in addition to laterals and manholes	SC 914	1/11/2019	\$38.3
27	Sewer Rehab in Outfall Sewershed – Rehabilitation and replacement of sanitary sewer lines by CIPP lining and open cut methods of pipe in addition to point repairs, laterals, and manholes	SC 919	11/24/2018	\$34.6
28A	Improvements to the Gwynns Falls Sewershed Collection System – Area B	SC 921 ^b	2/10/2021	\$11.8
28B	Powder Mill Interceptor Improvements and Stream Restoration in the Gwynns Falls Sewershed.	SC 955 ^c	11/21/2021	\$8.4
29	Sewer Rehab in Herring Run Sewershed – Rehabilitation and replacement of sanitary sewer lines by CIPP lining and open cut methods of pipe in addition to laterals	SC 937	Completed December 2017	\$6.4
30A	Hydraulic Improvements to the High Level Sewershed Collection System	SC 940	9/10/2021	\$58.6
30B	Sanitary Sewer Collection System Improvements in the High Level Sewershed	SC 953 ^d	3/23/2020	\$12.3
31	Sewer Rehab in Western Run, Greenmount, Hampden & Bolton Hill Areas of Jones Falls Sewershed – Rehabilitation and replacement of sanitary sewer lines by CIPP lining and open cut methods of pipe in addition to manholes	SC 941	1/5/2022	\$20.6
32	Improvements to the Sanitary Sewers in the Southeast area of Baltimore City A4	SC 962 ^e	1/25/2020	\$6.0
33	Improvements to the Sanitary Sewers in the Southwest area of Baltimore City, Maidens Choice Pressure Sewer Assessment, and Uplands Sewer Replacement	SC 963 ^{e,f}	06/30/2022	\$17.2
34	Improvements to the Sanitary Sewers in the Northwest area of Baltimore City	SC 964 ^e	06/09/2020	\$19.1
Structural and Priority Meter Basin Rehabilitation Projects (continued)				
35	Improvements to the Sanitary Sewers in the Northeast area of Baltimore City	SC 965 ^e	11/27/2020	\$6.4
36	Sewer Collection System Improvements in the Greenmount, Hampden, and Bolton Hill areas of the Jones Falls Sewershed	SC 976 ^g	Completed September 2019	\$18.1

ID #	Project	Baltimore City Contract Number (for reference)	Construction Completion Date	Costs incurred as of 12/31/2022 (millions)
Phase I Total Costs incurred as of June 30, 2023				\$1,032.6

^a Design costs incurred reported under SC 910

^b SC 921 also captures the expenditures for SC 977; GF Area B scope was split between SC 921 & SC 977.

^c Design costs incurred reported under SC 921

^d Design costs incurred reported under SC 940

^e Project is a re-scoped project containing elements of work from original contracts SC 897R, SC 898, SC 909 and SC 912. See projects SC 897R, SC 898, SC 909 and SC 912 for costs incurred under original contract.

^f Project SC 963 was re-scoped and portions of the work were re-assigned to SC 998. Costs incurred include costs related to projected SC 998.

^g Project re-scoped, costs incurred for repackaging reported under SC 897R

11.0 Acronyms

Acronym	Definition
BBERP	Building Backup Reimbursement Program
BWB	Blue Water Baltimore
CCTV	Closed-Circuit Television
CD	Consent Decree
CIPP	Cured-in-Place Pipe
CMMS	Computerized Maintenance Management System
COVID-19	Coronavirus Disease of 2019
CWA	Clean Water Act
DOE	Date of Entry
DPW	Department of Public Works
EPA	Environmental Protection Agency
ERP	Expedited Reimbursement Program
FOG	Fats, Oil, and Grease
FY	Fiscal Year
GIS	Geographic Information System
Hr.	Hour
I/I	Inflow and Infiltration
ID	Identification
In.	Inches
IT	Information Technology

Acronym	Definition
LF	Linear Feet
LOP	Level of Protection
MCD	Modified Consent Decree
MDE	Maryland Department of the Environment
MDOT	Maryland Department of Transportation
No.	Number
NPDES	National Pollutant Discharge Elimination System
OAM	Office of Asset Management
PCFM	Post-Construction Flow Monitoring
SBDP	Small Business Development Program
SCADA	Supervisory Control and Data Acquisition
SDUO	Sanitary Discharges of Unknown Origin
SSO	Sanitary Sewer Overflow
U.S.	United States
WSSC	Washington Suburban Sanitary Commission
WWTP	Wastewater Treatment Plant

Attachment 1. Collection System SSO Events during the Calendar Quarter

Date	Location	ZIP	Wet or Dry Weather	Volume (gallons)
4/3/2023	1129 N Fulton Ave	21217	Wet Weather	1
4/5/2023	E Monument St & N Wolfe St	21287	Dry Weather	243
4/7/2023	3407 Edmondson Ave	21229	Dry Weather	1,440
4/7/2023	Lawina Rd & Fairfax Rd	21216	Dry Weather	285
4/7/2023	2805 Walbrook Ave	21216	Dry Weather	1
4/7/2023	4641 Park Heights Ave	21215	Wet Weather	29
4/9/2023	3305 Taney Rd	21215	Wet Weather	1
4/10/2023	E Monument St & N Wolfe St	21287	Dry Weather	255
4/10/2023	2006 Fleet St	21231	Dry Weather	2
4/11/2023	1430 McCulloh St	21217	Dry Weather	1
4/12/2023	313 E Cold Spring Ln	21212	Dry Weather	7
4/12/2023	12 Hillside Rd	21210	Dry Weather	3
4/13/2023	641 W University Pkwy	21210	Dry Weather	760
4/14/2023	309 Mosher St	21217	Dry Weather	15
4/14/2023	6203 Wallis Ave	21215	Dry Weather	1970
4/14/2023	5110 Frederick Ave	21229	Dry Weather	185
4/17/2023	423 E Hamburg St	21230	Wet Weather	1
4/18/2023	2617 W Fairmount Ave	21223	Dry Weather	390
4/19/2023	5015 Boxhill Ln	21210	Dry Weather	880
4/19/2023	Boston St & Steelton Ave	21224	Dry Weather	590
4/19/2023	142 W Lanvale St	21217	Dry Weather	1
4/24/2023	3505 Lyndale Ave	21213	Wet Weather	1
4/25/2023	2803 Elgin Ave	21216	Wet Weather	1
4/25/2023	5713 Edgepark Rd	21239	Dry Weather	2
4/25/2023	5110 Frederick Ave	21229	Dry Weather	659
4/26/2023	1127 E Lombard St	21202	Dry Weather	3
4/28/2023	428 E Preston St - SSO Site #72	21202	Wet Weather	110,055
4/30/2023	702 S Broadway	21231	Wet Weather	1
4/30/2023	31 S Washington St	21231	Wet Weather	1
5/1/2023	4507 Roland Ave	21210	Wet Weather	2
5/1/2023	2812 Hinsdale Dr	21230	Wet Weather	1
5/1/2023	2210 Lyndhurst Ave	21216	Wet Weather	1
5/1/2023	2152 Hollins St	21223	Wet Weather	1
5/1/2023	1612 Elmtree St	21226	Wet Weather	1
5/2/2023	2803 Elgin Ave	21216	Wet Weather	1
5/3/2023	Edmondson Ave & Hilton St	21229	Dry Weather	15,600
5/5/2023	642 E Clement St	21230	Dry Weather	1
5/8/2023	1403 Race St	21230	Dry Weather	1
5/9/2023	Eastern Pkwy & Glenmore Ave	21206	Dry Weather	675

Date	Location	ZIP	Wet or Dry Weather	Volume (gallons)
5/9/2023	1612 Elmtree St	21226	Dry Weather	5
5/11/2023	4305 Wendover Rd	21218	Dry Weather	700
5/12/2023	N Athol Ave & Birchwood Dr	21229	Dry Weather	1,470
5/15/2023	5002 Boxhill Ln	21210	Wet Weather	1
5/15/2023	2303 James St	21230	Wet Weather	708
5/17/2023	2803 Elgin Ave	21216	Dry Weather	25
5/19/2023	1203 Mosher St	21217	Dry Weather	1
5/20/2023	Elizabeth Ave & Harriet Ave	21230	Dry Weather	3,482
5/20/2023	3520 Beech Ave	21211	Dry Weather	3,118
5/21/2023	3221 Clarks Ln	21215	Wet Weather	120
5/22/2023	4407 St Georges Ave	21212	Dry Weather	1
5/26/2023	1111 Bellemore Rd	21210	Dry Weather	1
5/28/2023	6014 Bertram Ave	21214	Dry Weather	1
5/29/2023	301 Edgevale Rd	21210	Dry Weather	1
5/30/2023	445 W 24th St	21211	Dry Weather	1
5/30/2023	2800 Rosalind Ave	21215	Dry Weather	10
6/1/2023	120 N Fremont Ave	21201	Dry Weather	2
6/5/2023	5613 Force Rd	21206	Dry Weather	2
6/6/2023	5110 Frederick Ave	21229	Dry Weather	1,805
6/8/2023	1710 St Paul St	21202	Dry Weather	1
6/12/2023	436 Kane St	21224	Dry Weather	36
6/13/2023	2607 Quantico Ave	21215	Wet Weather	1
6/18/2023	1713 Lancaster St	21231	Dry Weather	1
6/18/2023	2736 E Baltimore St	21224	Dry Weather	1
6/27/2023	862 Vine St	21201	Wet Weather	1
6/27/2023	N Charles St & W Lanvale St - SSO Site #152	21201	Wet Weather	500
6/27/2023	N Charles St & Lafayette Ave - SSO Site #154	21201	Wet Weather	5,000
6/30/2023	5950 Glen Falls Ave	21206	Wet Weather	2
Total:				151,064

Attachment 2. SSO Structure Overflows During the Calendar Quarter

Date	Location	ZIP	Wet or Dry Weather	Volume (gallons)
4/28/2023	428 E Preston St – SSO Site #72	21202	Wet Weather	110,055
6/27/2023	N Charles St & W Lanvale St – SSO Site #152	21201	Wet Weather	500
6/27/2023	N Charles St & Lafayette Ave – SSO Site #154	21201	Wet Weather	5,000
Total:				115,555

Attachment 3. Reported Building Backups During the Calendar Quarter

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
4800 MORELLO RD	4/1/2023	4/1/2023 10:12	No		Lateral	N/A	Unknown		
5000 DENMORE AVE	4/1/2023	4/1/2023 12:58	No		Mainline	N/A	Unknown		
1400 MCCULLOH ST	4/1/2023	4/1/2023 12:13	No		Lateral	N/A	Unknown		
5000 DENMORE AVE	4/1/2023	4/1/2023 12:52	No		Mainline	N/A	Unknown		
1300 GITTINGS AVE	4/1/2023	4/1/2023 13:17	No		Lateral	N/A	Unknown		
3900 BOARMAN AVE	4/1/2023	4/1/2023 15:16	No		Mainline and Lateral	N/A	Unknown		
5000 SCHAUB AVE	4/1/2023	4/1/2023 14:56	No		Lateral	N/A	Unknown		
6000 BELLONA AVE	4/1/2023	4/1/2023 15:30	No		Lateral	N/A	Unknown		
4600 HARCOURT RD	4/1/2023	4/1/2023 17:10	No		Mainline	N/A	Unknown		
400 FOLCROFT ST	4/1/2023	4/1/2023 17:19	No		Mainline	N/A	Unknown		
3000 TIOGA PKWY	4/1/2023	4/1/2023 17:25	No		Mainline	N/A	Unknown		
6000 BELLONA AVE	4/1/2023	4/1/2023 17:29	No		Lateral	N/A	Unknown		
1200 ANGLESEA ST	4/1/2023	4/1/2023 20:34	No		Lateral	N/A	Unknown		
2000 PARK AVE	4/1/2023	4/1/2023 23:35	No		Mainline	N/A	Unknown		
2700 BERYL AVE	4/2/2023	4/2/2023 12:10	No		Lateral	N/A	Unknown		
300 CEDARCROFT RD	4/2/2023	4/2/2023 13:58	No		Lateral	N/A	Unknown		
3900 BANCROFT RD	4/2/2023	4/2/2023 17:34	No		Lateral	N/A	Unknown		
1200 MERIDENE DR	4/2/2023	4/2/2023 17:42	No		Lateral	N/A	Unknown		
2100 AIKEN ST	4/2/2023	4/2/2023 17:04	No		Mainline	N/A	Unknown		
3500 CHESLEY AVE	4/2/2023	4/2/2023 19:47	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
3800 EDNOR RD	4/3/2023	4/4/2023 20:24	No		Lateral	N/A	Unknown		
3600 PARKSIDE DR	4/3/2023	4/3/2023 10:22	No		Mainline	N/A	Unknown		
4800 CORDELIA AVE	4/3/2023	4/3/2023 11:12	No		Lateral	N/A	Unknown		
1500 MORELAND AVE	4/3/2023	4/3/2023 10:56	No		Lateral	N/A	Unknown		
6300 LEITH WALK	4/3/2023	4/3/2023 11:02	No		Mainline and Lateral	N/A	Unknown		
1900 DEERING AVE	4/3/2023	4/3/2023 13:18	No		Lateral	N/A	Unknown		
2500 ARUNAH AVE	4/3/2023	4/3/2023 14:35	No		Mainline and Lateral	N/A	Unknown		
3700 MIDHEIGHTS RD	4/3/2023	4/3/2023 14:35	No		Lateral	N/A	Unknown		
3800 MONTEREY RD	4/3/2023	4/3/2023 16:50	No		Lateral	N/A	Unknown		
2600 JEFFERSON ST	4/3/2023	4/3/2023 16:22	No		Mainline	N/A	Unknown		
4800 FREDERICK AVE	4/3/2023	4/3/2023 19:17	No		Mainline	N/A	Unknown		
5800 CLEARSPRING RD	4/3/2023	4/3/2023 16:29	No		Mainline	N/A	Unknown		
5900 BELLE VISTA AVE	4/3/2023	4/3/2023 17:24	No		Lateral	N/A	Unknown		
500 EAST GITTINGS ST	4/3/2023	4/3/2023 17:03	No		Mainline and Lateral	N/A	Unknown		
1200 GITTINGS AVE	4/3/2023	4/3/2023 19:21	No		Lateral	N/A	Unknown		
1700 EAST BIDDLE ST	4/3/2023	4/3/2023 22:54	No		Lateral	N/A	Unknown		
5200 KELWAY RD	4/3/2023	4/3/2023 19:41	No		Lateral	N/A	Unknown		
400 NORTH BELNORD AVE	4/3/2023	4/3/2023 21:34	No		Lateral	N/A	Unknown		
2900 LIMOND PL	4/3/2023	4/3/2023 22:43	No		Lateral	N/A	Unknown		
4700 ELSRODE AVE	4/3/2023	4/4/2023 9:24	No		Mainline	N/A	Unknown		
3500 WILKENS AVE	4/4/2023	4/4/2023 10:00	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
1800 NORTH WOLFE ST	4/4/2023	4/4/2023 9:31	No		Mainline	N/A	Unknown		
2600 GARRETT AVE	4/4/2023	4/4/2023 17:30	No		Mainline	N/A	Unknown		
600 CHARRAWAY RD	4/4/2023	4/4/2023 14:50	No		Lateral	N/A	Unknown		
700 MELVILLE AVE	4/4/2023	4/4/2023 17:44	No		Lateral	N/A	Unknown		
2600 QUANTICO AVE	4/4/2023	4/4/2023 14:36	No		Mainline	N/A	Unknown		
100 SOUTH STRICKER ST	4/4/2023	4/4/2023 18:16	No		Mainline	N/A	Unknown		
1000 MARLAU DR	4/4/2023	4/4/2023 18:25	No		Lateral	N/A	Unknown		
3300 MORAVIA RD	4/4/2023	4/4/2023 19:25	No		Mainline	N/A	Unknown		
1900 RAMBLEWOOD RD	4/4/2023	4/4/2023 18:33	No		Lateral	N/A	Unknown		
2000 BRYANT AVE	4/4/2023	4/4/2023 16:44	No		Mainline	N/A	Unknown		
2500 DRUID HILL AVE	4/4/2023	4/4/2023 17:03	No		Mainline	N/A	Unknown		
5900 YORK RD	4/4/2023	4/4/2023 18:20	No		Mainline	N/A	Unknown		
3200 NERAK RD	4/4/2023	4/4/2023 20:39	No		Lateral	N/A	Unknown		
3900 GREENSPRING AVE	4/4/2023	4/4/2023 21:00	No		Mainline	N/A	Unknown		
3000 TIOGA PKWY	4/4/2023	4/4/2023 21:33	No		Mainline	N/A	Unknown		
5600 WINTHROPE AVE	4/4/2023	4/4/2023 21:46	No		Lateral	N/A	Unknown		
900 MCKEWIN AVE	4/4/2023	4/5/2023 9:06	No		Lateral	N/A	Unknown		
300 MARYDELL RD	4/5/2023	4/5/2023 9:48	No		Lateral	N/A	Unknown		
4500 HARCOURT RD	4/5/2023	4/5/2023 9:30	No		Lateral	N/A	Unknown		
1100 ARGYLE AVE	4/5/2023	4/5/2023 12:08	No		Lateral	N/A	Unknown		
300 BROXTON RD	4/5/2023	4/5/2023 13:09	No		Lateral	N/A	Unknown		
1600 NORTHWICK CT	4/5/2023	4/5/2023 13:39	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
3300 SAINT PAUL ST	4/5/2023	4/5/2023 15:44	No		Lateral	N/A	Unknown		
2900 ARUNAH AVE	4/5/2023	4/5/2023 17:38	No		Mainline	N/A	Unknown		
2500 DRUID HILL AVE	4/5/2023	4/5/2023 17:02	No		Mainline	N/A	Unknown		
4100 NORFOLK AVE	4/5/2023	4/5/2023 17:57	No		Mainline	N/A	Unknown		
5500 HARFORD RD	4/5/2023	4/5/2023 19:13	No		Mainline	N/A	Unknown		
4200 SHAMROCK AVE	4/5/2023	4/5/2023 19:55	No		Lateral	N/A	Unknown		
1900 SWANSEA RD	4/5/2023	4/5/2023 20:08	No		Mainline	N/A	Unknown		
700 DORCHESTER RD	4/5/2023	4/5/2023 20:04	No		Lateral	N/A	Unknown		
3300 BEVERLY RD	4/5/2023	4/5/2023 21:49	No		Lateral	N/A	Unknown		
5400 GRINDON AVE	4/5/2023	4/6/2023 10:08	No		Lateral	N/A	Unknown		
3900 BONNER RD	4/6/2023	4/6/2023 8:40	No		Lateral	N/A	Unknown		
400 NORTH CHAPEL ST	4/6/2023	4/6/2023 10:21	No		Mainline	N/A	Unknown		
1000 EASTERN AVE	4/6/2023	4/6/2023 11:26	No		Mainline	N/A	Unknown		
3800 LYNDALE AVE	4/6/2023	4/6/2023 10:43	No		Lateral	N/A	Unknown		
5000 PLYMOUTH RD	4/6/2023	4/6/2023 11:09	No		Mainline	N/A	Unknown		
3100 NORTHWAY DR	4/6/2023	4/6/2023 13:37	No		Lateral	N/A	Unknown		
3300 SAINT PAUL ST	4/6/2023	4/6/2023 15:25	No		Lateral	N/A	Unknown		
700 WINANS WAY	4/6/2023	4/6/2023 14:34	No		Mainline	N/A	Unknown		
1400 GITTINGS AVE	4/6/2023	4/6/2023 18:29	No		Lateral	N/A	Unknown		
400 MOUNT HOLLY ST	4/6/2023	4/6/2023 15:11	No		Lateral	N/A	Unknown		
4700 EDMONDSON AVE	4/6/2023	4/6/2023 17:55	No		Mainline	N/A	Unknown		
500 EAST COLD SPRING LN	4/6/2023	4/6/2023 17:17	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
6100 CHINQUAPIN PKWY	4/6/2023	4/6/2023 18:05	No		Mainline	N/A	Unknown		
5900 LILLYAN AVE	4/6/2023	4/6/2023 20:20	No		Mainline	N/A	Unknown		
6200 NORTHWOOD DR	4/6/2023	4/6/2023 19:23	No		Lateral	N/A	Unknown		
1200 MERIDENE DR	4/6/2023	4/6/2023 19:45	No		Lateral	N/A	Unknown		
2500 NORTH ROSEDALE ST	4/7/2023	4/7/2023 8:40	No		Mainline	N/A	Unknown		
6500 HOPETON AVE	4/7/2023	4/7/2023 9:09	No		Lateral	N/A	Unknown		
2200 NORTH ROSEDALE ST	4/7/2023	4/7/2023 9:30	No		Mainline and Lateral	N/A	Unknown		
5000 EAST FEDERAL ST	4/7/2023	4/7/2023 11:36	No		Mainline	N/A	Unknown		
3200 CHESLEY AVE	4/7/2023	4/7/2023 11:52	No		Mainline and Lateral	N/A	Unknown		
6400 LAURELTON AVE	4/7/2023	4/7/2023 11:32	No		Lateral	N/A	Unknown		
1300 NORTH ELLWOOD AVE	4/7/2023	4/7/2023 11:50	No		Mainline and Lateral	N/A	Unknown		
800 NORTH STREEPER ST	4/7/2023	4/7/2023 14:08	No		Mainline and Lateral	N/A	Unknown		
5800 YORK RD	4/7/2023	4/7/2023 12:31	No		Mainline	N/A	Unknown		
2800 WALBROOK AVE	4/7/2023	4/7/2023 13:32	No		Lateral	N/A	Unknown		
4300 ROLAND SPRINGS DR	4/7/2023	4/7/2023 14:52	No		Lateral	N/A	Unknown		
0 SOUTH FULTON AVE	4/7/2023	4/7/2023 15:26	No		Mainline	N/A	Unknown		
600 SOUTH GLOVER ST	4/7/2023	4/7/2023 17:01	No		Mainline and Lateral	N/A	Unknown		
100 SOUTH STRICKER ST	4/7/2023	4/7/2023 17:29	No		Mainline	N/A	Unknown		
4500 HARCOURT RD	4/7/2023	4/7/2023 17:42	No		Lateral	N/A	Unknown		
1700 SHERWOOD AVE	4/8/2023	4/8/2023 8:40	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
1700 NORTH PATTERSON PARK AVE	4/8/2023	4/8/2023 10:37	No		Mainline and Lateral	N/A	Unknown		
2400 EAST COLD SPRING LN	4/8/2023	4/8/2023 11:13	No		Mainline and Lateral	N/A	Unknown		
3100 NORTHWAY DR	4/8/2023	4/8/2023 11:38	No		Lateral	N/A	Unknown		
5900 BELLE VISTA AVE	4/8/2023	4/8/2023 12:41	No		Mainline and Lateral	N/A	Unknown		
1000 FAWN ST	4/8/2023	4/8/2023 17:56	No		Mainline	N/A	Unknown		
0 EAST PRESTON ST	4/8/2023	4/8/2023 19:16	No		Lateral	N/A	Unknown		
400 SOUTHWAY	4/8/2023	4/8/2023 20:09	No		Lateral	N/A	Unknown		
4500 HARCOURT RD	4/8/2023	4/8/2023 22:02	No		Lateral	N/A	Unknown		
3300 TANEY RD	4/8/2023	4/9/2023 9:09	No		Lateral	N/A	Unknown		
1500 LOCHWOOD RD	4/9/2023	4/9/2023 11:01	No		Lateral	N/A	Unknown		
5400 GRINDON AVE	4/9/2023	4/9/2023 13:58	No		Lateral	N/A	Unknown		
100 HOMELAND AVE	4/9/2023	4/9/2023 16:54	No		Lateral	N/A	Unknown		
7000 PARK HEIGHTS AVE	4/9/2023	4/9/2023 18:55	No		Lateral	N/A	Unknown		
2700 GOODWOOD RD	4/9/2023	4/9/2023 18:01	No		Lateral	N/A	Unknown		
500 WEST 40TH ST	4/9/2023	4/9/2023 21:02	No		Lateral	N/A	Unknown		
6200 FAIRDEL AVE	4/9/2023	4/9/2023 22:18	No		Lateral	N/A	Unknown		
700 MCKEWIN AVE	4/10/2023	4/10/2023 9:08	No		Mainline	N/A	Unknown		
4200 SHAMROCK AVE	4/10/2023	4/10/2023 9:38	No		Lateral	N/A	Unknown		
400 IMLA ST	4/10/2023	4/10/2023 10:21	No		Lateral	N/A	Unknown		
2800 ELGIN AVE	4/10/2023	4/10/2023 10:27	No		Mainline	N/A	Unknown		
3700 BROOKLYN AVE	4/10/2023	4/10/2023 11:50	No		Mainline	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
2700 BEECHLAND AVE	4/10/2023	4/10/2023 11:58	No		Mainline	N/A	Unknown		
2000 EAST LANVALE ST	4/10/2023	4/10/2023 18:26	No		Lateral	N/A	Unknown		
5300 NELSON AVE	4/10/2023	4/10/2023 13:18	No		Lateral	N/A	Unknown		
4600 ARABIA AVE	4/10/2023	4/10/2023 13:03	No		Mainline and Lateral	N/A	Unknown		
6300 WESTERN RUN DR	4/10/2023	4/10/2023 19:15	No		Lateral	N/A	Unknown		
1200 DELBERT AVE	4/10/2023	4/10/2023 15:49	No		Lateral	N/A	Unknown		
2200 CLIFTON AVE	4/10/2023	4/10/2023 18:00	No		Mainline and Lateral	N/A	Unknown		
2900 ROCKROSE AVE	4/10/2023	4/10/2023 18:15	No		Mainline	N/A	Unknown		
4900 ANNTANA AVE	4/10/2023	4/10/2023 18:44	No		Lateral	N/A	Unknown		
5700 WILLOWTON AVE	4/10/2023	4/10/2023 19:58	No		Lateral	N/A	Unknown		
2700 NORTH ROSEDALE ST	4/11/2023	4/11/2023 13:41	No		Lateral	N/A	Unknown		
200 BOLTON PL	4/11/2023	4/11/2023 9:51	No		Lateral	N/A	Unknown		
5200 CEDGATE RD	4/11/2023	4/11/2023 13:20	No		Lateral	N/A	Unknown		
900 REVERDY RD	4/11/2023	4/11/2023 10:44	No		Lateral	N/A	Unknown		
2600 GARRETT AVE	4/11/2023	4/11/2023 15:36	No		Lateral	N/A	Unknown		
4500 WAKEFIELD RD	4/11/2023	4/11/2023 13:43	No		Lateral	N/A	Unknown		
2300 WEST LANVALE ST	4/11/2023	4/11/2023 12:41	No		Mainline and Lateral	N/A	Unknown		
3000 BELMONT AVE	4/11/2023	4/11/2023 17:38	No		Mainline	N/A	Unknown		
500 SAINT PAUL PL	4/11/2023	4/11/2023 17:02	No		Mainline	N/A	Unknown		
2600 EAST FAYETTE ST	4/11/2023	4/11/2023 17:35	No		Mainline	N/A	Unknown		
600 WYETH ST	4/11/2023	4/11/2023 16:33	No		Mainline	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
4400 BELVIEU AVE	4/11/2023	4/11/2023 18:07	No		Mainline and Lateral	N/A	Unknown		
2300 ROGENE DR	4/11/2023	4/11/2023 19:44	No		Mainline	N/A	Unknown		
700 RICHWOOD AVE	4/11/2023	4/11/2023 20:16	No		Lateral	N/A	Unknown		
2100 POPLAR GROVE ST	4/11/2023	4/11/2023 21:16	No		Mainline	N/A	Unknown		
4100 THE ALAMEDA	4/11/2023	4/11/2023 19:37	No		Lateral	N/A	Unknown		
700 COOKS LN	4/11/2023	4/11/2023 21:48	No		Lateral	N/A	Unknown		
600 WASHBURN AVE	4/11/2023	4/11/2023 21:08	No		Lateral	N/A	Unknown		
3000 GRAYSON ST	4/12/2023	4/12/2023 8:31	No		Lateral	N/A	Unknown		
3600 GLENGYLE AVE	4/12/2023	4/12/2023 11:26	No		Mainline and Lateral	N/A	Unknown		
4200 CREST HEIGHTS RD	4/12/2023	4/12/2023 11:50	No		Mainline and Lateral	N/A	Unknown		
1400 REDFERN AVE	4/12/2023	4/12/2023 17:38	No		Mainline	N/A	Unknown		
3200 WESTERWALD AVE	4/12/2023	4/12/2023 14:12	No		Lateral	N/A	Unknown		
0 SOUTH FULTON AVE	4/12/2023	4/12/2023 15:07	No		Mainline and Lateral	N/A	Unknown		
900 EAST 22ND ST	4/12/2023	4/12/2023 17:22	No		Mainline	N/A	Unknown		
3300 AVONDALE AVE	4/12/2023	4/12/2023 17:15	No		Mainline	N/A	Unknown		
5600 SAGRA RD	4/12/2023	4/12/2023 19:17	No		Mainline and Lateral	N/A	Unknown		
1500 LOCHWOOD RD	4/12/2023	4/12/2023 20:46	No		Mainline and Lateral	N/A	Unknown		
2000 EAST LANVALE ST	4/12/2023	4/12/2023 20:41	No		Lateral	N/A	Unknown		
2700 CHESLEY AVE	4/12/2023	4/12/2023 21:39	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
6200 PIONEER DR	4/12/2023	4/12/2023 21:43	No		Lateral	N/A	Unknown		
4500 ROLAND AVE	4/12/2023	4/13/2023 13:04	No		Mainline	N/A	Unknown		
1500 EDISON HWY	4/13/2023	4/13/2023 9:30	No		Lateral	N/A	Unknown		
600 NORTH WOLFE ST	4/13/2023	4/13/2023 10:25	No		Mainline	N/A	Unknown		
2400 EUTAW PL	4/13/2023	4/14/2023 8:49	No		Lateral	N/A	Unknown		
5800 CLEARSPRING RD	4/13/2023	4/13/2023 13:11	No		Mainline	N/A	Unknown		
1500 LOCHWOOD RD	4/13/2023	4/13/2023 13:25	No		Lateral	N/A	Unknown		
5100 HILLWELL RD	4/13/2023	4/13/2023 12:29	No		Lateral	N/A	Unknown		
5800 CLEARSPRING RD	4/13/2023	4/13/2023 13:14	No		Mainline	N/A	Unknown		
900 REVERDY RD	4/13/2023	4/13/2023 13:07	No		Lateral	N/A	Unknown		
600 DENISON ST	4/13/2023	4/13/2023 14:51	No		Lateral	N/A	Unknown		
1400 WEST 37TH ST	4/13/2023	4/13/2023 17:45	No		Mainline	N/A	Unknown		
700 SAINT JOHNS RD	4/13/2023	4/13/2023 19:00	No		Lateral	N/A	Unknown		
4400 KATHLAND AVE	4/13/2023	4/13/2023 17:06	No		Lateral	N/A	Unknown		
3100 TYNDALE AVE	4/13/2023	4/13/2023 20:51	No		Mainline and Lateral	N/A	Unknown		
6700 BOSTON AVE	4/13/2023	4/13/2023 18:49	No		Lateral	N/A	Unknown		
2900 HARFORD RD	4/13/2023	4/13/2023 20:48	No		Mainline	N/A	Unknown	Yes	Closed
3700 BANCROFT RD	4/13/2023	4/13/2023 22:22	No		Lateral	N/A	Unknown		
3200 TANEY RD	4/13/2023	4/13/2023 22:43	No		Lateral	N/A	Unknown		
6600 GLENOAK AVE	4/13/2023	4/14/2023 11:44	No		Lateral	N/A	Unknown		
6300 WALLIS AVE	4/14/2023	4/14/2023 2:09	No		Mainline	N/A	Unknown		
6300 BLK WALLIS AVE	4/14/2023	4/14/2023 2:09	No		Mainline	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
2800 VIRGINIA AVE	4/14/2023	4/14/2023 9:42	No		Mainline	N/A	Unknown		
4300 FERNHILL AVE	4/14/2023	4/14/2023 11:11	No		Mainline and Lateral	N/A	Unknown		
2800 ALVARADO SQ	4/14/2023	4/14/2023 13:39	No		Lateral	N/A	Unknown		
2900 STRANDEN RD	4/14/2023	4/14/2023 14:21	No		Mainline	N/A	Unknown		
3400 WEST STRATHMORE AVE	4/14/2023	4/14/2023 13:40	No		Mainline	N/A	Unknown		
3000 BEVERLY RD	4/14/2023	4/14/2023 18:05	No		Mainline	N/A	Unknown		
6200 PIONEER DR	4/14/2023	4/14/2023 18:26	No		Lateral	N/A	Unknown		
500 SOUTH PORT ST	4/14/2023	4/14/2023 18:31	No		Mainline	N/A	Unknown		
200 NORTH CASTLE ST	4/14/2023	4/14/2023 18:13	No		Lateral	N/A	Unknown		
2200 EAST FAIRMOUNT AVE	4/14/2023	4/14/2023 18:21	No		Mainline	N/A	Unknown		
1100 NORTH GILMOR ST	4/14/2023	4/14/2023 18:45	No		Lateral	N/A	Unknown		
5200 CEDGATE RD	4/14/2023	4/14/2023 19:21	No		Lateral	N/A	Unknown		
1600 NORTH BOND ST	4/14/2023	4/14/2023 20:03	No		Lateral	N/A	Unknown		
3700 FOSTER AVE	4/15/2023	4/15/2023 9:35	No		Lateral	N/A	Unknown		
3800 CLIFTON AVE	4/15/2023	4/15/2023 12:14	No		Mainline and Lateral	N/A	Unknown		
2100 POPLAR GROVE ST	4/15/2023	4/15/2023 13:09	No		Mainline and Lateral	N/A	Unknown		
300 ALLENDALE ST	4/15/2023	4/15/2023 14:51	No		Lateral	N/A	Unknown		
4000 LOCH RAVEN BLVD	4/15/2023	4/15/2023 17:04	Yes		Lateral	N/A	Unknown		
1500 GLENEAGLE RD	4/16/2023	4/16/2023 9:31	Yes		Lateral	N/A	Unknown		
3900 COLBORNE RD	4/16/2023	4/16/2023 12:55	No		Lateral	N/A	Unknown		
2900 THE ALAMEDA	4/16/2023	4/16/2023 13:45	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
800 NORTH STREEPER ST	4/16/2023	4/16/2023 13:28	Yes		Mainline and Lateral	N/A	Unknown		
5600 WAYNE AVE	4/16/2023	4/16/2023 13:27	No		Mainline and Lateral	N/A	Unknown		
3800 GLENGYLE AVE	4/16/2023	4/16/2023 16:49	No		Lateral	N/A	Unknown		
5500 SILVERBELL RD	4/16/2023	4/16/2023 17:04	Yes		Lateral	N/A	Unknown		
4800 CORDELIA AVE	4/16/2023	4/16/2023 18:50	No		Lateral	N/A	Unknown		
1800 SWANSEA RD	4/16/2023	4/16/2023 20:22	Yes		Lateral	N/A	Unknown		
3100 CLIFTON AVE	4/16/2023	4/16/2023 21:54	No		Lateral	N/A	Unknown		
1300 EAST NORTHERN PKWY	4/17/2023	4/17/2023 9:25	No		Lateral	N/A	Unknown		
1600 EAST MADISON ST	4/17/2023	4/17/2023 10:34	No		Lateral	N/A	Unknown		
2800 CHRISTOPHER AVE	4/17/2023	4/17/2023 11:31	No		Lateral	N/A	Unknown		
2100 NORTH CHARLES ST	4/17/2023	4/17/2023 11:40	No		Mainline	N/A	Unknown		
1800 RIGGS AVE	4/17/2023	4/17/2023 12:06	No		Mainline	N/A	Unknown		
2100 GREENMOUNT AVE	4/17/2023	4/17/2023 12:22	No		Mainline	N/A	Unknown		
1900 CRESTVIEW RD	4/17/2023	4/17/2023 11:45	No		Lateral	N/A	Unknown		
3900 BELVIEU AVE	4/17/2023	4/17/2023 12:57	No		Lateral	N/A	Unknown		
3700 ELMORA AVE	4/17/2023	4/17/2023 15:02	No		Lateral	N/A	Unknown		
3300 SAINT PAUL ST	4/17/2023	4/17/2023 15:57	No		Lateral	N/A	Unknown		
3000 PINWOOD AVE	4/17/2023	4/17/2023 17:18	No		Lateral	N/A	Unknown		
3600 BEECH AVE	4/17/2023	4/17/2023 17:27	No		Lateral	N/A	Unknown		
1100 SOUTH POTOMAC ST	4/17/2023	4/17/2023 18:17	No		Mainline	N/A	Unknown		
100 NORTH MILTON AVE	4/17/2023	4/17/2023 18:48	No		Mainline and Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
5600 WAYNE AVE	4/17/2023	4/17/2023 20:28	No		Mainline and Lateral	N/A	Unknown		
3200 LYNDALE AVE	4/17/2023	4/17/2023 17:21	No		Lateral	N/A	Unknown		
1000 CAMERON RD	4/17/2023	4/17/2023 19:09	No		Mainline	N/A	Unknown		
1500 EAST 29TH ST	4/17/2023	4/17/2023 21:14	No		Lateral	N/A	Unknown		
800 SOUTH EATON ST	4/17/2023	4/17/2023 21:16	No		Mainline	N/A	Unknown		
6200 HILLTOP AVE	4/18/2023	4/18/2023 9:33	No		Lateral	N/A	Unknown		
100 NORTH EDGEWOOD ST	4/18/2023	4/18/2023 10:17	No		Lateral	N/A	Unknown		
700 WINANS WAY	4/18/2023	4/18/2023 10:01	No		Lateral	N/A	Unknown		
5300 MAPLE AVE	4/18/2023	4/18/2023 15:40	No		Mainline	N/A	Unknown		
1900 NORTH FOREST PARK AVE	4/18/2023	4/18/2023 13:38	No		Lateral	N/A	Unknown		
3100 HAMILTON AVE	4/18/2023	4/18/2023 20:40	No		Mainline	N/A	Unknown		
2900 HARFORD RD	4/18/2023	4/18/2023 20:01	No		Mainline	N/A	Unknown		
0 SOUTH MONASTERY AVE	4/18/2023	4/18/2023 21:30	No		Lateral	N/A	Unknown		
2100 CLIFTON AVE	4/18/2023	4/18/2023 16:47	No		Mainline	N/A	Unknown		
5700 CROSS COUNTRY BLVD	4/18/2023	4/18/2023 19:25	No		Mainline and Lateral	N/A	Unknown		
400 NORTH PATTERSON PARK AVE	4/18/2023	4/18/2023 22:43	No		Mainline	N/A	Unknown		
2300 EUTAW PL	4/18/2023	4/18/2023 21:45	No		Mainline	N/A	Unknown		
0 SOUTH FULTON AVE	4/18/2023	4/18/2023 19:33	No		Mainline	N/A	Unknown		
2800 EDMONDSON AVE	4/18/2023	4/18/2023 20:35	No		Mainline	N/A	Unknown		
900 NORTH ARLINGTON AVE	4/18/2023	4/18/2023 22:03	No		Lateral	N/A	Unknown		
1900 NORTH FOREST PARK AVE	4/19/2023	4/19/2023 11:36	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
1500 MORELAND AVE	4/19/2023	4/19/2023 10:52	No		Mainline and Lateral	N/A	Unknown		
0 NORTH CALHOUN ST	4/19/2023	4/19/2023 13:17	No		Mainline	N/A	Unknown		
4900 GILRAY DR	4/19/2023	4/19/2023 17:26	No		Mainline and Lateral	N/A	Unknown		
2900 WHITE AVE	4/19/2023	4/19/2023 17:46	No		Mainline	N/A	Unknown		
3300 SEQUOIA AVE	4/19/2023	4/19/2023 14:47	No		Mainline and Lateral	N/A	Unknown		
2800 MONTEBELLO TER	4/19/2023	4/19/2023 18:06	No		Lateral	N/A	Unknown		
4700 EDMONDSON AVE	4/19/2023	4/19/2023 20:21	No		Mainline	N/A	Unknown		
4800 LIBERTY HEIGHTS AVE	4/19/2023	4/19/2023 18:26	No		Mainline	N/A	Unknown		
4100 RAYMONN AVE	4/19/2023	4/19/2023 20:12	No		Lateral	N/A	Unknown		
1600 STONEWOOD RD	4/20/2023	4/20/2023 10:42	No		Lateral	N/A	Unknown		
3400 ELMLEY AVE	4/20/2023	4/20/2023 13:25	No		Mainline and Lateral	N/A	Unknown		
2500 GUILFORD AVE	4/20/2023	4/20/2023 12:36	No		Lateral	N/A	Unknown		
1200 WHITELOCK ST	4/20/2023	4/20/2023 13:33	No		Lateral	N/A	Unknown		
0 SOUTH MONASTERY AVE	4/20/2023	4/20/2023 14:25	No		Mainline	N/A	Unknown		
5000 WESTHILLS RD	4/20/2023	4/20/2023 14:34	No		Lateral	N/A	Unknown		
600 WYETH ST	4/20/2023	4/20/2023 15:32	No		Mainline and Lateral	N/A	Unknown		
3600 MILFORD AVE	4/20/2023	4/20/2023 18:07	No		Lateral	N/A	Unknown		
3500 FRANKFORD AVE	4/20/2023	4/20/2023 19:02	No		Mainline and Lateral	N/A	Unknown		
900 BRIDGEVIEW RD	4/20/2023	4/20/2023 19:12	No		Mainline	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
5300 GIST AVE	4/21/2023	4/21/2023 10:33	No		Mainline	N/A	Unknown		
1800 WEST LOMBARD ST	4/21/2023	4/21/2023 13:11	No		Lateral	N/A	Unknown		
1900 EAST 31ST ST	4/21/2023	4/21/2023 13:15	No		Lateral	N/A	Unknown		
2100 CLIFTON AVE	4/21/2023	4/21/2023 14:03	No		Mainline	N/A	Unknown		
4900 GILRAY DR	4/21/2023	4/21/2023 13:37	No		Lateral	N/A	Unknown		
0 NORTH CALHOUN ST	4/21/2023	4/21/2023 14:38	No		Lateral	N/A	Unknown		
4800 FREDERICK AVE	4/21/2023	4/21/2023 17:32	No		Mainline	N/A	Unknown		
1800 EAST OLIVER ST	4/21/2023	4/21/2023 17:52	No		Mainline	N/A	Unknown		
100 SOUTH CULVER ST	4/21/2023	4/21/2023 19:15	No		Mainline and Lateral	N/A	Unknown		
3200 TANEY RD	4/21/2023	4/21/2023 19:56	No		Lateral	N/A	Unknown		
6000 ROLAND AVE	4/21/2023	4/21/2023 20:23	No		Lateral	N/A	Unknown		
3700 KIMBLE RD	4/21/2023	4/21/2023 21:32	No		Lateral	N/A	Unknown		
3700 MARMON AVE	4/22/2023	4/22/2023 9:29	No		Lateral	N/A	Unknown		
1900 NORTH PULASKI ST	4/22/2023	4/22/2023 11:01	No		Mainline	N/A	Unknown		
4700 EDMONDSON AVE	4/22/2023	4/22/2023 12:25	No		Mainline	N/A	Unknown		
100 WITHERSPOON RD	4/22/2023	4/22/2023 13:42	No		Mainline	N/A	Unknown		
5000 GRINDON AVE	4/22/2023	4/22/2023 13:18	No		Mainline and Lateral	N/A	Unknown		
1900 NORTH ROSEDALE ST	4/22/2023	4/22/2023 15:52	No		Lateral	N/A	Unknown		
2500 BROOKFIELD AVE	4/22/2023	4/22/2023 16:56	Yes		Mainline	N/A	Unknown		
5200 FREDCREST RD	4/22/2023	4/22/2023 19:15	Yes		Lateral	N/A	Unknown		
1900 WINFORD RD	4/22/2023	4/22/2023 19:33	Yes		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
1600 SEXTON ST	4/22/2023	4/22/2023 22:35	Yes		Lateral	N/A	Unknown		
4900 GILRAY DR	4/23/2023	4/23/2023 11:15	Yes		Lateral	N/A	Unknown		
700 SAINT JOHNS RD	4/23/2023	4/23/2023 15:02	Yes		Lateral	N/A	Unknown		
4600 WALTHER AVE	4/23/2023	4/23/2023 16:52	Yes		Lateral	N/A	Unknown		
1300 WALTERS AVE	4/23/2023	4/23/2023 15:25	Yes		Lateral	N/A	Unknown		
5600 BIDDISON AVE	4/23/2023	4/23/2023 17:54	Yes		Lateral	N/A	Unknown		
2700 JEFFERSON ST	4/23/2023	4/23/2023 18:09	Yes		Lateral	N/A	Unknown		
2300 MARYLAND AVE	4/23/2023	4/23/2023 19:13	Yes		Lateral	N/A	Unknown		
5500 BELLEVILLE AVE	4/23/2023	4/23/2023 20:02	Yes		Lateral	N/A	Unknown		
3900 LABYRINTH RD	4/24/2023	4/24/2023 10:59	Yes		Lateral	N/A	Unknown		
4000 BOWERS AVE	4/24/2023	4/24/2023 13:11	Yes		Mainline	N/A	Unknown		
2900 MOSHER ST	4/24/2023	4/24/2023 14:44	Yes		Lateral	N/A	Unknown		
1200 NORTH BROADWAY	4/24/2023	4/24/2023 15:14	Yes		Mainline	N/A	Unknown		
3600 MARY AVE	4/24/2023	4/24/2023 18:31	No		Lateral	N/A	Unknown		
500 SOUTH PORT ST	4/24/2023	4/25/2023 9:56	No		Lateral	N/A	Unknown		
3700 REISTERSTOWN RD	4/25/2023	4/25/2023 10:55	No		Lateral	N/A	Unknown		
1800 WEST PRATT ST	4/25/2023	4/25/2023 12:21	No		Mainline	N/A	Unknown		
3300 ELBERT ST	4/25/2023	4/25/2023 15:44	No		Lateral	N/A	Unknown		
3200 FALLSTAFF RD	4/25/2023	4/25/2023 18:11	No		Lateral	N/A	Unknown		
4000 BOWERS AVE	4/25/2023	4/25/2023 17:36	No		Lateral	N/A	Unknown		
3700 BROOKLYN AVE	4/25/2023	4/25/2023 17:09	No		Lateral	N/A	Unknown		
3100 HILLCREST AVE	4/25/2023	4/25/2023 18:37	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
100 NORTH CURLEY ST	4/25/2023	4/25/2023 18:59	No		Mainline	N/A	Unknown		
1000 WEST PRATT ST	4/25/2023	4/25/2023 20:04	No		Lateral	N/A	Unknown		
1400 NORTH LUZERNE AVE	4/25/2023	4/25/2023 20:39	No		Lateral	N/A	Unknown		
1200 MERIDENE DR	4/25/2023	4/26/2023 9:56	No		Lateral	N/A	Unknown		
1500 NORTHBOURNE RD	4/26/2023	4/26/2023 9:42	No		Lateral	N/A	Unknown		
5800 WINNER AVE	4/26/2023	4/26/2023 10:05	No		Lateral	N/A	Unknown		
4500 HAMILTON AVE	4/26/2023	4/26/2023 11:11	No		Mainline and Lateral	N/A	Unknown		
3200 YOSEMITE AVE	4/26/2023	4/26/2023 12:42	No		Mainline and Lateral	N/A	Unknown		
6600 EASTERN PKWY	4/26/2023	4/26/2023 12:52	No		Lateral	N/A	Unknown		
2700 HARLEM AVE	4/26/2023	4/26/2023 14:23	No		Mainline	N/A	Unknown		
900 DARTMOUTH GLEN WAY	4/26/2023	4/26/2023 14:48	No		Lateral	N/A	Unknown		
3700 BROOKLYN AVE	4/26/2023	4/26/2023 14:50	No		Lateral	N/A	Unknown		
6700 ROBERTS AVE	4/26/2023	4/26/2023 14:27	No		Lateral	N/A	Unknown		
800 SAINT DUNSTANS RD	4/26/2023	4/26/2023 15:09	No		Lateral	N/A	Unknown		
200 NORTH FRANKLINTOWN RD	4/26/2023	4/26/2023 15:07	No		Lateral	N/A	Unknown		
1100 EAST LOMBARD ST	4/26/2023	4/26/2023 16:27	No		Mainline	N/A	Unknown		
1000 MARLAU DR	4/26/2023	4/26/2023 18:01	No		Lateral	N/A	Unknown		
4500 LASALLE AVE	4/26/2023	4/26/2023 18:30	No		Lateral	N/A	Unknown		
1100 KEVIN RD	4/26/2023	4/26/2023 19:00	No		Lateral	N/A	Unknown		
2900 LIMOND PL	4/26/2023	4/26/2023 22:43	No		Lateral	N/A	Unknown		
1000 MARLAU DR	4/26/2023	4/26/2023 19:29	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
300 SOUTH COLLINS AVE	4/26/2023	4/26/2023 21:08	No		Lateral	N/A	Unknown		
1600 STONEWOOD RD	4/26/2023	4/26/2023 22:00	No		Mainline	N/A	Unknown		
2800 WOODBROOK AVE	4/27/2023	4/27/2023 9:17	No		Mainline	N/A	Unknown		
4700 SCHLEY AVE	4/27/2023	4/27/2023 11:20	No		Lateral	N/A	Unknown		
1600 STONEWOOD RD	4/27/2023	4/27/2023 11:32	No		Lateral	N/A	Unknown		
400 KANE ST	4/27/2023	4/27/2023 12:46	No		Lateral	N/A	Unknown		
300 SOUTH COLLINS AVE	4/27/2023	4/27/2023 12:57	No		Mainline and Lateral	N/A	Unknown		
2400 MCCULLOH ST	4/27/2023	4/27/2023 13:20	No		Mainline	N/A	Unknown		
5200 WESLEY AVE	4/27/2023	4/27/2023 13:54	No		Mainline	N/A	Unknown		
300 SAINT DUNSTANS RD	4/27/2023	4/27/2023 15:12	No		Lateral	N/A	Unknown		
400 SOUTH HANOVER ST	4/27/2023	4/27/2023 14:37	No		Mainline	N/A	Unknown		
300 NORTH CALHOUN ST	4/27/2023	4/27/2023 15:21	No		Lateral	N/A	Unknown		
3600 BROOKLYN AVE	4/27/2023	4/27/2023 17:45	No		Mainline	N/A	Unknown		
4300 NORWOOD RD	4/27/2023	4/27/2023 17:10	No		Lateral	N/A	Unknown		
5100 ARDMORE WAY	4/27/2023	4/27/2023 17:18	No		Mainline	N/A	Unknown		
2400 EVERTON RD	4/27/2023	4/27/2023 18:50	No		Mainline	N/A	Unknown		
100 UPMANOR RD	4/27/2023	4/27/2023 16:52	No		Mainline	N/A	Unknown		
5600 READY AVE	4/27/2023	4/27/2023 19:04	No		Mainline and Lateral	N/A	Unknown		
1800 MCCULLOH ST	4/27/2023	4/27/2023 18:23	No		Mainline	N/A	Unknown		
4400 MOUNTVIEW RD	4/27/2023	4/27/2023 20:27	No		Lateral	N/A	Unknown		
2700 HARLEM AVE	4/27/2023	4/27/2023 21:22	No		Mainline	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
3800 BARTWOOD RD	4/27/2023	4/27/2023 20:58	No		Lateral	N/A	Unknown		
400 WESTGATE RD	4/27/2023	4/28/2023 8:35	No		Lateral	N/A	Unknown		
5500 BELAIR RD	4/28/2023	4/28/2023 10:22	No		Mainline	N/A	Unknown		
3500 WEST FRANKLIN ST	4/28/2023	4/28/2023 10:00	No		Mainline and Lateral	N/A	Unknown		
500 SAINT PAUL PL	4/28/2023	4/28/2023 9:38	No		Mainline	N/A	Unknown		
0 EAST PRESTON ST	4/28/2023	4/28/2023 10:29	No		Mainline and Lateral	N/A	Unknown		
5600 ANTHONY AVE	4/28/2023	4/28/2023 11:37	No		Lateral	N/A	Unknown		
3000 ABELL AVE	4/28/2023	4/28/2023 12:33	No		Mainline	N/A	Unknown		
1800 WEST NORTH AVE	4/28/2023	4/28/2023 12:09	No		Lateral	N/A	Unknown		
2000 NORTH DUKELAND ST	4/28/2023	4/28/2023 12:17	No		Lateral	N/A	Unknown		
5300 WABASH AVE	4/28/2023	4/28/2023 12:46	No		Mainline	N/A	Unknown		
2800 EAST STRATHMORE AVE	4/28/2023	4/28/2023 13:56	Yes		Lateral	N/A	Unknown		
3200 FAIT AVE	4/28/2023	4/28/2023 17:03	Yes		Mainline	N/A	Unknown		
5900 AYLESHERE RD	4/28/2023	4/28/2023 16:55	Yes		Lateral	N/A	Unknown		
1800 WEST PRATT ST	4/28/2023	4/28/2023 17:52	Yes		Mainline	N/A	Unknown		
2100 LOUISE AVE	4/28/2023	4/28/2023 18:08	Yes		Lateral	N/A	Unknown		
3300 SHELBURNE RD	4/28/2023	4/28/2023 18:42	Yes		Mainline	N/A	Unknown		
1700 ASHBURTON ST	4/29/2023	4/29/2023 9:26	Yes		Mainline	N/A	Unknown		
4000 LIBERTY HEIGHTS AVE	4/29/2023	4/29/2023 10:39	Yes		Mainline and Lateral	N/A	Unknown		
5600 SAGRA RD	4/29/2023	4/29/2023 13:22	Yes		Lateral	N/A	Unknown		
5800 YORK RD	4/29/2023	4/29/2023 17:09	Yes		Mainline	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
3300 SHELburne RD	4/29/2023	4/29/2023 22:29	Yes		Lateral	N/A	Unknown		
6300 WESTERN RUN DR	4/29/2023	4/29/2023 22:34	Yes		Lateral	N/A	Unknown		
6000 OLD HARFORD RD	4/30/2023	4/30/2023 9:56	Yes		Lateral	N/A	Unknown		
2800 BAUERNWOOD AVE	4/30/2023	4/30/2023 14:10	Yes		Lateral	N/A	Unknown		
2800 BAKER ST	4/30/2023	4/30/2023 18:57	Yes		Mainline	N/A	Unknown		
5500 BENTON HEIGHTS AVE	4/30/2023	4/30/2023 18:03	Yes		Lateral	N/A	Unknown		
5300 SAINT GEORGES AVE	4/30/2023	4/30/2023 17:54	No		Lateral	N/A	Unknown		
3500 WEST FRANKLIN ST	4/30/2023	4/30/2023 19:31	No		Mainline	N/A	Unknown		
600 WASHBURN AVE	4/30/2023	4/30/2023 21:05	No		Lateral	N/A	Unknown		
5600 WINTHROPE AVE	4/30/2023	4/30/2023 21:10	No		Lateral	N/A	Unknown		
1600 STONEWOOD RD	5/1/2023	5/1/2023 9:07	No		Lateral	N/A	Unknown		
1200 CLENDENIN ST	5/1/2023	5/1/2023 9:14	No		Lateral	N/A	Unknown		
800 VINE ST	5/1/2023	5/1/2023 10:14	No		Lateral	N/A	Unknown		
1700 EAST 25TH ST	5/1/2023	5/1/2023 10:45	No		Mainline	N/A	Unknown		
300 EAST 22ND ST	5/1/2023	5/1/2023 11:04	No		Mainline	N/A	Unknown		
300 EDGEVALE RD	5/1/2023	5/1/2023 11:33	No		Lateral	N/A	Unknown		
1900 NORTH FOREST PARK AVE	5/1/2023	5/1/2023 11:43	No		Lateral	N/A	Unknown		
3100 ROYSTON AVE	5/1/2023	5/1/2023 13:06	No		Lateral	N/A	Unknown		
2500 KEYWORTH AVE	5/1/2023	5/1/2023 13:16	No		Mainline	N/A	Unknown		
2500 NORTH ELLAMONT ST	5/1/2023	5/1/2023 13:40	No		Lateral	N/A	Unknown		
1900 WADSWORTH WAY	5/1/2023	5/1/2023 19:11	No		Lateral	N/A	Unknown		
100 MALLOW HILL RD	5/1/2023	5/1/2023 15:12	No		Mainline and Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
1700 DRUID HILL AVE	5/1/2023	5/1/2023 21:01	No		Lateral	N/A	Unknown		
1300 WEST 41ST ST	5/1/2023	5/1/2023 17:01	No		Mainline	N/A	Unknown		
2000 BRYANT AVE	5/1/2023	5/1/2023 16:18	No		Lateral	N/A	Unknown		
2400 ELSINORE AVE	5/1/2023	5/1/2023 16:29	No		Lateral	N/A	Unknown		
3800 RIDGEWOOD AVE	5/1/2023	5/1/2023 16:35	No		Lateral	N/A	Unknown		
300 WHITRIDGE AVE	5/1/2023	5/1/2023 21:04	No		Mainline and Lateral	N/A	Unknown		
3600 CLARINTH RD	5/1/2023	5/1/2023 22:24	No		Lateral	N/A	Unknown		
600 SOUTH MACON ST	5/1/2023	5/1/2023 21:36	No		Mainline	N/A	Unknown		
2800 ELGIN AVE	5/2/2023	5/2/2023 12:37	No		Lateral	N/A	Unknown		
4000 FALLSTAFF RD	5/2/2023	5/2/2023 15:04	No		Lateral	N/A	Unknown		
3300 TIOGA PKWY	5/2/2023	5/2/2023 13:05	No		Mainline	N/A	Unknown		
5300 WABASH AVE	5/2/2023	5/2/2023 15:42	No		Lateral	N/A	Unknown		
1800 WEST PRATT ST	5/2/2023	5/2/2023 17:40	No		Mainline	N/A	Unknown		
100 EAST RANDALL ST	5/2/2023	5/2/2023 18:00	No		Lateral	N/A	Unknown		
6300 MOYER AVE	5/2/2023	5/2/2023 17:12	No		Lateral	N/A	Unknown		
3500 EAST NORTHERN PKWY	5/2/2023	5/2/2023 17:28	No		Lateral	N/A	Unknown		
600 SOUTH MACON ST	5/2/2023	5/2/2023 18:57	No		Mainline	N/A	Unknown		
1400 REDFERN AVE	5/2/2023	5/2/2023 21:16	No		Mainline	N/A	Unknown		
2200 NORTH CALVERT ST	5/3/2023	5/3/2023 11:37	No		Lateral	N/A	Unknown		
2400 PICKWICK RD	5/3/2023	5/3/2023 10:53	No		Lateral	N/A	Unknown		
5800 WINNER AVE	5/3/2023	5/3/2023 11:25	No		Lateral	N/A	Unknown		
800 VINE ST	5/3/2023	5/3/2023 10:50	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
3000 NORTHWAY DR	5/3/2023	5/3/2023 11:01	No		Lateral	N/A	Unknown		
4100 FAIRHAVEN AVE	5/3/2023	5/3/2023 11:33	No		Lateral	N/A	Unknown		
3600 MALDEN AVE	5/3/2023	5/3/2023 12:10	No		Lateral	N/A	Unknown		
2600 PARK HEIGHTS TER	5/3/2023	5/3/2023 11:46	No		Lateral	N/A	Unknown		
6300 1 2 HARFORD RD	5/3/2023	5/3/2023 14:59	No		Mainline	N/A	Unknown		
3000 REISTERSTOWN RD	5/3/2023	5/3/2023 16:42	No		Mainline	N/A	Unknown		
5700 DENWOOD AVE	5/3/2023	5/3/2023 18:59	No		Lateral	N/A	Unknown		
2800 LAWINA RD	5/3/2023	5/3/2023 17:15	No		Mainline and Lateral	N/A	Unknown		
2700 SAINT PAUL ST	5/3/2023	5/3/2023 17:38	No		Mainline	N/A	Unknown		
2400 EDMONDSON AVE	5/3/2023	5/3/2023 20:48	No		Mainline and Lateral	N/A	Unknown		
1400 WINSTON AVE	5/3/2023	5/3/2023 20:20	No		Mainline	N/A	Unknown		
100 WEST LANVALE ST	5/3/2023	5/3/2023 21:57	No		Mainline	N/A	Unknown		
100 EAST MONTGOMERY ST	5/4/2023	5/4/2023 8:43	No		Mainline	N/A	Unknown		
2800 OSWEGO AVE	5/4/2023	5/4/2023 9:29	No		Lateral	N/A	Unknown		
2800 AUCHENTOROLY TER	5/4/2023	5/4/2023 9:03	No		Mainline and Lateral	N/A	Unknown		
500 SOUTH BEECHFIELD AVE	5/4/2023	5/4/2023 9:49	No		Mainline	N/A	Unknown		
4200 NORFOLK AVE	5/4/2023	5/4/2023 10:40	No		Lateral	N/A	Unknown		
4100 CREST HEIGHTS RD	5/4/2023	5/4/2023 11:48	No		Lateral	N/A	Unknown		
5400 CEDONIA AVE	5/4/2023	5/4/2023 10:15	No		Lateral	N/A	Unknown		
3400 ELMLEY AVE	5/4/2023	5/4/2023 12:58	No		Lateral	N/A	Unknown		
3800 KESWICK RD	5/4/2023	5/4/2023 17:10	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
2800 MAYFIELD AVE	5/4/2023	5/4/2023 12:48	No		Lateral	N/A	Unknown		
2700 UHLER AVE	5/4/2023	5/4/2023 14:50	No		Mainline	N/A	Unknown		
4200 NORFOLK AVE	5/4/2023	5/4/2023 16:18	No		Lateral	N/A	Unknown		
5800 RUBIN AVE	5/4/2023	5/4/2023 15:35	No		Lateral	N/A	Unknown		
1800 RUXTON AVE	5/4/2023	5/4/2023 15:09	No		Lateral	N/A	Unknown		
4400 PEN LUCY RD	5/4/2023	5/4/2023 19:43	No		Lateral	N/A	Unknown		
1500 LOCHWOOD RD	5/4/2023	5/4/2023 21:10	No		Lateral	N/A	Unknown		
2700 NORTH LONGWOOD ST	5/5/2023	5/5/2023 10:27	No		Lateral	N/A	Unknown		
300 EAST LORRAINE AVE	5/5/2023	5/5/2023 11:30	No		Lateral	N/A	Unknown		
4700 EAST LN	5/5/2023	5/5/2023 13:36	No		Mainline	N/A	Unknown		
800 RADNOR AVE	5/5/2023	5/5/2023 11:48	No		Lateral	N/A	Unknown		
5700 KENMORE RD	5/5/2023	5/5/2023 13:12	No		Mainline and Lateral	N/A	Unknown		
4400 PEN LUCY RD	5/5/2023	5/5/2023 12:58	No		Lateral	N/A	Unknown		
1000 ELLICOTT DR	5/5/2023	5/5/2023 13:27	No		Lateral	N/A	Unknown		
2500 PARKTRAIL RD	5/5/2023	5/5/2023 13:17	No		Lateral	N/A	Unknown		
4400 MAINE AVE	5/5/2023	5/5/2023 14:28	No		Lateral	N/A	Unknown		
300 EAST 22ND ST	5/5/2023	5/5/2023 15:05	No		Lateral	N/A	Unknown		
1200 KEVIN RD	5/5/2023	5/5/2023 17:48	No		Lateral	N/A	Unknown		
2500 NORTH CHARLES ST	5/5/2023	5/5/2023 19:17	No		Mainline	N/A	Unknown		
900 GORSUCH AVE	5/5/2023	5/5/2023 18:06	No		Lateral	N/A	Unknown		
400 SOUTH ANN ST	5/5/2023	5/5/2023 19:12	No		Mainline	N/A	Unknown		
3700 GWYNNNS FALLS PKWY	5/6/2023	5/6/2023 8:31	No		Mainline	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
3700 BONVIEW AVE	5/6/2023	5/6/2023 14:25	No		Lateral	N/A	Unknown		
2800 BAKER ST	5/6/2023	5/6/2023 14:12	No		Lateral	N/A	Unknown		
3300 HUDSON ST	5/6/2023	5/6/2023 15:37	No		Lateral	N/A	Unknown		
1100 WICKLOW RD	5/6/2023	5/6/2023 18:30	No		Lateral	N/A	Unknown		
3700 WEST COLD SPRING LN	5/6/2023	5/6/2023 20:14	No		Lateral	N/A	Unknown		
3100 BELMONT AVE	5/6/2023	5/6/2023 22:03	No		Lateral	N/A	Unknown		
3400 PINKNEY RD	5/7/2023	5/7/2023 16:12	No		Mainline	N/A	Unknown		
3600 MALDEN AVE	5/7/2023	5/7/2023 21:38	No		Lateral	N/A	Unknown		
300 NORTHWAY	5/8/2023	5/8/2023 8:45	No		Lateral	N/A	Unknown		
3400 PINKNEY RD	5/8/2023	5/8/2023 9:53	No		Lateral	N/A	Unknown		
2300 ALLENDALE RD	5/8/2023	5/8/2023 10:51	No		Mainline	N/A	Unknown		
3700 LYNDAL AVE	5/8/2023	5/8/2023 9:32	No		Lateral	N/A	Unknown		
1100 ROLAND HEIGHTS AVE	5/8/2023	5/8/2023 11:41	No		Lateral	N/A	Unknown		
5800 WINNER AVE	5/8/2023	5/8/2023 17:10	No		Lateral	N/A	Unknown		
4000 BROOKHILL RD	5/8/2023	5/8/2023 18:00	No		Lateral	N/A	Unknown		
3700 GWYNNS FALLS PKWY	5/8/2023	5/8/2023 19:05	No		Lateral	N/A	Unknown		
1400 RACE ST	5/8/2023	5/8/2023 20:31	No		Lateral	N/A	Unknown		
3200 YOSEMITE AVE	5/8/2023	5/9/2023 10:24	No		Lateral	N/A	Unknown		
900 STOLL ST	5/9/2023	5/9/2023 8:50	No		Lateral	N/A	Unknown		
3500 DUDLEY AVE	5/9/2023	5/9/2023 10:10	No		Lateral	N/A	Unknown		
3900 FALLS RD	5/9/2023	5/9/2023 10:52	No		Lateral	N/A	Unknown		
200 TAPLOW RD	5/9/2023	5/9/2023 11:05	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
800 EAST JEFFREY ST	5/9/2023	5/9/2023 11:30	No		Mainline	N/A	Unknown		
1200 EAST BELVEDERE AVE	5/9/2023	5/9/2023 15:38	No		Lateral	N/A	Unknown		
3700 CALLAWAY AVE	5/9/2023	5/9/2023 13:19	No		Mainline	N/A	Unknown		
4500 WAKEFIELD RD	5/9/2023	5/9/2023 12:42	No		Lateral	N/A	Unknown		
500 SOUTH GLOVER ST	5/9/2023	5/9/2023 13:15	No		Mainline	N/A	Unknown		
5500 SILVERBELL RD	5/9/2023	5/9/2023 17:44	No		Mainline	N/A	Unknown		
6900 REISTERSTOWN RD	5/9/2023	5/9/2023 19:09	No		Mainline	N/A	Unknown		
4500 KESWICK RD	5/9/2023	5/9/2023 19:43	No		Mainline and Lateral	N/A	Unknown		
2900 KIRK AVE	5/9/2023	5/9/2023 17:35	No		Mainline and Lateral	N/A	Unknown		
1700 MORELAND AVE	5/9/2023	5/9/2023 18:16	No		Mainline	N/A	Unknown		
4800 BOWLAND AVE	5/9/2023	5/9/2023 18:57	No		Mainline and Lateral	N/A	Unknown		
900 NORTH ARLINGTON AVE	5/9/2023	5/9/2023 21:19	No		Lateral	N/A	Unknown		
300 ELRINO ST	5/9/2023	5/9/2023 20:47	No		Lateral	N/A	Unknown		
4000 GRANITE AVE	5/9/2023	5/9/2023 21:22	No		Mainline	N/A	Unknown		
6200 FALKIRK RD	5/9/2023	5/9/2023 21:48	No		Lateral	N/A	Unknown		
300 BROADMOOR RD	5/9/2023	5/9/2023 22:11	No		Lateral	N/A	Unknown		
200 GOODWOOD GDNS	5/9/2023	5/9/2023 22:39	No		Mainline	N/A	Unknown		
5900 PLUMER AVE	5/9/2023	5/10/2023 9:05	No		Mainline	N/A	Unknown		
5600 GOVANE AVE	5/9/2023	5/10/2023 9:48	No		Lateral	N/A	Unknown		
5900 PLUMER AVE	5/10/2023	5/10/2023 9:05	No		Mainline	N/A	Unknown		
5900 PLUMER AVE	5/10/2023	5/10/2023 9:28	No		Mainline	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
7200 PARK HEIGHTS AVE	5/10/2023	5/10/2023 11:18	No		Lateral	N/A	Unknown		
4100 FAIRFAX RD	5/10/2023	5/10/2023 15:09	No		Mainline and Lateral	N/A	Unknown		
2600 WEST FAIRMOUNT AVE	5/10/2023	5/10/2023 14:15	No		Mainline	N/A	Unknown		
200 SOUTH PRESIDENT ST	5/10/2023	5/10/2023 14:42	No		Mainline and Lateral	N/A	Unknown		
3500 NORTHWAY DR	5/10/2023	5/10/2023 17:10	No		Mainline and Lateral	N/A	Unknown		
600 GIBSON RD	5/10/2023	5/10/2023 18:37	No		Lateral	N/A	Unknown		
5900 PLUMER AVE	5/10/2023	5/10/2023 18:07	No		Mainline	N/A	Unknown		
1600 DRUID HILL AVE	5/10/2023	5/10/2023 17:18	No		Lateral	N/A	Unknown		
1800 MORELAND AVE	5/10/2023	5/10/2023 18:02	No		Mainline	N/A	Unknown		
5900 PLUMER AVE	5/10/2023	5/10/2023 18:34	No		Mainline	N/A	Unknown		
2800 ELGIN AVE	5/10/2023	5/10/2023 19:13	No		Lateral	N/A	Unknown		
200 PRESIDENT ST	5/10/2023	5/10/2023 20:17	No		Mainline	N/A	Unknown		
400 CEDARCROFT RD	5/10/2023	5/10/2023 21:50	No		Lateral	N/A	Unknown		
2500 WEST BALTIMORE ST	5/11/2023	5/11/2023 8:55	No		Mainline	N/A	Unknown		
6900 REISTERSTOWN RD	5/11/2023	5/11/2023 9:38	No		Mainline	N/A	Unknown		
4300 NORWOOD RD	5/11/2023	5/11/2023 9:52	No		Lateral	N/A	Unknown		
4500 KESWICK RD	5/11/2023	5/11/2023 10:21	No		Lateral	N/A	Unknown		
2800 WEST LANVALE ST	5/11/2023	5/11/2023 10:44	No		Lateral	N/A	Unknown		
2300 ARUNAH AVE	5/11/2023	5/11/2023 10:30	No		Mainline	N/A	Unknown		
1100 STEELTON AVE	5/11/2023	5/11/2023 11:19	No		Mainline	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
1300 WARD ST	5/11/2023	5/11/2023 11:22	No		Mainline and Lateral	N/A	Unknown		
5300 SAINT GEORGES AVE	5/11/2023	5/11/2023 12:09	No		Lateral	N/A	Unknown		
3700 MOHAWK AVE	5/11/2023	5/11/2023 13:13	No		Lateral	N/A	Unknown		
4100 CRANSTON AVE	5/11/2023	5/11/2023 14:05	No		Mainline	N/A	Unknown		
5300 WABASH AVE	5/11/2023	5/11/2023 12:53	No		Lateral	N/A	Unknown		
3900 GREENWAY	5/11/2023	5/11/2023 17:34	No		Mainline	N/A	Unknown		
100 EAST MONTGOMERY ST	5/11/2023	5/11/2023 16:47	No		Mainline	N/A	Unknown		
0 UPMANOR RD	5/11/2023	5/11/2023 18:04	No		Lateral	N/A	Unknown		
5700 DENWOOD AVE	5/11/2023	5/11/2023 18:48	No		Mainline and Lateral	N/A	Unknown		
100 NORTH FRONT ST	5/11/2023	5/11/2023 20:11	No		Mainline	N/A	Unknown		
1400 SOUTH CAREY ST	5/11/2023	5/11/2023 20:20	No		Lateral	N/A	Unknown		
400 IMLA ST	5/12/2023	5/12/2023 11:09	No		Lateral	N/A	Unknown		
1700 MORELAND AVE	5/12/2023	5/12/2023 9:55	No		Lateral	N/A	Unknown		
1300 PARK AVE	5/12/2023	5/12/2023 10:08	No		Lateral	N/A	Unknown		
1200 DELBERT AVE	5/12/2023	5/12/2023 11:52	No		Mainline	N/A	Unknown		
1000 WEDGEWOOD RD	5/12/2023	5/12/2023 12:51	No		Lateral	N/A	Unknown		
1300 NORTH BROADWAY	5/12/2023	5/12/2023 12:45	No		Mainline	N/A	Unknown		
2000 NORTH FULTON AVE	5/12/2023	5/12/2023 12:26	No		Lateral	N/A	Unknown		
4200 MORTIMER AVE	5/12/2023	5/12/2023 14:17	No		Mainline	N/A	Unknown		
3100 BELMONT AVE	5/12/2023	5/12/2023 14:39	No		Mainline	N/A	Unknown		
4000 GRANITE AVE	5/12/2023	5/12/2023 18:49	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
5900 CARTER AVE	5/12/2023	5/12/2023 19:04	No		Lateral	N/A	Unknown		
1000 NORTH CENTRAL AVE	5/12/2023	5/12/2023 20:51	No		Mainline	N/A	Unknown		
2300 ROGENE DR	5/12/2023	5/12/2023 19:36	No		Lateral	N/A	Unknown		
1500 NORTHGATE RD	5/12/2023	5/12/2023 20:26	No		Mainline and Lateral	N/A	Unknown		
0 STRATFORD RD	5/12/2023	5/12/2023 20:46	No		Lateral	N/A	Unknown		
3900 HILLSDALE RD	5/12/2023	5/12/2023 21:23	No		Lateral	N/A	Unknown		
4600 KAVON AVE	5/13/2023	5/13/2023 9:09	No		Lateral	N/A	Unknown		
3700 YOLANDO RD	5/13/2023	5/13/2023 9:51	No		Lateral	N/A	Unknown		
2900 MOSHER ST	5/13/2023	5/13/2023 11:22	No		Mainline	N/A	Unknown		
1700 DRUID HILL AVE	5/13/2023	5/13/2023 13:20	No		Lateral	N/A	Unknown		
2400 LINDEN AVE	5/13/2023	5/13/2023 13:19	No		Mainline and Lateral	N/A	Unknown		
0 SAINT GEORGES RD	5/13/2023	5/13/2023 13:41	No		Lateral	N/A	Unknown		
300 RADNOR RD	5/13/2023	5/13/2023 13:15	No		Lateral	N/A	Unknown		
3600 COOLIDGE AVE	5/13/2023	5/13/2023 17:19	No		Lateral	N/A	Unknown		
700 SAINT JOHNS RD	5/13/2023	5/13/2023 19:58	No		Lateral	N/A	Unknown		
0 SOUTH COLLINS AVE	5/13/2023	5/13/2023 20:49	No		Lateral	N/A	Unknown		
100 UPNOR RD	5/13/2023	5/13/2023 20:46	No		Lateral	N/A	Unknown		
500 SOUTH GLOVER ST	5/13/2023	5/13/2023 20:52	No		Mainline and Lateral	N/A	Unknown		
2300 ASHBURTON ST	5/13/2023	5/13/2023 21:18	No		Mainline	N/A	Unknown		
2300 GARRETT AVE	5/14/2023	5/14/2023 10:36	No		Lateral	N/A	Unknown		
1200 WICKLOW RD	5/14/2023	5/14/2023 9:41	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
3200 CLARKS LN	5/14/2023	5/14/2023 10:30	No		Mainline	N/A	Unknown		
500 NORTH CHESTER ST	5/14/2023	5/14/2023 12:48	No		Lateral	N/A	Unknown		
2900 KESWICK RD	5/14/2023	5/14/2023 13:48	No		Lateral	N/A	Unknown		
300 MARYDELL RD	5/14/2023	5/14/2023 17:44	No		Lateral	N/A	Unknown		
300 CEDARCROFT RD	5/14/2023	5/14/2023 19:01	No		Lateral	N/A	Unknown		
3600 WEST BAY AVE	5/15/2023	5/15/2023 10:28	No		Mainline	N/A	Unknown		
1700 PENNSYLVANIA AVE	5/15/2023	5/15/2023 11:47	No		Mainline	N/A	Unknown		
2900 KESWICK RD	5/15/2023	5/15/2023 12:07	No		Mainline	N/A	Unknown		
5700 DENWOOD AVE	5/15/2023	5/15/2023 12:00	No		Mainline and Lateral	N/A	Unknown		
4000 FREDERICK AVE	5/15/2023	5/15/2023 13:43	No		Mainline	N/A	Unknown		
5500 DAYWALT AVE	5/15/2023	5/15/2023 13:57	No		Mainline	N/A	Unknown		
5600 LIBERTY HEIGHTS AVE	5/15/2023	5/15/2023 14:04	No		Mainline	N/A	Unknown		
4100 FAIRFAX RD	5/15/2023	5/15/2023 14:24	No		Mainline and Lateral	N/A	Unknown		
1200 KEVIN RD	5/15/2023	5/15/2023 17:42	No		Lateral	N/A	Unknown		
5200 CEDGATE RD	5/15/2023	5/15/2023 17:52	No		Lateral	N/A	Unknown		
200 MALLOW HILL RD	5/15/2023	5/15/2023 20:03	No		Lateral	N/A	Unknown		
2700 INGLEWOOD AVE	5/15/2023	5/15/2023 20:59	No		Lateral	N/A	Unknown		
2200 PENROSE AVE	5/15/2023	5/15/2023 21:11	No		Mainline	N/A	Unknown		
1400 KENHILL AVE	5/16/2023	5/16/2023 12:22	No		Mainline	N/A	Unknown		
6300 WESTERN RUN DR	5/16/2023	5/16/2023 13:07	No		Lateral	N/A	Unknown		
2500 MOSHER ST	5/16/2023	5/16/2023 15:25	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
5700 DENWOOD AVE	5/16/2023	5/16/2023 14:30	No		Mainline	N/A	Unknown		
1500 NORTH PULASKI ST	5/16/2023	5/16/2023 17:02	No		Mainline	N/A	Unknown		
1900 WADSWORTH WAY	5/16/2023	5/16/2023 17:19	No		Lateral	N/A	Unknown		
700 BENNINGHAUS RD	5/16/2023	5/16/2023 17:44	No		Mainline	N/A	Unknown		
4100 MOUNTWOOD RD	5/17/2023	5/17/2023 9:30	No		Lateral	N/A	Unknown		
5000 THE ALAMEDA	5/17/2023	5/17/2023 11:15	No		Lateral	N/A	Unknown		
4000 GROVELAND AVE	5/17/2023	5/17/2023 10:34	No		Lateral	N/A	Unknown		
600 DENISON ST	5/17/2023	5/17/2023 12:42	No		Mainline	N/A	Unknown		
0 NORTH SMALLWOOD ST	5/17/2023	5/17/2023 13:21	No		Mainline	N/A	Unknown		
2500 MOSHER ST	5/17/2023	5/17/2023 16:55	No		Lateral	N/A	Unknown		
300 WOODLAWN RD	5/17/2023	5/17/2023 17:40	No		Mainline	N/A	Unknown		
3000 EAST NORTHERN PKWY	5/17/2023	5/17/2023 18:22	No		Mainline	N/A	Unknown		
3700 DELVERNE RD	5/17/2023	5/17/2023 18:33	No		Lateral	N/A	Unknown		
4300 WENDOVER RD	5/17/2023	5/17/2023 18:50	No		Lateral	N/A	Unknown		
600 BRISBANE RD	5/17/2023	5/17/2023 19:11	No		Mainline and Lateral	N/A	Unknown		
1500 EAST MADISON ST	5/17/2023	5/17/2023 22:02	No		Lateral	N/A	Unknown		
100 TAPLOW RD	5/17/2023	5/17/2023 22:50	No		Lateral	N/A	Unknown		
1600 NORTH DUKELAND ST	5/18/2023	5/18/2023 8:48	No		Mainline	N/A	Unknown		
4000 ECHODALE AVE	5/18/2023	5/18/2023 12:42	No		Lateral	N/A	Unknown		
600 SOUTH HANOVER ST	5/18/2023	5/18/2023 14:02	No		Mainline	N/A	Unknown		
200 MALLOW HILL RD	5/18/2023	5/18/2023 14:44	No		Lateral	N/A	Unknown		
0 SOUTH CURLEY ST	5/18/2023	5/18/2023 14:13	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
3300 MORAVIA RD	5/18/2023	5/18/2023 17:44	No		Lateral	N/A	Unknown		
4200 WOODLEA AVE	5/18/2023	5/18/2023 17:34	No		Mainline	N/A	Unknown		
1000 DARLEY AVE	5/18/2023	5/18/2023 19:18	No		Mainline	N/A	Unknown		
4100 BELLE AVE	5/19/2023	5/19/2023 8:55	No		Mainline	N/A	Unknown		
3900 PARK HEIGHTS AVE	5/19/2023	5/19/2023 8:35	No		Mainline and Lateral	N/A	Unknown		
1300 ASHLAND AVE	5/19/2023	5/19/2023 9:58	No		Lateral	N/A	Unknown		
300 JOPLIN ST	5/19/2023	5/19/2023 13:45	No		Mainline	N/A	Unknown		
3800 FERNDALE AVE	5/19/2023	5/19/2023 11:57	No		Lateral	N/A	Unknown		
3300 ALTO RD	5/19/2023	5/19/2023 18:14	No		Mainline	N/A	Unknown		
2200 MOUNT HOLLY ST	5/19/2023	5/19/2023 19:06	No		Mainline and Lateral	N/A	Unknown		
3300 TANEY RD	5/19/2023	5/19/2023 14:58	No		Lateral	N/A	Unknown		
100 SOUTH LOUDON AVE	5/19/2023	5/19/2023 14:49	No		Lateral	N/A	Unknown		
3400 GRANTLEY RD	5/19/2023	5/19/2023 15:32	No		Lateral	N/A	Unknown		
5900 WINNER AVE	5/19/2023	5/19/2023 17:26	No		Lateral	N/A	Unknown		
2800 OAKFORD AVE	5/19/2023	5/19/2023 17:50	No		Mainline	N/A	Unknown		
3000 OVERLAND AVE	5/19/2023	5/19/2023 20:08	No		Mainline	N/A	Unknown		
3500 DOLFIELD AVE	5/19/2023	5/19/2023 19:43	No		Lateral	N/A	Unknown		
300 JOPLIN ST	5/19/2023	5/19/2023 19:28	No		Mainline	N/A	Unknown		
600 SOUTH PACA ST	5/20/2023	5/20/2023 10:15	No		Mainline	N/A	Unknown		
6900 GLENHEIGHTS RD	5/20/2023	5/20/2023 11:12	No		Mainline	N/A	Unknown		
2300 FREDERICK AVE	5/20/2023	5/20/2023 16:46	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
5300 SAINT GEORGES AVE	5/20/2023	5/20/2023 17:02	No		Lateral	N/A	Unknown		
1100 WICKLOW RD	5/20/2023	5/20/2023 17:15	No		Lateral	N/A	Unknown		
1200 MERIDENE DR	5/20/2023	5/20/2023 17:25	No		Lateral	N/A	Unknown		
6900 MOYER AVE	5/20/2023	5/20/2023 17:27	No		Mainline	N/A	Unknown		
2300 MARYLAND AVE	5/20/2023	5/20/2023 21:30	No		Lateral	N/A	Unknown		
2800 MAYFIELD AVE	5/21/2023	5/21/2023 9:43	No		Lateral	N/A	Unknown		
3300 LIBERTY HEIGHTS AVE	5/21/2023	5/21/2023 10:26	No		Lateral	N/A	Unknown		
1300 GITTINGS AVE	5/21/2023	5/21/2023 12:08	No		Lateral	N/A	Unknown		
3500 SHANNON DR	5/21/2023	5/21/2023 14:44	No		Lateral	N/A	Unknown		
1100 HOLLEN RD	5/21/2023	5/21/2023 15:25	No		Lateral	N/A	Unknown		
5300 SAINT GEORGES AVE	5/21/2023	5/21/2023 17:02	No		Mainline and Lateral	N/A	Unknown		
3200 CLARKS LN	5/21/2023	5/21/2023 19:06	No		Mainline	N/A	Unknown		
3000 OVERLAND AVE	5/21/2023	5/21/2023 21:18	No		Mainline	N/A	Unknown		
3200 CLARKS LN	5/21/2023	5/21/2023 20:48	No		Mainline	N/A	Unknown		
2500 ARUNAH AVE	5/22/2023	5/22/2023 13:04	No		Lateral	N/A	Unknown		
5800 LEITH WALK	5/22/2023	5/22/2023 9:52	No		Lateral	N/A	Unknown		
5500 WAYNE AVE	5/22/2023	5/22/2023 14:33	No		Lateral	N/A	Unknown		
1800 EAST BELVEDERE AVE	5/22/2023	5/22/2023 11:49	No		Lateral	N/A	Unknown		
2500 OSWEGO AVE	5/22/2023	5/22/2023 14:07	No		Mainline and Lateral	N/A	Unknown		
2700 SAINT PAUL ST	5/22/2023	5/22/2023 13:38	No		Lateral	N/A	Unknown		
2400 NORTH CALVERT ST	5/22/2023	5/22/2023 14:10	No		Mainline	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
2100 HOMEWOOD AVE	5/22/2023	5/22/2023 14:23	No		Lateral	N/A	Unknown		
700 HIGHWOOD DR	5/22/2023	5/22/2023 18:00	No		Lateral	N/A	Unknown		
3000 BARCLAY ST	5/22/2023	5/22/2023 20:44	No		Lateral	N/A	Unknown		
1000 SAINT PAUL ST	5/23/2023	5/23/2023 11:25	No		Mainline	N/A	Unknown		
3300 AVONDALE AVE	5/23/2023	5/23/2023 11:21	No		Mainline and Lateral	N/A	Unknown		
3500 DOLFIELD AVE	5/23/2023	5/23/2023 11:54	No		Mainline	N/A	Unknown		
6600 EASTERN PKWY	5/23/2023	5/23/2023 12:53	No		Lateral	N/A	Unknown		
1000 MARLAU DR	5/23/2023	5/23/2023 15:19	No		Lateral	N/A	Unknown		
3800 BAYONNE AVE	5/23/2023	5/23/2023 13:32	No		Lateral	N/A	Unknown		
1900 MADISON AVE	5/23/2023	5/23/2023 13:15	No		Lateral	N/A	Unknown		
3800 BARTWOOD RD	5/23/2023	5/23/2023 13:55	No		Lateral	N/A	Unknown		
6400 BELAIR RD	5/23/2023	5/23/2023 17:45	No		Mainline	N/A	Unknown		
2300 AVALON AVE	5/23/2023	5/23/2023 16:30	No		Mainline	N/A	Unknown		
5300 WABASH AVE	5/23/2023	5/23/2023 16:55	No		Lateral	N/A	Unknown		
400 WEST COLD SPRING LN	5/23/2023	5/23/2023 17:23	No		Lateral	N/A	Unknown		
300 CEDARCROFT RD	5/23/2023	5/23/2023 20:32	No		Lateral	N/A	Unknown		
5500 BUCKNELL RD	5/23/2023	5/23/2023 20:09	No		Lateral	N/A	Unknown		
3000 NORTHWAY DR	5/23/2023	5/23/2023 20:03	No		Lateral	N/A	Unknown		
1200 EAST BELVEDERE AVE	5/23/2023	5/23/2023 22:30	No		Lateral	N/A	Unknown		
2800 ELGIN AVE	5/24/2023	5/24/2023 10:59	No		Lateral	N/A	Unknown		
3600 ROSEDALE RD	5/24/2023	5/24/2023 11:13	No		Lateral	N/A	Unknown		
800 EAST PRESTON ST	5/24/2023	5/24/2023 11:32	No		Mainline	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
500 NORTH MONTFORD AVE	5/24/2023	5/24/2023 14:49	No		Mainline	N/A	Unknown		
2300 CALLOW AVE	5/24/2023	5/24/2023 16:43	No		Mainline and Lateral	N/A	Unknown		
2300 ARUNAH AVE	5/24/2023	5/24/2023 17:00	No		Mainline	N/A	Unknown		
1300 NORTH MONROE ST	5/25/2023	5/25/2023 11:50	No		Mainline and Lateral	N/A	Unknown		
6200 PINEHURST RD	5/25/2023	5/25/2023 10:49	No		Lateral	N/A	Unknown		
2800 RAYNER AVE	5/25/2023	5/25/2023 12:18	No		Lateral	N/A	Unknown		
400 KENNETH SQ	5/25/2023	5/25/2023 13:59	No		Mainline	N/A	Unknown		
1500 NORTH MONROE ST	5/25/2023	5/25/2023 17:05	No		Mainline	N/A	Unknown		
0 SOUTH CAREY ST	5/25/2023	5/25/2023 17:13	No		Mainline	N/A	Unknown		
800 EAST 35TH ST	5/25/2023	5/25/2023 17:04	No		Mainline	N/A	Unknown		
4900 BOWLAND AVE	5/25/2023	5/25/2023 19:58	No		Lateral	N/A	Unknown		
5500 ELDERON AVE	5/25/2023	5/25/2023 21:16	No		Lateral	N/A	Unknown		
1500 BURNWOOD RD	5/25/2023	5/25/2023 22:03	No		Lateral	N/A	Unknown		
1300 WEST 41ST ST	5/26/2023	5/26/2023 9:41	No		Lateral	N/A	Unknown		
0 ELMHURST RD	5/26/2023	5/26/2023 11:27	No		Mainline	N/A	Unknown		
2100 HOLLINS ST	5/26/2023	5/26/2023 10:52	No		Mainline	N/A	Unknown		
300 EAST 22ND ST	5/26/2023	5/26/2023 14:07	No		Mainline and Lateral	N/A	Unknown		
3900 BOARMAN AVE	5/26/2023	5/26/2023 10:51	No		Mainline and Lateral	N/A	Unknown		
2700 SILVER HILL AVE	5/26/2023	5/26/2023 13:38	No		Lateral	N/A	Unknown		
2800 EDMONDSON AVE	5/26/2023	5/26/2023 17:24	No		Mainline	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
2800 MAYFIELD AVE	5/26/2023	5/26/2023 17:01	No		Lateral	N/A	Unknown		
3500 FAIRFIELD RD	5/26/2023	5/26/2023 18:28	No		Mainline	N/A	Unknown		
2200 CECIL AVE	5/26/2023	5/26/2023 16:41	No		Mainline	N/A	Unknown		
2200 CHESTERFIELD AVE	5/26/2023	5/26/2023 19:01	No		Lateral	N/A	Unknown		
2400 NORTH ELLAMONT ST	5/26/2023	5/26/2023 19:22	No		Lateral	N/A	Unknown		
800 EAST LAKE AVE	5/26/2023	5/26/2023 19:54	No		Mainline and Lateral	N/A	Unknown		
100 NORTH FREMONT AVE	5/26/2023	5/26/2023 21:47	No		Lateral	N/A	Unknown		
3900 KESWICK RD	5/26/2023	5/26/2023 22:05	No		Lateral	N/A	Unknown		
4600 BELVIEU AVE	5/27/2023	5/27/2023 8:53	No		Lateral	N/A	Unknown		
4300 NORFOLK AVE	5/27/2023	5/27/2023 10:26	No		Mainline	N/A	Unknown		
1800 DRUID HILL AVE	5/27/2023	5/27/2023 10:54	No		Mainline	N/A	Unknown		
1100 NORTH GILMOR ST	5/27/2023	5/27/2023 11:10	No		Lateral	N/A	Unknown		
3800 MIDHEIGHTS RD	5/27/2023	5/27/2023 19:25	No		Lateral	N/A	Unknown		
4000 BROOKHILL RD	5/27/2023	5/27/2023 19:30	No		Lateral	N/A	Unknown		
100 SOUTH CULVER ST	5/27/2023	5/28/2023 10:25	No		Lateral	N/A	Unknown		
6100 GIST AVE	5/28/2023	5/28/2023 10:04	No		Lateral	N/A	Unknown		
6100 RUSK AVE	5/28/2023	5/28/2023 9:19	No		Mainline	N/A	Unknown		
200 GOODWOOD GDNS	5/28/2023	5/28/2023 8:41	No		Mainline	N/A	Unknown		
1200 EAST BELVEDERE AVE	5/28/2023	5/28/2023 15:21	No		Lateral	N/A	Unknown		
5400 BUCKNELL RD	5/28/2023	5/28/2023 14:41	No		Lateral	N/A	Unknown		
5600 GOVANE AVE	5/28/2023	5/28/2023 20:34	No		Lateral	N/A	Unknown		
2300 GARRETT AVE	5/29/2023	5/29/2023 8:47	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
3300 WOODSTOCK AVE	5/29/2023	5/29/2023 11:18	No		Lateral	N/A	Unknown		
1200 SOUTHVIEW RD	5/29/2023	5/29/2023 11:04	No		Lateral	N/A	Unknown		
3600 WABASH AVE	5/29/2023	5/29/2023 11:46	No		Mainline and Lateral	N/A	Unknown		
500 QUAIL ST	5/29/2023	5/29/2023 12:07	No		Lateral	N/A	Unknown		
3200 PIEDMONT AVE	5/29/2023	5/29/2023 14:42	No		Mainline and Lateral	N/A	Unknown		
2200 ROSLYN AVE	5/29/2023	5/29/2023 17:53	No		Lateral	N/A	Unknown		
3100 FERNDALE AVE	5/29/2023	5/29/2023 20:19	No		Lateral	N/A	Unknown		
3700 CLARENELL RD	5/30/2023	5/30/2023 9:50	No		Lateral	N/A	Unknown		
400 WOODFORD RD	5/30/2023	5/30/2023 11:09	No		Lateral	N/A	Unknown		
3100 NORTHWAY DR	5/30/2023	5/30/2023 10:34	No		Lateral	N/A	Unknown		
2700 JEFFERSON ST	5/30/2023	5/30/2023 15:04	No		Mainline	N/A	Unknown		
4000 FALLSTAFF RD	5/30/2023	5/30/2023 12:52	No		Lateral	N/A	Unknown		
3400 PINKNEY RD	5/30/2023	5/30/2023 13:20	No		Lateral	N/A	Unknown		
1200 CEDARCROFT RD	5/30/2023	5/30/2023 13:33	No		Lateral	N/A	Unknown		
1500 KENHILL AVE	5/30/2023	5/30/2023 19:50	No		Lateral	N/A	Unknown		
500 DENISON ST	5/30/2023	5/30/2023 18:13	No		Mainline and Lateral	N/A	Unknown		
3700 BONVIEW AVE	5/30/2023	5/30/2023 20:11	No		Mainline and Lateral	N/A	Unknown		
4000 GARRISON BLVD	5/30/2023	5/30/2023 21:03	No		Mainline	N/A	Unknown		
5700 ADLEIGH AVE	5/31/2023	5/31/2023 12:10	No		Lateral	N/A	Unknown		
6000 EASTERN PKWY	5/31/2023	5/31/2023 11:50	No		Mainline and Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
1200 EAST LANVALE ST	5/31/2023	5/31/2023 15:46	No		Mainline	N/A	Unknown		
600 EAST 31ST ST	5/31/2023	5/31/2023 17:15	No		Lateral	N/A	Unknown		
0 UPMANOR RD	5/31/2023	5/31/2023 18:05	No		Mainline	N/A	Unknown		
3300 BRENDAN AVE	5/31/2023	5/31/2023 17:48	No		Mainline	N/A	Unknown		
1800 EAST 33RD ST	5/31/2023	5/31/2023 17:52	No		Lateral	N/A	Unknown		
5300 SAINT ALBANS WAY	5/31/2023	5/31/2023 20:19	No		Lateral	N/A	Unknown		
3400 OLYMPIA AVE	6/1/2023	6/1/2023 11:22	No		Mainline and Lateral	N/A	Unknown		
6100 BENHURST RD	6/1/2023	6/1/2023 11:45	No		Mainline and Lateral	N/A	Unknown		
1000 EAST BELVEDERE AVE	6/1/2023	6/1/2023 10:31	No		Lateral	N/A	Unknown		
1600 NORTHBOURNE RD	6/1/2023	6/1/2023 15:05	No		Lateral	N/A	Unknown		
200 NORTH MONTFORD AVE	6/1/2023	6/1/2023 14:26	No		Mainline	N/A	Unknown		
3000 ELGIN AVE	6/1/2023	6/1/2023 14:34	No		Mainline	N/A	Unknown		
3100 TYNDALE AVE	6/1/2023	6/1/2023 14:31	No		Lateral	N/A	Unknown		
2900 EAST MADISON ST	6/1/2023	6/1/2023 19:37	No		Mainline	N/A	Unknown		
3500 CEDARDALE RD	6/1/2023	6/1/2023 21:51	No		Lateral	N/A	Unknown		
6600 HILLTOP AVE	6/1/2023	6/1/2023 18:13	No		Lateral	N/A	Unknown		
2700 EAST STRATHMORE AVE	6/1/2023	6/1/2023 17:38	No		Mainline	N/A	Unknown		
6000 EASTERN PKWY	6/1/2023	6/1/2023 20:18	No		Lateral	N/A	Unknown		
4600 BELVIEU AVE	6/1/2023	6/1/2023 19:46	No		Mainline	N/A	Unknown		
3800 PARKMONT AVE	6/1/2023	6/1/2023 20:36	No		Lateral	N/A	Unknown		
2600 QUEEN ANNE RD	6/2/2023	6/2/2023 8:33	No		Mainline	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
100 ENFIELD RD	6/2/2023	6/2/2023 8:49	No		Lateral	N/A	Unknown		
6600 BOSTON ST	6/2/2023	6/2/2023 9:55	No		Lateral	N/A	Unknown		
200 NORTH EDGEWOOD ST	6/2/2023	6/2/2023 8:57	No		Lateral	N/A	Unknown		
3900 WILKENS AVE	6/2/2023	6/2/2023 10:03	No		Mainline	N/A	Unknown		
2700 RAYNER AVE	6/2/2023	6/2/2023 9:36	No		Lateral	N/A	Unknown		
400 HAZLETT AVE	6/2/2023	6/2/2023 14:53	No		Lateral	N/A	Unknown		
3800 MIDHEIGHTS RD	6/2/2023	6/2/2023 12:49	No		Lateral	N/A	Unknown		
1300 AISQUITH ST	6/2/2023	6/2/2023 13:40	No		Mainline	N/A	Unknown		
5300 CATALPHA RD	6/2/2023	6/2/2023 14:06	No		Lateral	N/A	Unknown		
3900 DOLFIELD AVE	6/2/2023	6/2/2023 17:03	No		Lateral	N/A	Unknown		
900 NORTH ARLINGTON AVE	6/2/2023	6/2/2023 18:08	No		Mainline	N/A	Unknown		
4900 WESTHILLS RD	6/2/2023	6/2/2023 19:20	No		Mainline and Lateral	N/A	Unknown		
3000 ROSALIE AVE	6/2/2023	6/2/2023 19:53	No		Lateral	N/A	Unknown		
1500 GLENEAGLE RD	6/2/2023	6/2/2023 20:06	No		Lateral	N/A	Unknown		
4000 CHATHAM RD	6/2/2023	6/2/2023 17:26	No		Lateral	N/A	Unknown		
4400 RASPE AVE	6/2/2023	6/2/2023 20:25	No		Lateral	N/A	Unknown		
1700 PRESBURY ST	6/3/2023	6/3/2023 11:38	No		Mainline	N/A	Unknown		
3000 ROSELAWN AVE	6/3/2023	6/3/2023 13:45	No		Lateral	N/A	Unknown		
2400 REISTERSTOWN RD	6/3/2023	6/3/2023 14:43	No		Lateral	N/A	Unknown		
3700 BAYONNE AVE	6/3/2023	6/3/2023 18:19	No		Lateral	N/A	Unknown		
700 DENISON ST	6/3/2023	6/3/2023 17:38	No		Lateral	N/A	Unknown		
5200 CORDELIA AVE	6/3/2023	6/3/2023 21:20	No		Mainline	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
6600 HILLTOP AVE	6/3/2023	6/3/2023 21:36	No		Mainline and Lateral	N/A	Unknown		
1800 NORTHBOURNE RD	6/4/2023	6/4/2023 10:06	No		Lateral	N/A	Unknown		
1200 ARGONNE DR	6/4/2023	6/4/2023 11:36	No		Lateral	N/A	Unknown		
3600 MALDEN AVE	6/4/2023	6/4/2023 11:39	No		Lateral	N/A	Unknown		
3800 1 2 BELLE AVE	6/4/2023	6/4/2023 13:09	No		Lateral	N/A	Unknown		
2800 MAYFIELD AVE	6/4/2023	6/4/2023 14:59	No		Lateral	N/A	Unknown		
4400 PARKTON ST	6/4/2023	6/4/2023 17:32	No		Mainline and Lateral	N/A	Unknown		
5600 FORCE RD	6/4/2023	6/4/2023 22:15	No		Mainline	N/A	Unknown		
1100 NORTH CENTRAL AVE	6/4/2023	6/4/2023 22:36	No		Lateral	N/A	Unknown		
6200 TRAMORE RD	6/4/2023	6/5/2023 11:28	No		Lateral	N/A	Unknown		
5600 FORCE RD	6/4/2023	6/5/2023 12:19	No		Mainline and Lateral	N/A	Unknown		
800 WOODWARD ST	6/5/2023	6/5/2023 11:01	No		Lateral	N/A	Unknown		
3900 DOLFIELD AVE	6/5/2023	6/5/2023 9:49	No		Lateral	N/A	Unknown		
1400 WOODALL ST	6/5/2023	6/5/2023 9:57	No		Lateral	N/A	Unknown		
2300 SAINT PAUL ST	6/5/2023	6/5/2023 16:37	No		Lateral	N/A	Unknown		
2900 ELGIN AVE	6/5/2023	6/5/2023 10:57	No		Lateral	N/A	Unknown		
400 NORTHWAY	6/5/2023	6/5/2023 15:06	No		Lateral	N/A	Unknown		
3100 MILFORD AVE	6/5/2023	6/5/2023 11:52	No		Mainline	N/A	Unknown		
3600 GREENVALE RD	6/5/2023	6/5/2023 12:31	No		Lateral	N/A	Unknown		
3600 EDGEWOOD RD	6/5/2023	6/5/2023 19:03	No		Mainline and Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
2400 REISTERSTOWN RD	6/5/2023	6/5/2023 18:40	No		Lateral	N/A	Unknown		
4700 FREDERICK AVE	6/5/2023	6/5/2023 19:51	No		Lateral	N/A	Unknown		
2900 EAST MADISON ST	6/5/2023	6/5/2023 20:07	No		Lateral	N/A	Unknown		
100 MALLOW HILL RD	6/5/2023	6/5/2023 19:12	No		Lateral	N/A	Unknown		
3600 ELKADER RD	6/5/2023	6/5/2023 22:04	No		Mainline	N/A	Unknown		
2400 MOSHER ST	6/6/2023	6/6/2023 9:01	No		Mainline and Lateral	N/A	Unknown		
2400 KEYWORTH AVE	6/6/2023	6/6/2023 14:32	No		Lateral	N/A	Unknown		
1200 RAMBLEWOOD RD	6/6/2023	6/6/2023 12:18	No		Lateral	N/A	Unknown		
700 DEEPDENE RD	6/6/2023	6/6/2023 18:56	No		Mainline and Lateral	N/A	Unknown		
3900 ROSECREST AVE	6/6/2023	6/6/2023 19:18	No		Lateral	N/A	Unknown		
1800 BANK ST	6/6/2023	6/6/2023 13:14	No		Mainline and Lateral	N/A	Unknown		
2100 HOLLINS ST	6/6/2023	6/6/2023 14:11	No		Mainline	N/A	Unknown		
1200 EVESHAM AVE	6/6/2023	6/6/2023 14:27	No		Lateral	N/A	Unknown		
4000 FREDERICK AVE	6/6/2023	6/6/2023 17:26	No		Mainline	N/A	Unknown		
900 NORTH ARLINGTON AVE	6/6/2023	6/6/2023 16:58	No		Mainline	N/A	Unknown		
2500 HAMILTON AVE	6/6/2023	6/6/2023 18:37	No		Lateral	N/A	Unknown		
4500 REISTERSTOWN RD	6/7/2023	6/7/2023 17:00	No		Mainline	N/A	Unknown		
2400 EAST LAFAYETTE AVE	6/7/2023	6/7/2023 12:32	No		Lateral	N/A	Unknown		
3800 EAST BIDDLE ST	6/7/2023	6/7/2023 12:51	No		Mainline	N/A	Unknown		
600 SOUTH ROSE ST	6/7/2023	6/7/2023 13:33	No		Mainline	N/A	Unknown		
4600 KESWICK RD	6/7/2023	6/7/2023 18:41	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
1100 WEST 38TH ST	6/7/2023	6/7/2023 18:53	No		Lateral	N/A	Unknown		
6100 CHINQUAPIN PKWY	6/8/2023	6/8/2023 9:58	No		Mainline	N/A	Unknown		
3000 SAINT PAUL ST	6/8/2023	6/8/2023 8:58	No		Lateral	N/A	Unknown		
500 DENISON ST	6/8/2023	6/8/2023 10:06	No		Mainline and Lateral	N/A	Unknown		
5300 SINCLAIR LN	6/8/2023	6/8/2023 13:59	No		Mainline	N/A	Unknown		
4200 SHAMROCK AVE	6/8/2023	6/8/2023 14:36	No		Lateral	N/A	Unknown		
2200 PENROSE AVE	6/8/2023	6/8/2023 12:50	No		Mainline and Lateral	N/A	Unknown		
6000 GLENOAK AVE	6/8/2023	6/8/2023 15:07	No		Lateral	N/A	Unknown		
600 NORTH PAYSON ST	6/8/2023	6/8/2023 19:29	No		Lateral	N/A	Unknown		
600 NORTH PULASKI ST	6/8/2023	6/8/2023 20:47	No		Mainline	N/A	Unknown		
1600 CHILTON ST	6/8/2023	6/8/2023 21:03	No		Mainline	N/A	Unknown		
1800 EUTAW PL	6/8/2023	6/8/2023 20:48	No		Mainline	N/A	Unknown		
600 MONTPELIER ST	6/8/2023	6/8/2023 21:39	No		Mainline	N/A	Unknown		
3000 FENDALL RD	6/8/2023	6/8/2023 19:25	No		Mainline	N/A	Unknown		
5200 TRAMORE RD	6/8/2023	6/8/2023 21:14	No		Lateral	N/A	Unknown		
1900 DRUID HILL AVE	6/8/2023	6/8/2023 20:58	No		Lateral	N/A	Unknown		
3500 ALAMEDA CIR	6/8/2023	6/9/2023 9:48	No		Lateral	N/A	Unknown		
1800 NORTHBOURNE RD	6/9/2023	6/9/2023 10:30	No		Lateral	N/A	Unknown		
200 PRESIDENT ST	6/9/2023	6/9/2023 12:18	No		Mainline and Lateral	N/A	Unknown		
0 SOUTH CAREY ST	6/9/2023	6/9/2023 12:03	No		Mainline	N/A	Unknown		
2000 CECIL AVE	6/9/2023	6/9/2023 15:35	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
1600 DRUID HILL AVE	6/9/2023	6/9/2023 14:53	No		Lateral	N/A	Unknown		
2700 WEST NORTH AVE	6/9/2023	6/9/2023 16:34	No		Mainline	N/A	Unknown		
1200 WEST CROSS ST	6/9/2023	6/9/2023 17:07	No		Mainline	N/A	Unknown		
3400 RAMONA AVE	6/9/2023	6/9/2023 18:17	No		Lateral	N/A	Unknown		
5600 PIONEER DR	6/9/2023	6/9/2023 21:15	No		Mainline	N/A	Unknown		
200 PRESIDENT ST	6/10/2023	6/10/2023 9:23	No		Mainline	N/A	Unknown		
6200 FAIRDEL AVE	6/10/2023	6/10/2023 11:45	No		Lateral	N/A	Unknown		
3200 MILFORD AVE	6/10/2023	6/10/2023 12:17	No		Mainline	N/A	Unknown		
3700 CEDARDALE RD	6/10/2023	6/10/2023 12:24	No		Mainline and Lateral	N/A	Unknown		
1200 WALKER AVE	6/10/2023	6/10/2023 12:28	No		Lateral	N/A	Unknown		
0 HADLEY SQ SOUTH	6/10/2023	6/10/2023 13:08	No		Lateral	N/A	Unknown		
2800 MAUDLIN AVE	6/10/2023	6/10/2023 14:06	No		Lateral	N/A	Unknown		
4900 LOCH RAVEN BLVD	6/10/2023	6/10/2023 14:29	No		Lateral	N/A	Unknown		
5900 BENTON HEIGHTS AVE	6/10/2023	6/10/2023 14:24	No		Lateral	N/A	Unknown		
4100 CREST HEIGHTS RD	6/10/2023	6/10/2023 14:55	No		Mainline and Lateral	N/A	Unknown		
1300 HOMESTEAD ST	6/10/2023	6/10/2023 17:18	No		Lateral	N/A	Unknown		
600 MONTPELIER ST	6/10/2023	6/10/2023 17:45	No		Mainline	N/A	Unknown		
3600 GREENWAY	6/10/2023	6/10/2023 17:11	No		Mainline	N/A	Unknown		
900 CHESTNUT HILL AVE	6/10/2023	6/10/2023 17:10	No		Lateral	N/A	Unknown		
1900 NORTHBOURNE RD	6/10/2023	6/10/2023 18:06	No		Lateral	N/A	Unknown		
400 NORTH KENWOOD AVE	6/11/2023	6/11/2023 17:22	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
3800 GLENGYLE AVE	6/11/2023	6/11/2023 19:41	No		Lateral	N/A	Unknown		
2600 CHELSEA TER	6/11/2023	6/11/2023 20:51	No		Lateral	N/A	Unknown		
700 DEACONHILL CT	6/12/2023	6/12/2023 9:38	No		Mainline and Lateral	N/A	Unknown		
5600 KAVON AVE	6/12/2023	6/12/2023 9:49	No		Mainline	N/A	Unknown		
4600 BELVIEU AVE	6/12/2023	6/12/2023 12:29	No		Lateral	N/A	Unknown		
500 EAST PATAPSCO AVE	6/12/2023	6/12/2023 19:14	No		Mainline	N/A	Unknown		
4900 BELAIR RD	6/12/2023	6/12/2023 13:19	No		Mainline	N/A	Unknown		
1500 NORTHGATE RD	6/12/2023	6/12/2023 13:27	No		Lateral	N/A	Unknown		
4100 BALFERN AVE	6/12/2023	6/12/2023 14:26	No		Lateral	N/A	Unknown		
2800 HARVIEW AVE	6/12/2023	6/12/2023 16:42	No		Lateral	N/A	Unknown		
1800 RIGGS AVE	6/12/2023	6/12/2023 18:30	No		Mainline	N/A	Unknown		
3600 CALLAWAY AVE	6/12/2023	6/12/2023 17:24	No		Mainline	N/A	Unknown		
1100 GLENEAGLE RD	6/12/2023	6/12/2023 18:43	No		Lateral	N/A	Unknown		
1500 BYRD ST	6/12/2023	6/12/2023 20:29	No		Lateral	N/A	Unknown		
700 SOUTH WOODINGTON RD	6/12/2023	6/12/2023 21:06	No		Lateral	N/A	Unknown		
4000 HILLCREST AVE	6/13/2023	6/13/2023 9:54	No		Lateral	N/A	Unknown		
5500 JONQUIL AVE	6/13/2023	6/13/2023 11:26	No		Lateral	N/A	Unknown		
3900 BANCROFT RD	6/13/2023	6/13/2023 12:13	No		Lateral	N/A	Unknown		
3800 MOHAWK AVE	6/13/2023	6/13/2023 13:24	No		Lateral	N/A	Unknown		
700 BELLE TERRE AVE	6/13/2023	6/13/2023 13:49	No		Mainline	N/A	Unknown		
2900 EAST MADISON ST	6/13/2023	6/13/2023 17:31	No		Mainline	N/A	Unknown		
2800 NORTH HOWARD ST	6/13/2023	6/13/2023 20:28	No		Mainline	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
900 BENNETT PL	6/13/2023	6/13/2023 21:35	No		Lateral	N/A	Unknown		
3200 ELGIN AVE	6/14/2023	6/14/2023 9:13	No		Mainline and Lateral	N/A	Unknown		
5300 HERRING RUN DR	6/14/2023	6/14/2023 8:35	No		Mainline	N/A	Unknown		
3000 ELGIN AVE	6/14/2023	6/14/2023 9:27	No		Lateral	N/A	Unknown		
3000 OVERLAND AVE	6/14/2023	6/14/2023 10:17	No		Mainline	N/A	Unknown		
6300 WESTERN RUN DR	6/14/2023	6/14/2023 10:08	No		Lateral	N/A	Unknown		
6200 NORTHWOOD DR	6/14/2023	6/14/2023 11:21	No		Mainline and Lateral	N/A	Unknown		
2900 ERDMAN AVE	6/14/2023	6/14/2023 12:27	No		Mainline	N/A	Unknown		
1900 NORTH FOREST PARK AVE	6/14/2023	6/14/2023 12:01	No		Mainline and Lateral	N/A	Unknown		
1400 HULL ST	6/14/2023	6/14/2023 13:33	No		Mainline	N/A	Unknown		
4700 ALHAMBRA AVE	6/14/2023	6/14/2023 15:11	No		Lateral	N/A	Unknown		
4000 BARRINGTON RD	6/14/2023	6/14/2023 17:50	No		Mainline	N/A	Unknown		
2900 LYNDHURST AVE	6/14/2023	6/14/2023 17:05	No		Mainline and Lateral	N/A	Unknown		
1700 NORTH CHESTER ST	6/14/2023	6/14/2023 15:30	No		Lateral	N/A	Unknown		
3000 FENDALL RD	6/14/2023	6/14/2023 19:32	No		Mainline	N/A	Unknown		
3400 PINKNEY RD	6/14/2023	6/14/2023 23:16	No		Lateral	N/A	Unknown		
2800 FLEETWOOD AVE	6/14/2023	6/14/2023 23:27	No		Lateral	N/A	Unknown		
5600 KAVON AVE	6/15/2023	6/15/2023 9:49	No		Lateral	N/A	Unknown		
800 SOUTH SHARP ST	6/15/2023	6/15/2023 10:12	No		Lateral	N/A	Unknown		
1200 COOKS LN	6/15/2023	6/15/2023 9:47	No		Mainline and Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
2900 FLEETWOOD AVE	6/15/2023	6/15/2023 13:56	No		Mainline	N/A	Unknown		
3500 KENYON AVE	6/15/2023	6/15/2023 14:30	No		Mainline	N/A	Unknown		
2600 PARK HEIGHTS TER	6/15/2023	6/15/2023 15:25	No		Lateral	N/A	Unknown		
400 SOUTH WICKHAM RD	6/15/2023	6/15/2023 19:08	No		Lateral	N/A	Unknown		
2400 HAMILTON AVE	6/15/2023	6/15/2023 19:43	No		Lateral	N/A	Unknown		
2100 POPLAR GROVE ST	6/15/2023	6/15/2023 20:20	No		Lateral	N/A	Unknown		
1400 EDISON HWY	6/15/2023	6/15/2023 21:28	No		Mainline and Lateral	N/A	Unknown		
1300 LAURENS ST	6/16/2023	6/16/2023 8:43	No		Mainline	N/A	Unknown		
1200 NORTH AUGUSTA AVE	6/16/2023	6/16/2023 10:33	No		Mainline	N/A	Unknown		
1700 WEST NORTH AVE	6/16/2023	6/16/2023 11:56	No		Mainline	N/A	Unknown		
3900 CANTERBURY RD	6/16/2023	6/16/2023 11:33	No		Mainline	N/A	Unknown		
1200 WEST 40TH ST	6/16/2023	6/16/2023 12:33	No		Mainline and Lateral	N/A	Unknown		
2300 ANOKA AVE	6/16/2023	6/16/2023 14:01	No		Mainline	N/A	Unknown		
1600 NORTHWICK CT	6/16/2023	6/16/2023 13:23	No		Mainline and Lateral	N/A	Unknown		
1800 HILLENWOOD RD	6/16/2023	6/16/2023 17:22	No		Lateral	N/A	Unknown		
1400 WINSTON AVE	6/16/2023	6/16/2023 17:06	No		Mainline	N/A	Unknown		
6300 WALLIS AVE	6/16/2023	6/16/2023 18:20	No		Mainline	N/A	Unknown		
6400 ROSEMONT AVE	6/16/2023	6/16/2023 20:48	No		Mainline	N/A	Unknown		
200 SOUTH SMALLWOOD ST	6/16/2023	6/16/2023 22:18	No		Mainline	N/A	Unknown		
2300 MONTEBELLO TER	6/17/2023	6/17/2023 11:04	No		Lateral	N/A	Unknown		
800 BENNINGHAUS RD	6/17/2023	6/17/2023 11:25	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
3300 GLEN AVE	6/17/2023	6/17/2023 12:44	No		Mainline and Lateral	N/A	Unknown		
200 NORTH MONTFORD AVE	6/17/2023	6/17/2023 13:12	No		Mainline	N/A	Unknown		
3900 CANTERBURY RD	6/17/2023	6/17/2023 12:43	No		Lateral	N/A	Unknown		
3200 ELGIN AVE	6/17/2023	6/17/2023 14:15	No		Mainline and Lateral	N/A	Unknown		
5400 WOODMONT AVE	6/17/2023	6/17/2023 16:32	No		Lateral	N/A	Unknown		
1500 MCHENRY ST	6/17/2023	6/17/2023 15:07	No		Lateral	N/A	Unknown		
6200 CHINQUAPIN PKWY	6/17/2023	6/17/2023 15:47	No		Lateral	N/A	Unknown		
1600 PENTWOOD RD	6/17/2023	6/17/2023 16:36	No		Lateral	N/A	Unknown		
2900 GEORGETOWN RD	6/18/2023	6/18/2023 9:34	No		Mainline	N/A	Unknown		
1700 LANCASTER ST	6/18/2023	6/18/2023 11:22	No		Lateral	N/A	Unknown		
4400 HICKORY AVE	6/18/2023	6/18/2023 13:14	No		Lateral	N/A	Unknown		
2700 EAST BALTIMORE ST	6/18/2023	6/18/2023 14:39	No		Mainline and Lateral	N/A	Unknown		
1500 WINSTON AVE	6/18/2023	6/18/2023 16:53	No		Lateral	N/A	Unknown		
2000 SWANSEA RD	6/18/2023	6/18/2023 20:08	No		Lateral	N/A	Unknown		
2800 MAYFIELD AVE	6/18/2023	6/18/2023 20:11	No		Lateral	N/A	Unknown		
5800 MEADOWOOD RD	6/18/2023	6/18/2023 22:23	No		Lateral	N/A	Unknown		
5300 WABASH AVE	6/19/2023	6/19/2023 11:34	No		Lateral	N/A	Unknown		
3800 ROKEBY RD	6/19/2023	6/19/2023 13:47	No		Lateral	N/A	Unknown		
1600 PENTWOOD RD	6/19/2023	6/19/2023 15:10	No		Mainline and Lateral	N/A	Unknown		
1300 ARGONNE DR	6/19/2023	6/19/2023 17:36	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
2800 EAST FEDERAL ST	6/19/2023	6/19/2023 17:41	No		Lateral	N/A	Unknown		
3300 OLYMPIA AVE	6/19/2023	6/19/2023 21:15	No		Lateral	N/A	Unknown		
1900 HEATHFIELD RD	6/19/2023	6/19/2023 22:48	No		Lateral	N/A	Unknown		
1500 WINDEMERE AVE	6/20/2023	6/20/2023 8:59	No		Mainline	N/A	Unknown		
3000 HANLON AVE	6/20/2023	6/20/2023 11:04	No		Lateral	N/A	Unknown		
4800 MELBOURNE RD	6/20/2023	6/20/2023 10:05	No		Lateral	N/A	Unknown		
4100 WOODHAVEN AVE	6/20/2023	6/20/2023 11:21	No		Mainline and Lateral	N/A	Unknown		
1300 GLENWOOD AVE	6/20/2023	6/20/2023 12:21	No		Lateral	N/A	Unknown		
800 GUILFORD AVE	6/20/2023	6/20/2023 14:22	No		Mainline	N/A	Unknown		
500 DENISON ST	6/20/2023	6/20/2023 13:03	No		Lateral	N/A	Unknown		
5900 BELLONA AVE	6/20/2023	6/20/2023 13:47	No		Mainline	N/A	Unknown		
6200 PLYMOUTH RD	6/20/2023	6/20/2023 14:09	No		Lateral	N/A	Unknown		
4100 DUDLEY AVE	6/20/2023	6/20/2023 15:20	No		Lateral	N/A	Unknown		
600 GORSUCH AVE	6/20/2023	6/20/2023 16:52	No		Mainline and Lateral	N/A	Unknown		
1600 LOCHWOOD RD	6/20/2023	6/20/2023 17:11	No		Lateral	N/A	Unknown		
5300 FERNPARK AVE	6/20/2023	6/20/2023 19:03	No		Mainline and Lateral	N/A	Unknown		
1700 SAINT PAUL ST	6/20/2023	6/20/2023 17:04	No		Lateral	N/A	Unknown		
3400 ELMLEY AVE	6/20/2023	6/20/2023 17:47	No		Mainline	N/A	Unknown		
3700 GWYNNS FALLS PKWY	6/20/2023	6/20/2023 18:21	No		Lateral	N/A	Unknown		
3600 SEVEN MILE LN	6/21/2023	6/21/2023 11:10	No		Mainline	N/A	Unknown		
5400 BUCKNELL RD	6/21/2023	6/21/2023 9:12	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
800 WASHBURN AVE	6/21/2023	6/21/2023 10:54	No		Lateral	N/A	Unknown		
3600 1 2 SEVEN MILE LN	6/21/2023	6/21/2023 11:25	No		Mainline	N/A	Unknown		
2100 WHISTLER AVE	6/21/2023	6/21/2023 13:06	No		Lateral	N/A	Unknown		
6100 CHINQUAPIN PKWY	6/21/2023	6/21/2023 13:48	No		Lateral	N/A	Unknown		
300 SCOTT ST	6/21/2023	6/21/2023 15:27	No		Mainline and Lateral	N/A	Unknown		
1100 KEVIN RD	6/21/2023	6/21/2023 16:34	No		Lateral	N/A	Unknown		
3700 GREENMOUNT AVE	6/21/2023	6/21/2023 17:48	No		Mainline	N/A	Unknown		
2600 EAST CHASE ST	6/21/2023	6/21/2023 18:02	No		Mainline	N/A	Unknown		
1700 LANCASTER ST	6/21/2023	6/21/2023 19:41	No		Lateral	N/A	Unknown		
1900 FAIRBANK RD	6/21/2023	6/21/2023 20:38	No		Lateral	N/A	Unknown		
1500 KINGSWAY RD	6/21/2023	6/21/2023 21:32	No		Lateral	N/A	Unknown		
1100 SHERWOOD AVE	6/21/2023	6/21/2023 22:18	No		Lateral	N/A	Unknown		
1300 1 2 SHERWOOD AVE	6/21/2023	6/21/2023 22:35	No		Lateral	N/A	Unknown		
5900 BLAND AVE	6/22/2023	6/22/2023 10:17	No		Lateral	N/A	Unknown		
3600 KENYON AVE	6/22/2023	6/22/2023 9:10	No		Mainline and Lateral	N/A	Unknown		
200 NORTH MONTFORD AVE	6/22/2023	6/22/2023 10:08	No		Mainline	N/A	Unknown		
5900 BLAND AVE	6/22/2023	6/22/2023 10:22	No		Lateral	N/A	Unknown		
5200 CORDELIA AVE	6/22/2023	6/22/2023 12:32	No		Mainline and Lateral	N/A	Unknown		
0 SOUTH MONASTERY AVE	6/22/2023	6/22/2023 12:57	No		Mainline and Lateral	N/A	Unknown		
900 FLEET ST	6/22/2023	6/22/2023 13:45	No		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
2300 NORTH DUKELAND ST	6/22/2023	6/22/2023 13:55	No		Lateral	N/A	Unknown		
800 GLEN ALLEN DR	6/22/2023	6/22/2023 14:20	No		Mainline and Lateral	N/A	Unknown		
800 WEST 33RD ST	6/22/2023	6/22/2023 17:32	No		Lateral	N/A	Unknown		
1500 NORTH POTOMAC ST	6/22/2023	6/22/2023 18:22	No		Mainline and Lateral	N/A	Unknown		
4000 LIBERTY HEIGHTS AVE	6/22/2023	6/22/2023 20:58	No		Lateral	N/A	Unknown		
3600 1 2 SEVEN MILE LN	6/23/2023	6/23/2023 9:21	No		Mainline	N/A	Unknown		
3600 SEVEN MILE LN	6/23/2023	6/23/2023 9:31	No		Mainline	N/A	Unknown		
3600 SEVEN MILE LN	6/23/2023	6/23/2023 9:32	No		Mainline	N/A	Unknown		
1900 LINDEN AVE	6/23/2023	6/23/2023 9:56	No		Lateral	N/A	Unknown		
1400 WINSTON AVE	6/23/2023	6/23/2023 10:40	No		Lateral	N/A	Unknown		
3500 DUDLEY AVE	6/23/2023	6/23/2023 11:20	No		Mainline	N/A	Unknown		
3000 BEVERLY RD	6/23/2023	6/23/2023 11:13	No		Mainline	N/A	Unknown		
2600 EAST CHASE ST	6/23/2023	6/23/2023 11:25	No		Lateral	N/A	Unknown		
3800 CEDARHURST RD	6/23/2023	6/23/2023 11:41	No		Mainline	N/A	Unknown		
3400 WOODSTOCK AVE	6/23/2023	6/23/2023 13:14	No		Lateral	N/A	Unknown		
4000 FREDERICK AVE	6/23/2023	6/23/2023 17:14	No		Mainline	N/A	Unknown		
4100 SAINT GEORGES AVE	6/23/2023	6/23/2023 19:51	No		Mainline and Lateral	N/A	Unknown		
2300 WEST LANVALE ST	6/24/2023	6/24/2023 10:10	No		Lateral	N/A	Unknown		
3600 ELKADER RD	6/24/2023	6/24/2023 14:38	No		Mainline	N/A	Unknown		
2000 EAST PRESTON ST	6/24/2023	6/24/2023 14:43	No		Lateral	N/A	Unknown		
2900 FLEETWOOD AVE	6/24/2023	6/24/2023 17:33	No		Mainline	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
3700 CEDARDALE RD	6/24/2023	6/24/2023 16:24	No		Lateral	N/A	Unknown		
5200 DARIEN RD	6/24/2023	6/24/2023 21:34	No		Mainline	N/A	Unknown		
2600 KENTUCKY AVE	6/24/2023	6/24/2023 21:55	No		Lateral	N/A	Unknown		
4700 KERNWOOD AVE	6/25/2023	6/25/2023 9:49	No		Lateral	N/A	Unknown		
100 WEST LAKE AVE	6/25/2023	6/25/2023 14:11	No		Lateral	N/A	Unknown		
3300 ELMLEY AVE	6/25/2023	6/25/2023 17:37	No		Lateral	N/A	Unknown		
1200 WICKLOW RD	6/25/2023	6/25/2023 17:04	No		Lateral	N/A	Unknown		
5300 NELSON AVE	6/26/2023	6/26/2023 9:01	No		Lateral	N/A	Unknown		
700 COLORADO AVE	6/26/2023	6/26/2023 13:48	No		Mainline	N/A	Unknown		
2600 MOORE AVE	6/26/2023	6/26/2023 10:14	No		Lateral	N/A	Unknown		
5700 LIBERTY HEIGHTS AVE	6/26/2023	6/26/2023 19:06	No		Mainline	N/A	Unknown		
500 SOUTH BENTALOU ST	6/26/2023	6/26/2023 12:39	No		Lateral	N/A	Unknown		
3400 ORLANDO AVE	6/26/2023	6/26/2023 14:31	No		Lateral	N/A	Unknown		
0 UPLAND RD	6/26/2023	6/26/2023 20:29	No		Lateral	N/A	Unknown		
1500 WINSTON AVE	6/26/2023	6/26/2023 16:27	No		Lateral	N/A	Unknown		
4700 CHATFORD AVE	6/26/2023	6/26/2023 17:21	No		Lateral	N/A	Unknown		
2000 EAST PRESTON ST	6/26/2023	6/26/2023 19:29	No		Mainline	N/A	Unknown		
3500 VIRGINIA AVE	6/26/2023	6/26/2023 21:37	Yes		Lateral	N/A	Unknown		
6100 EVERALL AVE	6/26/2023	6/26/2023 20:11	No		Lateral	N/A	Unknown		
4600 PARKTON ST	6/27/2023	6/27/2023 10:17	No		Mainline	N/A	Unknown		
5900 YORKWOOD RD	6/27/2023	6/27/2023 10:51	Yes		Mainline and Lateral	N/A	Unknown		
1500 STONEWOOD RD	6/27/2023	6/27/2023 14:45	Yes		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
2900 GRANTLEY AVE	6/27/2023	6/27/2023 13:03	Yes		Lateral	N/A	Unknown		
5900 BENTON HEIGHTS AVE	6/27/2023	6/27/2023 12:48	Yes		Mainline	N/A	Unknown		
100 NORTH ATHOL AVE	6/27/2023	6/27/2023 13:24	No		Lateral	N/A	Unknown		
6700 DANVILLE AVE	6/27/2023	6/27/2023 13:55	Yes		Lateral	N/A	Unknown		
4200 ELDERON AVE	6/27/2023	6/27/2023 13:31	Yes		Mainline and Lateral	N/A	Unknown		
4000 DUDLEY AVE	6/27/2023	6/27/2023 17:28	Yes		Lateral	N/A	Unknown		
600 ANNABEL AVE	6/27/2023	6/27/2023 14:38	Yes		Lateral	N/A	Unknown		
1600 WINFORD RD	6/27/2023	6/27/2023 18:44	Yes		Lateral	N/A	Unknown		
3800 FAIRHAVEN AVE	6/27/2023	6/27/2023 15:22	Yes		Mainline	N/A	Unknown		
3600 FAIRHAVEN AVE	6/27/2023	6/27/2023 16:43	Yes		Lateral	N/A	Unknown		
6100 EVERALL AVE	6/27/2023	6/27/2023 20:30	Yes		Mainline	N/A	Unknown		
6100 EVERALL AVE	6/27/2023	6/27/2023 20:31	Yes		Mainline	N/A	Unknown		
5300 NUTH AVE	6/27/2023	6/28/2023 19:06	Yes		Mainline	N/A	Unknown		
3800 COPLEY RD	6/28/2023	6/28/2023 8:36	Yes		Lateral	N/A	Unknown		
3100 PRESSTMAN ST	6/28/2023	6/28/2023 10:03	Yes		Mainline	N/A	Unknown		
3200 1 2 FALLSTAFF RD	6/28/2023	6/28/2023 10:55	Yes		Lateral	N/A	Unknown		
400 EVESHAM AVE	6/28/2023	6/28/2023 11:08	Yes		Mainline	N/A	Unknown		
4700 LIBERTY HEIGHTS AVE	6/28/2023	6/28/2023 11:37	Yes		Mainline	N/A	Unknown		
1100 WICKLOW RD	6/28/2023	6/28/2023 12:11	Yes		Lateral	N/A	Unknown		
1000 REVERDY RD	6/28/2023	6/28/2023 14:34	Yes		Lateral	N/A	Unknown		
2600 WEGWORTH LN	6/28/2023	6/28/2023 14:09	Yes		Lateral	N/A	Unknown		


Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
5300 CHANDLER AVE	6/28/2023	6/28/2023 14:40	Yes		Mainline and Lateral	N/A	Unknown		
400 NORTH LINWOOD AVE	6/28/2023	6/28/2023 21:03	Yes		Lateral	N/A	Unknown		
6700 DANVILLE AVE	6/28/2023	6/28/2023 17:43	Yes		Lateral	N/A	Unknown		
3000 ROSALIE AVE	6/28/2023	6/28/2023 20:32	Yes		Lateral	N/A	Unknown		
2300 WEST BALTIMORE ST	6/28/2023	6/28/2023 19:03	Yes		Mainline	N/A	Unknown		
1700 INGRAM RD	6/28/2023	6/28/2023 21:24	Yes		Lateral	N/A	Unknown		
4200 ELDERON AVE	6/28/2023	6/28/2023 22:34	Yes		Lateral	N/A	Unknown		
800 EAST 34TH ST	6/29/2023	6/29/2023 11:29	No		Mainline	N/A	Unknown		
3800 WEST FOREST PARK AVE	6/29/2023	6/29/2023 11:23	Yes		Mainline	N/A	Unknown		
5100 ARDMORE WAY	6/29/2023	6/29/2023 11:56	No		Mainline	N/A	Unknown		
0 SOUTH MONASTERY AVE	6/29/2023	6/29/2023 12:09	Yes		Lateral	N/A	Unknown		
3000 MONDAWMIN AVE	6/29/2023	6/29/2023 14:35	Yes		Lateral	N/A	Unknown		
4200 SHAMROCK AVE	6/29/2023	6/29/2023 17:36	No		Lateral	N/A	Unknown		
1000 PARKSLEY AVE	6/29/2023	6/29/2023 17:43	Yes		Mainline	N/A	Unknown		
2500 WEST LANVALE ST	6/29/2023	6/29/2023 17:05	Yes		Mainline	N/A	Unknown		
4900 BOWLAND AVE	6/30/2023	6/30/2023 9:30	No		Lateral	N/A	Unknown		
500 EAST CLEMENT ST	6/30/2023	6/30/2023 9:16	No		Mainline	N/A	Unknown		
2000 EAST PRESTON ST	6/30/2023	6/30/2023 10:02	No		Lateral	N/A	Unknown		
1300 WEST 40TH ST	6/30/2023	6/30/2023 11:21	No		Lateral	N/A	Unknown		
600 WEST 39TH ST	6/30/2023	6/30/2023 11:40	No		Lateral	N/A	Unknown		
1900 BLOOMINGDALE RD	6/30/2023	6/30/2023 12:33	No		Mainline	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
4000 OAKFORD AVE	6/30/2023	6/30/2023 13:09	No		Mainline and Lateral	N/A	Unknown		
4000 SPRINGDALE AVE	6/30/2023	6/30/2023 12:51	No		Lateral	N/A	Unknown		
4000 GROVELAND AVE	6/30/2023	6/30/2023 13:49	No		Mainline and Lateral	N/A	Unknown		
3600 ELKADER RD	6/30/2023	6/30/2023 17:52	No		Lateral	N/A	Unknown		
800 WEST 35TH ST	6/30/2023	6/30/2023 17:12	No		Mainline	N/A	Unknown		
6000 BELLE VISTA AVE	6/30/2023	6/30/2023 17:40	No		Lateral	N/A	Unknown		
600 EAST 33RD ST	6/30/2023	6/30/2023 17:10	No		Lateral	N/A	Unknown		
1500 LOCHWOOD RD	6/30/2023	6/30/2023 18:14	No		Mainline	N/A	Unknown		
4300 WENDOVER RD	6/30/2023	6/30/2023 17:22	No		Lateral	N/A	Unknown		
2900 RAYSHIRE RD	6/30/2023	6/30/2023 17:54	No		Lateral	N/A	Unknown		
4900 WESTHILLS RD	6/30/2023	6/30/2023 18:45	No		Mainline	N/A	Unknown		
2800 SOUTH EDGECOMBE CIR	6/30/2023	6/30/2023 17:56	No		Mainline	N/A	Unknown		
4900 SAINT GEORGES AVE	6/30/2023	6/30/2023 21:39	Yes		Mainline	N/A	Unknown		
1300 SHERWOOD AVE	1/7/2023	1/8/2023 10:13	No		Mainline	N/A	Unknown		
3200 CLARKS LN	1/9/2023	1/9/2023 12:19	No		Mainline	N/A	Unknown		
3800 CALLAWAY AVE	1/18/2023	1/18/2023 15:12	No		Lateral	N/A	Unknown	Yes	Closed
3100 MILFORD AVE	1/24/2023	1/24/2023 18:23	No		Mainline and Lateral	N/A	Unknown		
1900 JEFFERSON ST	2/3/2023	2/3/2023 11:36	No		Mainline	N/A	Unknown		
2200 WEST LEXINGTON ST	2/12/2023	2/12/2023 17:19	No		Mainline	N/A	Unknown	Yes	Closed
1200 EAST 43 RD ST	2/17/2023	2/17/2023 16:41	Yes		Mainline	N/A	Unknown	Yes	Open
5600 PURDUE AVE	2/17/2023	2/17/2023 19:51	Yes		Lateral	N/A	Unknown		

Block Name	Date Reported	Response Date and Time	24 Hour Rain Event in Prior 48 Hours	Dates of Other Building Backups (within prior 36 months)	Cause, if Identified	If Unknown, Efforts to Identify	Estimated Volume Released Into the Building	Claim Filed	Status of Claim (if applicable)
<i>500 SOUTH HANOVER ST</i>	<i>3/4/2023</i>	<i>3/4/2023 13:55</i>	<i>Yes</i>		<i>Lateral</i>	<i>N/A</i>	<i>Unknown</i>	<i>Yes</i>	<i>Open</i>
<i>1500 NORTHGATE RD</i>	<i>3/6/2023</i>	<i>3/6/2023 20:35</i>	<i>No</i>		<i>Mainline and Lateral</i>	<i>N/A</i>	<i>Unknown</i>		
<i>100 NORTH KENWOOD AVE</i>	<i>3/20/2023</i>	<i>3/20/2023 10:43</i>	<i>No</i>		<i>Mainline</i>	<i>N/A</i>	<i>Unknown</i>		
<i>3800 LOCH RAVEN BLVD</i>	<i>3/26/2023</i>	<i>3/26/2023 19:25</i>	<i>No</i>		<i>Lateral</i>	<i>N/A</i>	<i>Unknown</i>	<i>Yes</i>	<i>Closed</i>

*Previously reported Building Backups are formatted in grey italicized text and current calendar quarter Building Backups are formatted in plain black font.

Attachment 4. Map of Reported Building Backups During the Calendar Quarter

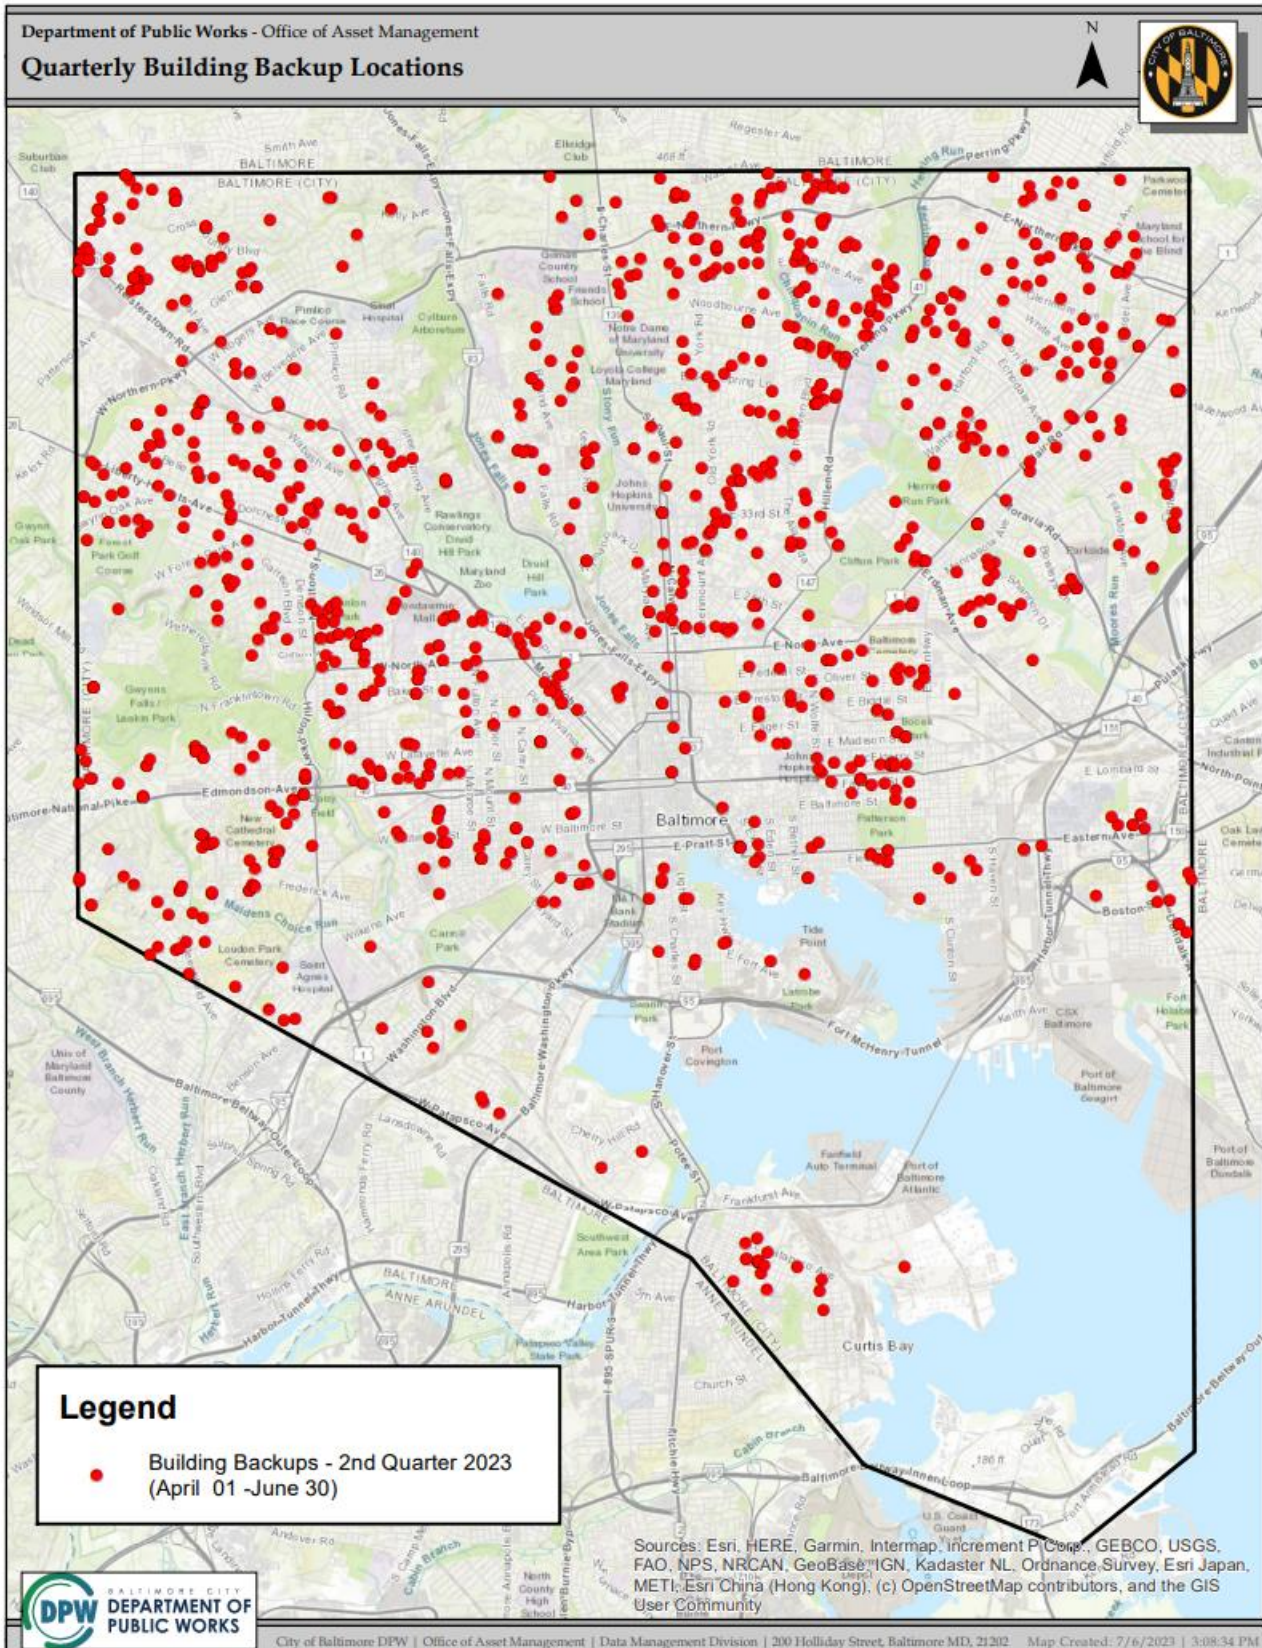

Attachment 5. SDUO

SDUO ¹ #	Date Occurrence Recorded	Location	Zip Code	Date of 5-day Report	Water Body Affected	Source Investigation Measures	Planned Future Work	Resolution ^{2,3} Date	Duration (days)	Estimated Volume ⁴ (gallons)
22HB02	07/15/2022	Greenmount Ave & 21 ½ St.	21218		Back River	Sewage found entering storm pipe. Investigation ongoing. Waiting for smoke machine to continue investigation. Dye testing performed 2/22/23 and letter of concern sent 2/17/23. Sent to OEC for repair. Repair complete. Abated.	Abated	6/30/2023	350	504,000
22GF01	08/10/2022	4013 W. Forest Park	21207		Gwynns Falls	Sewage leak into adjacent storm. Investigation ongoing. Unable to contact property owner. Letter of concern sent 9/15/22 and 10/13/22. Continued attempts to make contact by knocking on door and leaving door hangers on 2/15/23. Discharge has stopped.	Abated	4/11/2023	244	351
23JF01	01/18/2023	2900 Glen Ave.	21215		Jones Falls	Choked sewer on private line. Choke was relieved but permanent repair needs to occur. NOC sent for permanent repair. Temporary measure taken to stop discharge. Discharge not active. Monitoring water quality.	Monitoring water quality until repair is completed	2/3/2023	16	23,040
23JF03	05/04/2023	4210 N. Charles St.	21218		Jones Falls	Water discharging from an underdrain at an outfall that is contaminated with sewage. Sent to contractor for repair.		Ongoing	58	1,413
23JF04	05/18/2023	3802 Juniper Road (North branch)	21218		Jones Falls	Sewage is in the storm drain pipe. Further investigation needed.		Ongoing	44	17,832
23JF05	05/22/2023	3812 Juniper Road	21218		Jones Falls	House lateral found to be leaking into the storm pipe. Working on repair plan.		Ongoing	40	14,400
23JF06	05/24/2023	216 E. 38 th St.	21218		Jones Falls	Direct connection to the storm drain pipe. Abated.	Abated	6/15/2023	22	8,554
23HB01	05/11/2023	501 S. Broadway	21231		Inner Harbor	Possible direct connection. Waiting for contractor to perform CCTV inspection.		Ongoing	51	18,360
23JF07	06/06/2023	5928 Falls Rd.	21209		Jones Falls	Property is still connected to an abandoned sewer pipe that discharges to the stream. Sent to contractor for CCTV inspection.		Ongoing	25	9,720
23JF08	06/07/2023	3505 Seven Miles Ln.	21208		Western Run	Property's sewer is connected to the clean water drain and storm pipe. Letter of concern sent.		Ongoing	24	9,331

¹ For any SDUO confirmed as originating from the collection system, footnote the SDUO with the date the written SSO report was submitted to MDE.

SDUO ¹ #	Date Occurrence Recorded	Location	Zip Code	Date of 5-day Report	Water Body Affected	Source Investigation Measures	Planned Future Work	Resolution ^{2,3} Date	Duration (days)	Estimated Volume ⁴ (gallons)
------------------------	--------------------------	----------	----------	----------------------	---------------------	-------------------------------	---------------------	--------------------------------	-----------------	---

² For sites that have not yet been resolved, "Estimated Volume (Gal)" is readjusted each quarter to reflect the elapse of time and any recent field information (flow, NH3, TKN) that may have been collected for a given site.

³ For all active sites the City ultimately plans on calculating flows using TKN - per guidelines of the approved protocol by EPA; flows calculated utilizing TKN or Ammonia concentrations.

⁴ Volume is calculated based on the SDUO Quantification Protocol dated November 12, 2010, and submitted by the City to the U.S. EPA on November 18, 2010.